
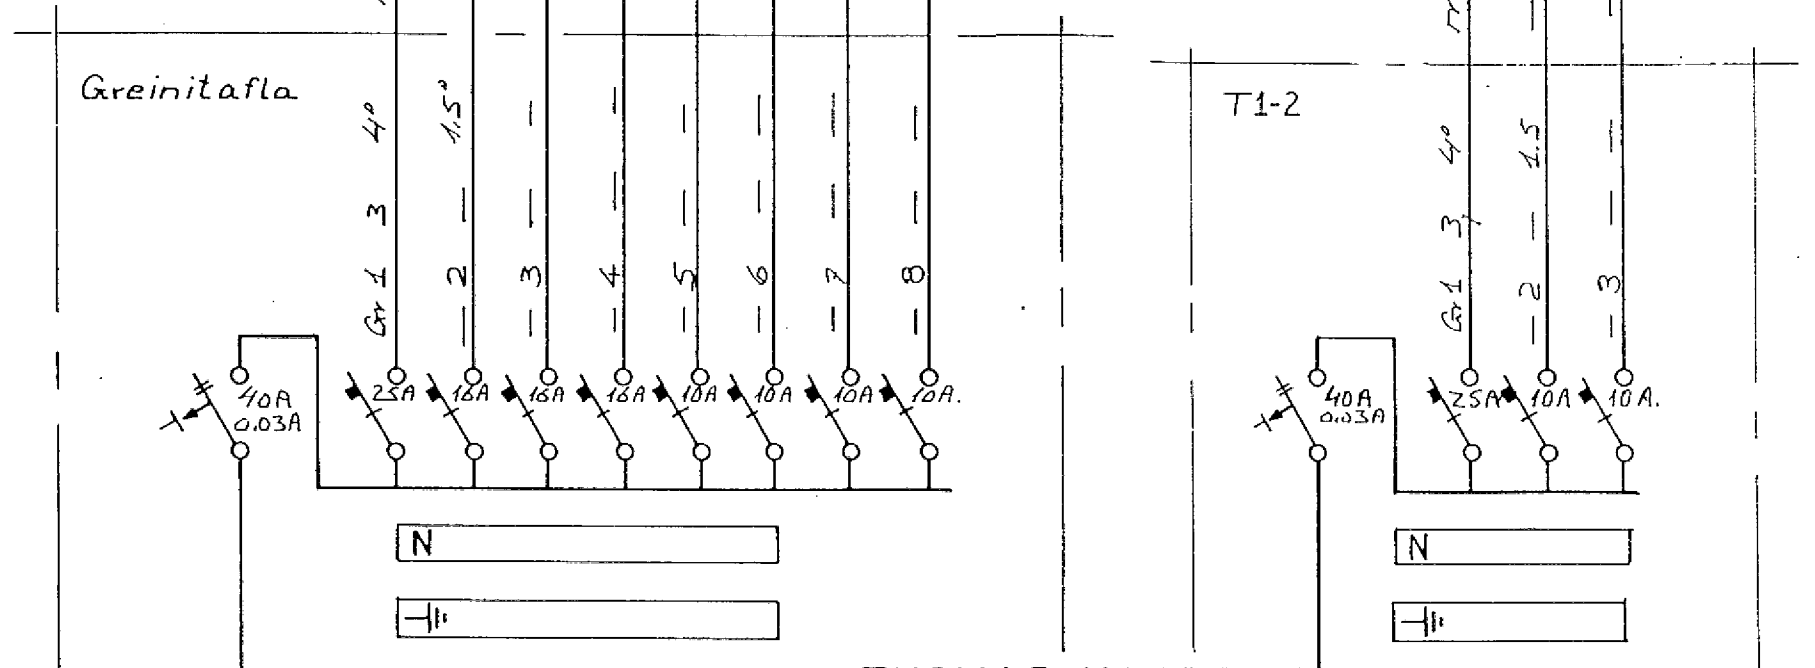


63mm pl.p.f. rafmínutak  
 25mm pl.p. aukar  
 50mm pl.p.f. símanntak  
 2x25mm pl.p.f. smáspennu  
 Rör fyrir loftnet skal vera 50mm.

- Þvottavél
- Purrkari
- Sorp Anod
- Geymsla
- Stiga hlús
- Síðgi
- Eldavél
- Uppþvottavél
- Örbylgjuofn
- Þvottavél
- Eldhlús
- Stofa
- Skáki G.
- Herb. Bæðhb.
- Eldavél
- Eldhlús
- Stofa

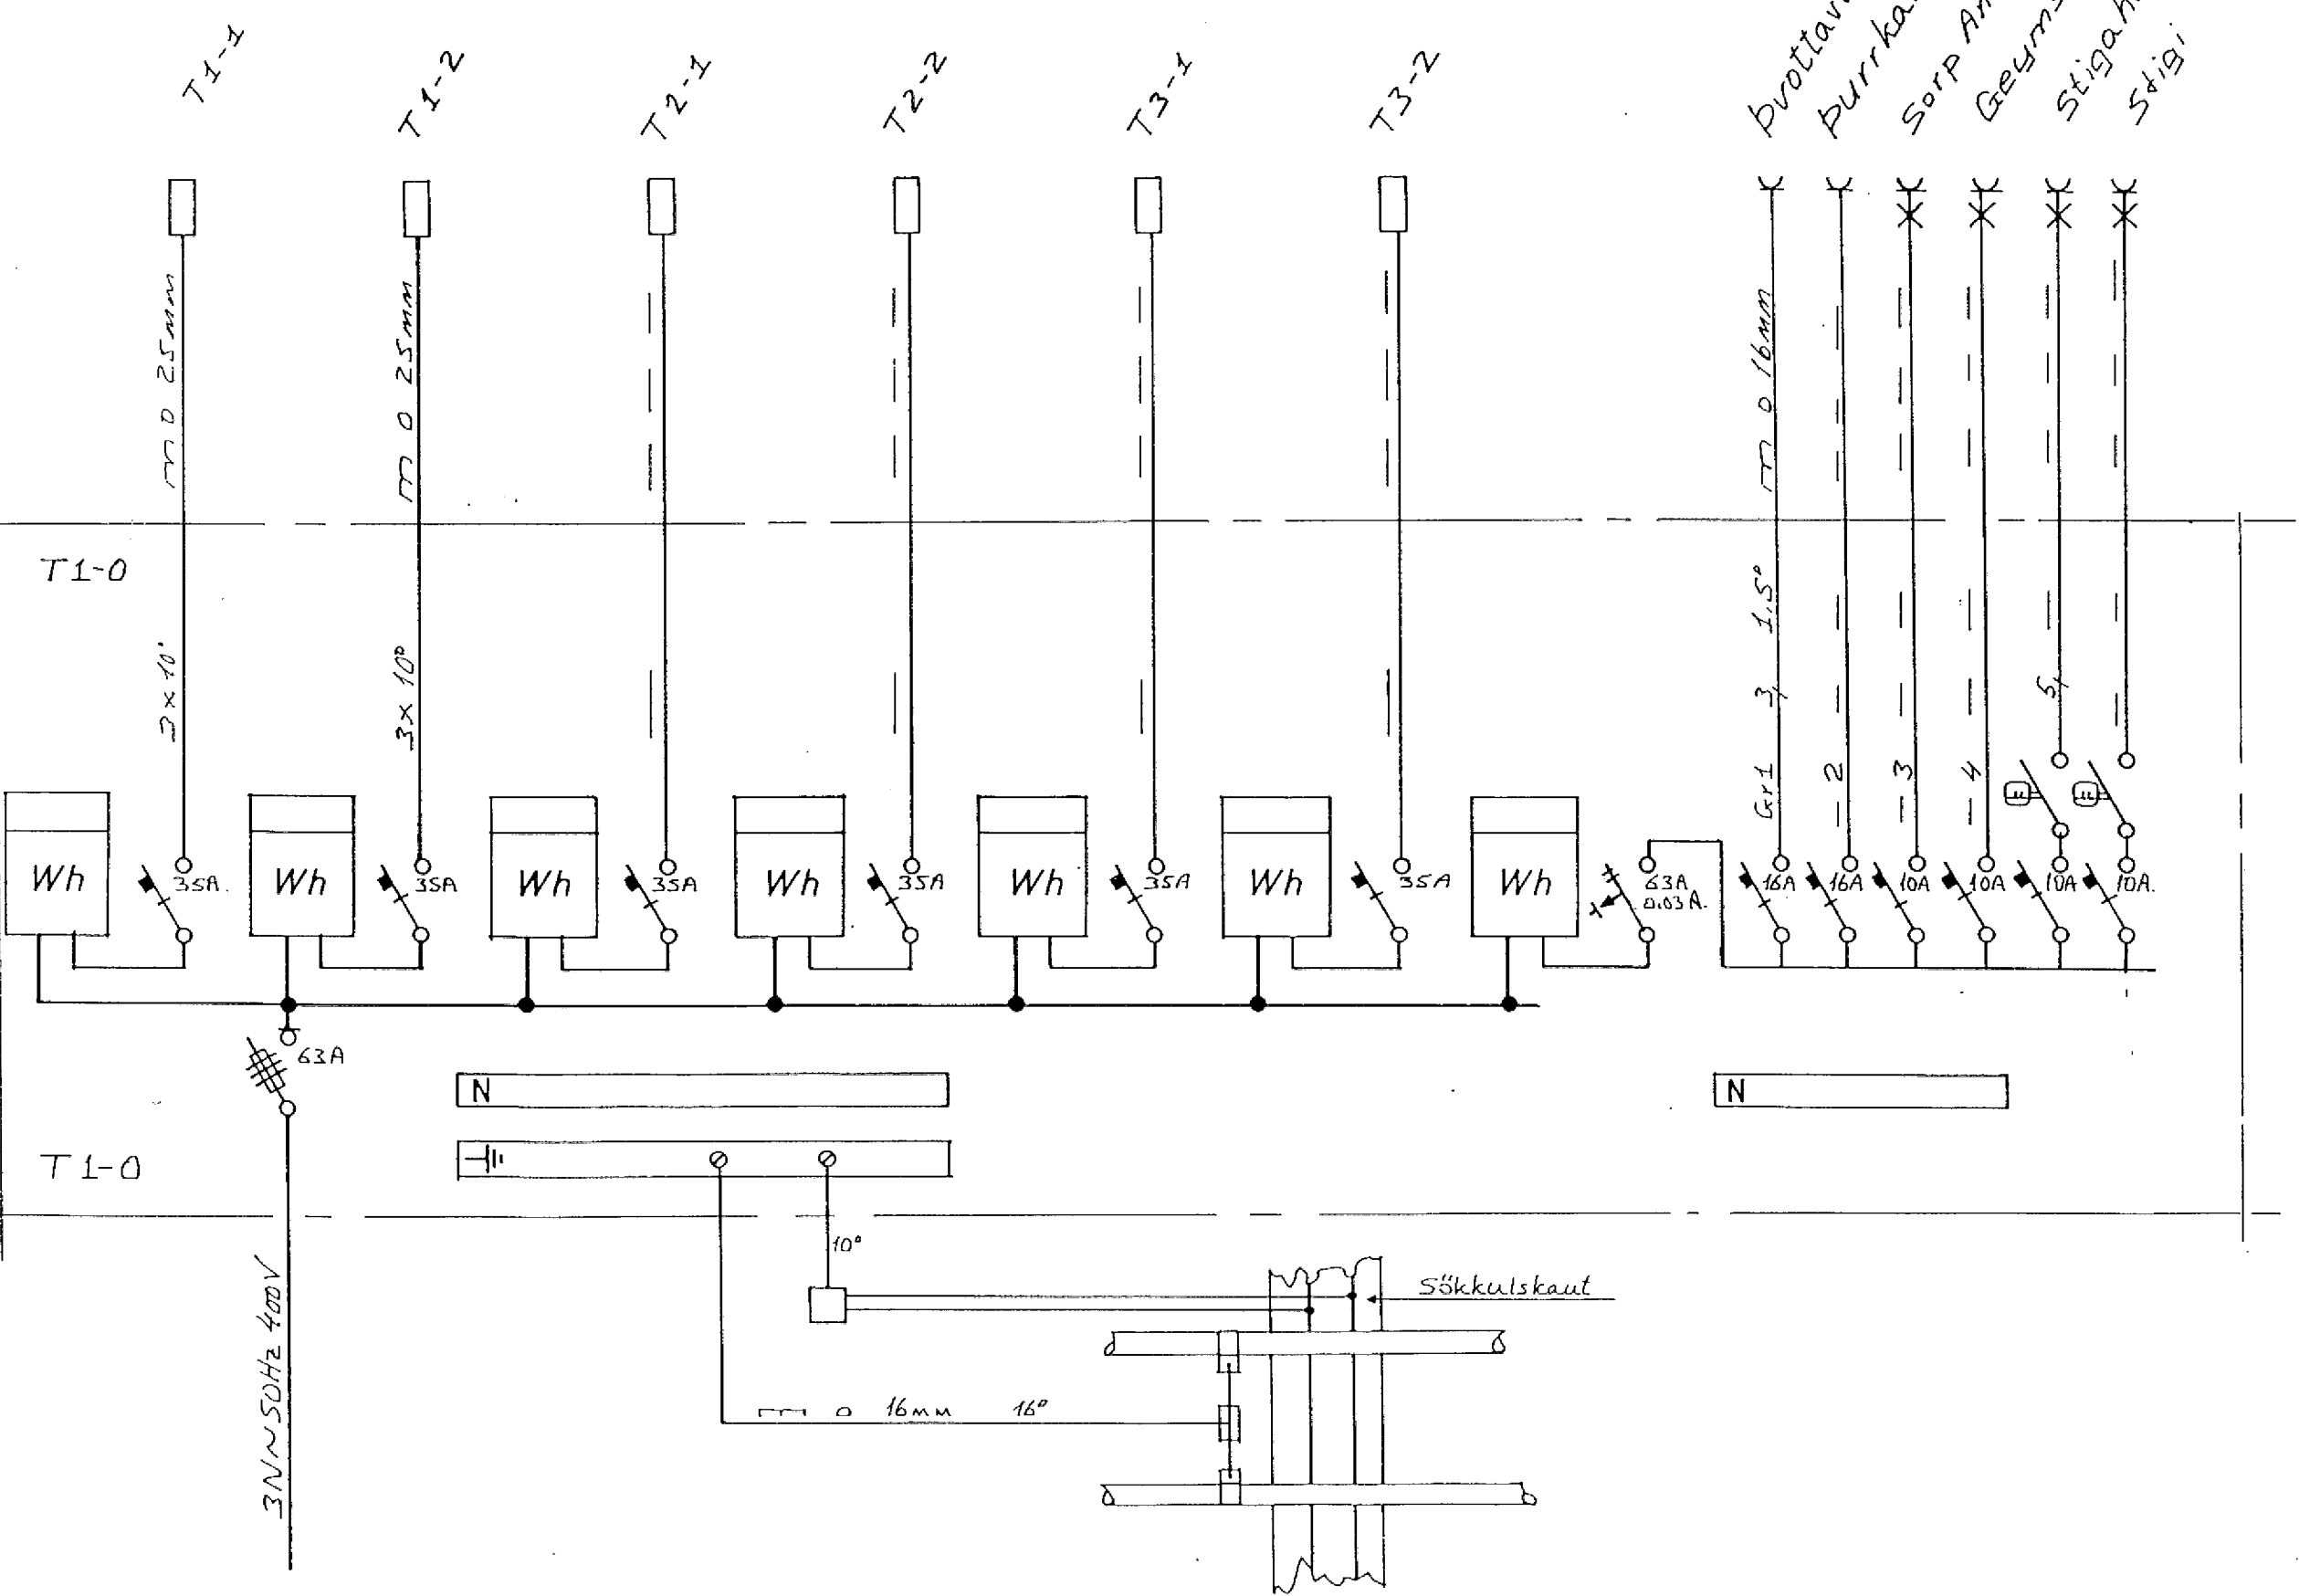

**THOMAS KAABER RAFIDNFRÆÐINGUR**  
 Teknistofa Skólavordustig 3 Sími 21266

BIRKIHLÍÐ 4B  
 SNIÐ  
 EINLÍNUMYND

Verk 683 bl. 2 of 5 m 1:100 d JAN. '93 T.K.

Þreytt samp Thomas Kaaber