



HÚSVEITUGRIND - INNTAKSGRIND

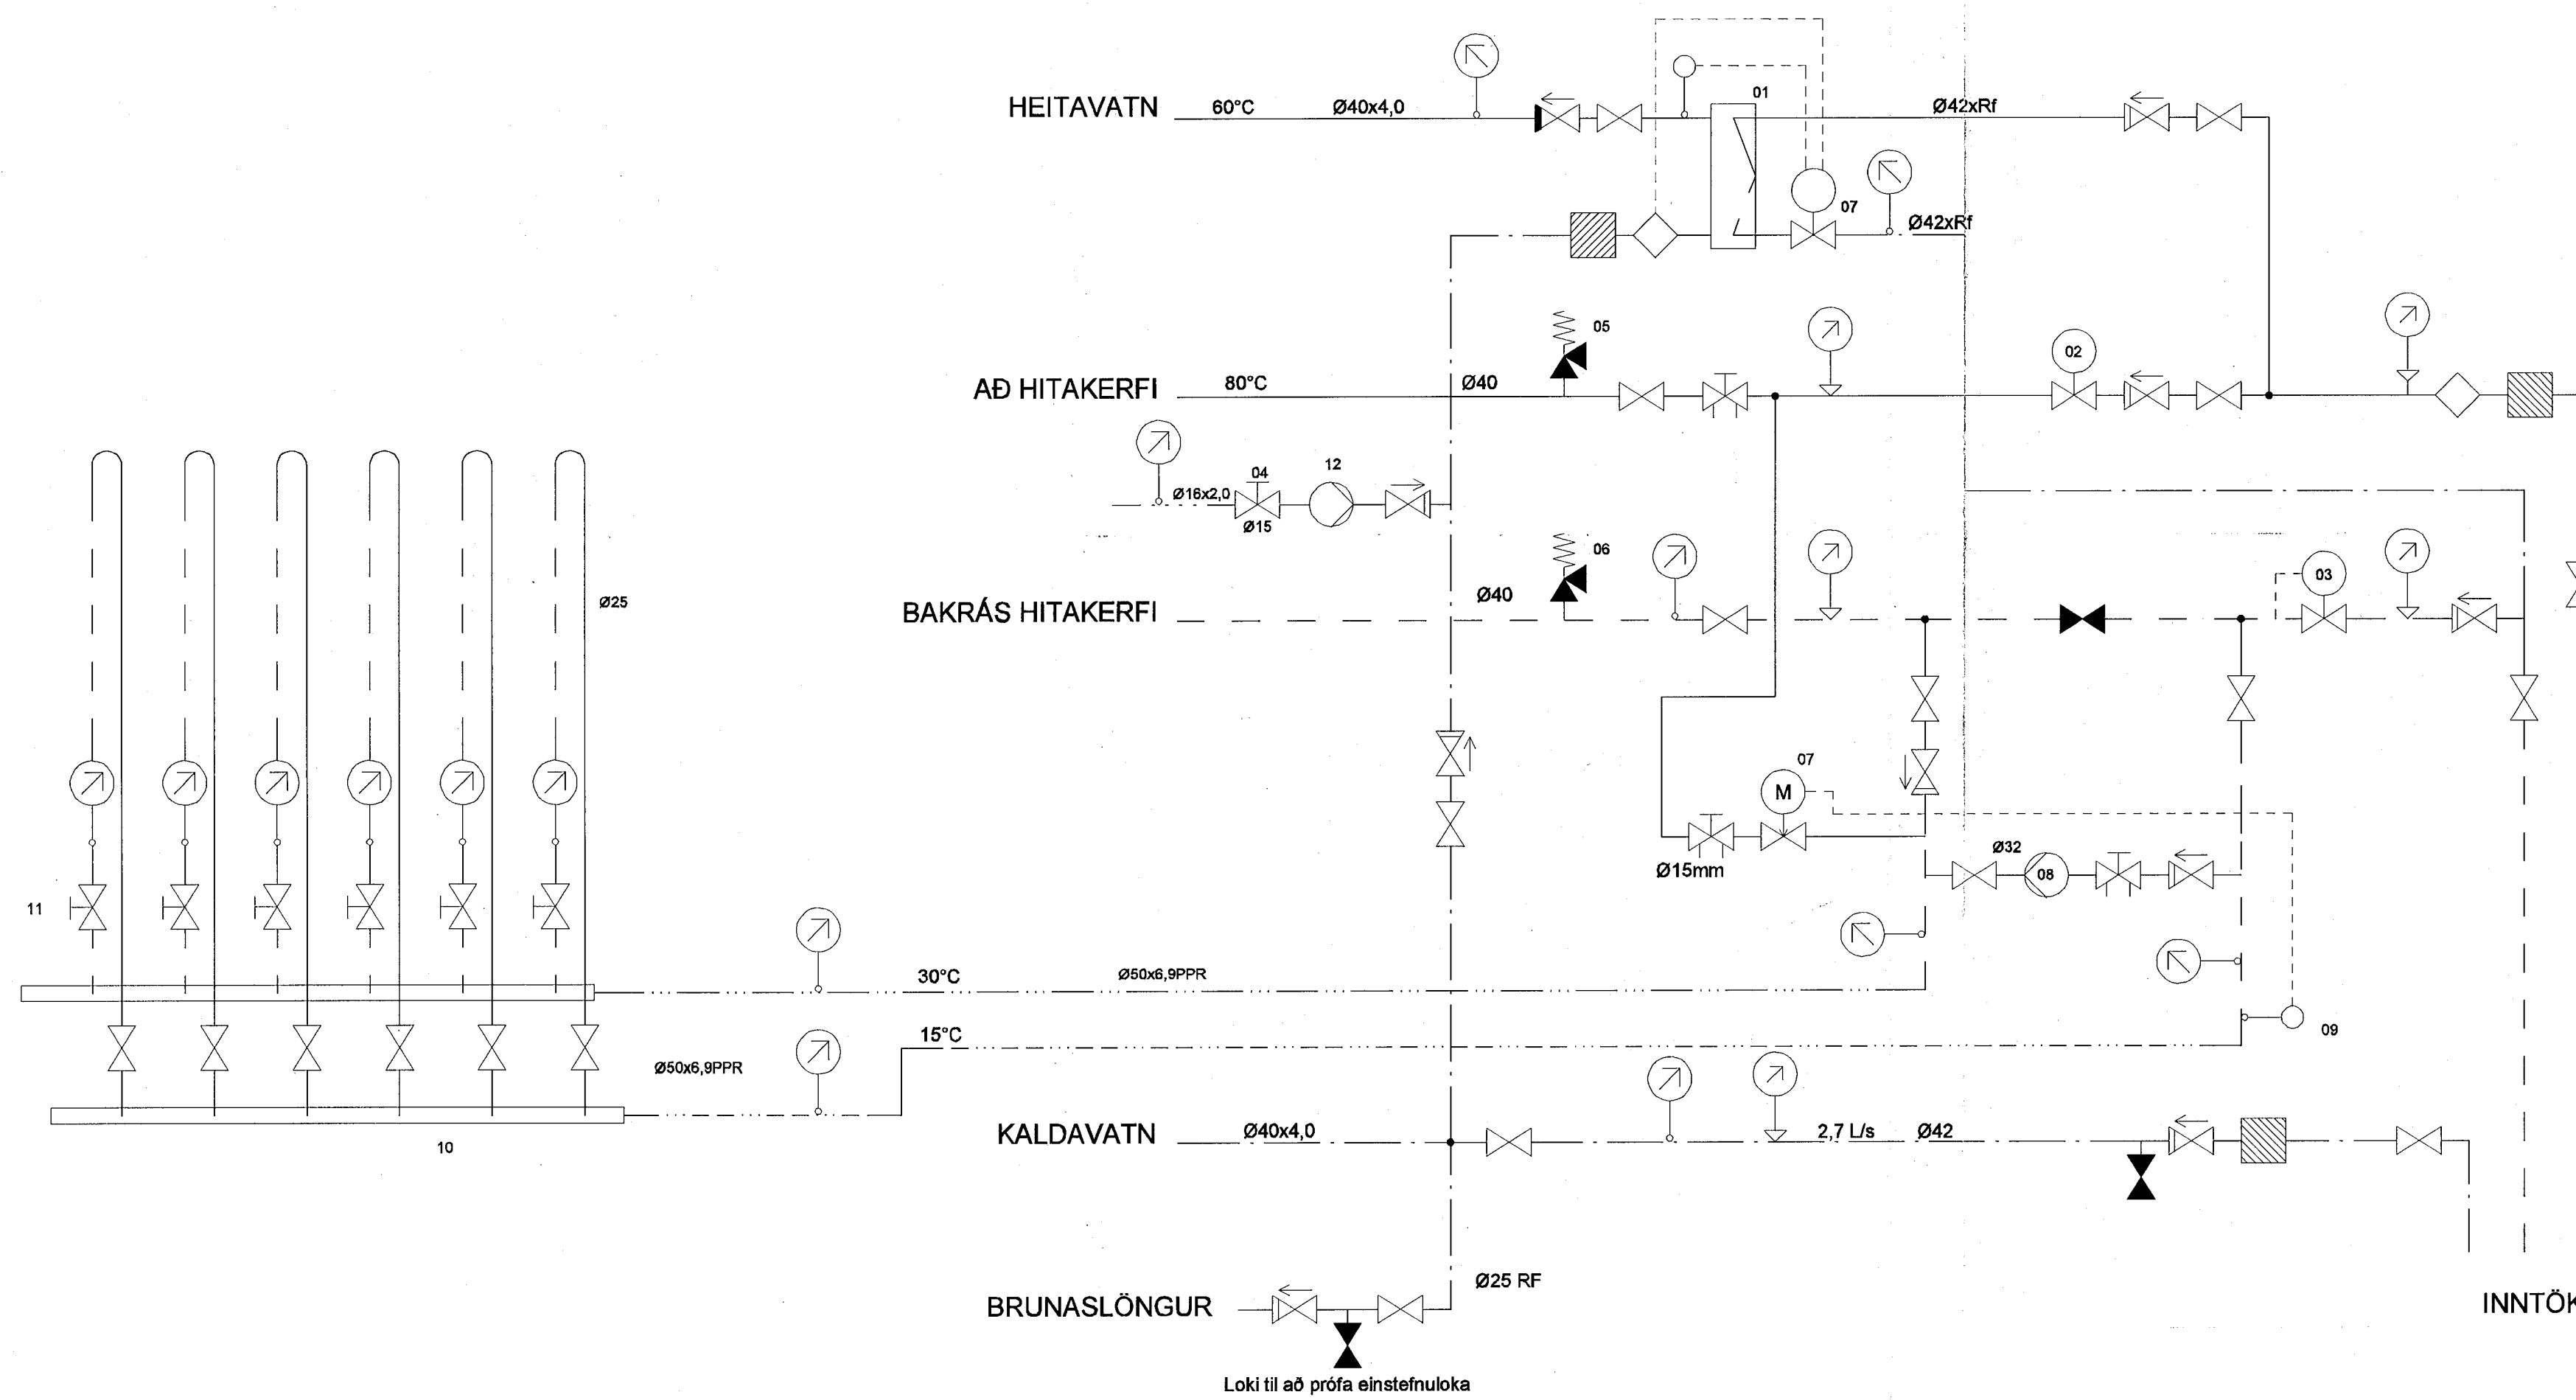

TÆKJALISTI

- 01 VARMASKIPTIR 70/85°C/80/40°, 20KPA 320KW
- 02 ÞRÝSTIMINKARI - 0-1BAR, KV = 4
- 03 SLAUFULOKI - KV = 4
- 04 STILLILOKI Ø15
- 05 ÖRYGGISLOKI Ø20 8 BAR
- 06 ÖRYGGISLOKI Ø20 8 BAR
- 07 HITASTYRDUR LOKI - Kv = 0,83
- 08 HRINGRÁGARD/ELA - 0.5 L/s, 4mVs VALIN Á MÖSTILLINGU
- 09 HITASKYNJARI
- 10 SNJÓBRÆÐSLUKISTA Ø50x6.9PPR
- 11 STILLITÉ Ø20
- 12 HRINGRÁGARD/ELA 0.1L/s, 20KPA

SKIPALÓN 23

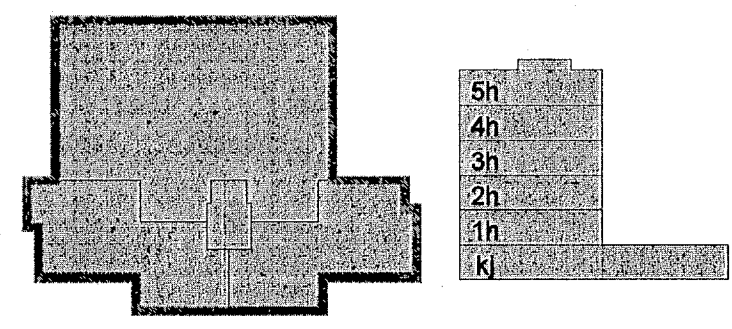

A 20.01.14 Ýmsar breytingar SÁS/SÁS
Útg. Dags. Skýring Hannab/Yfirfarið



VERKFRÆÐISTOFA

B/EJARHRAUN 20 · 220 HAFNARFJÖRÐUR · KENNIT. 710796-2899
vab@vab.is · Sími 585 8600 · Fax 585 8610 · www.vab.is

Aritun sérhönnuðar
Sveinn Áki Sverrisson, Kt. 230885 6609
Verkhætti
SKIPALÓN 23
HAFNARFIRÐI

Hannað	Teknað	Yfirfarið	Kvæði	Síða
BL	BL	SÁS	-	/ A1
Dags.	Verkefni	Telning	Útgáfa	
15.12.2006	06926	P001	A	

ASK
28. jan. 2014