

OFNATAFLA

At = 40 C° Ofndregl = 10mm



Ofn nr.	Ofn Tegund	Tenging	W Orkuþrff	Ath.
001	P21-750x1600	GH	2000	endarelstur
002	P23-750x1600	EF	2700	endarelstur
003	P23-750x2500	BC	4200	

HITABLÁSARAR

At = 40 C°

Bláðar nr.	Tegund	W Orkuþrff	Ath.
BL01		20000	
BL02		10000	
BL03		10000	
BL04		10000	
BL05		10000	
BL06		5400	

ATH: Viftur í hitablásurum skulu vera hitastýrðar og ö alla hitablásara komi réturloki.

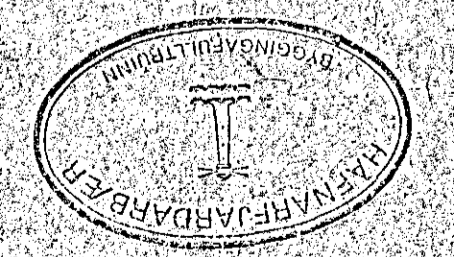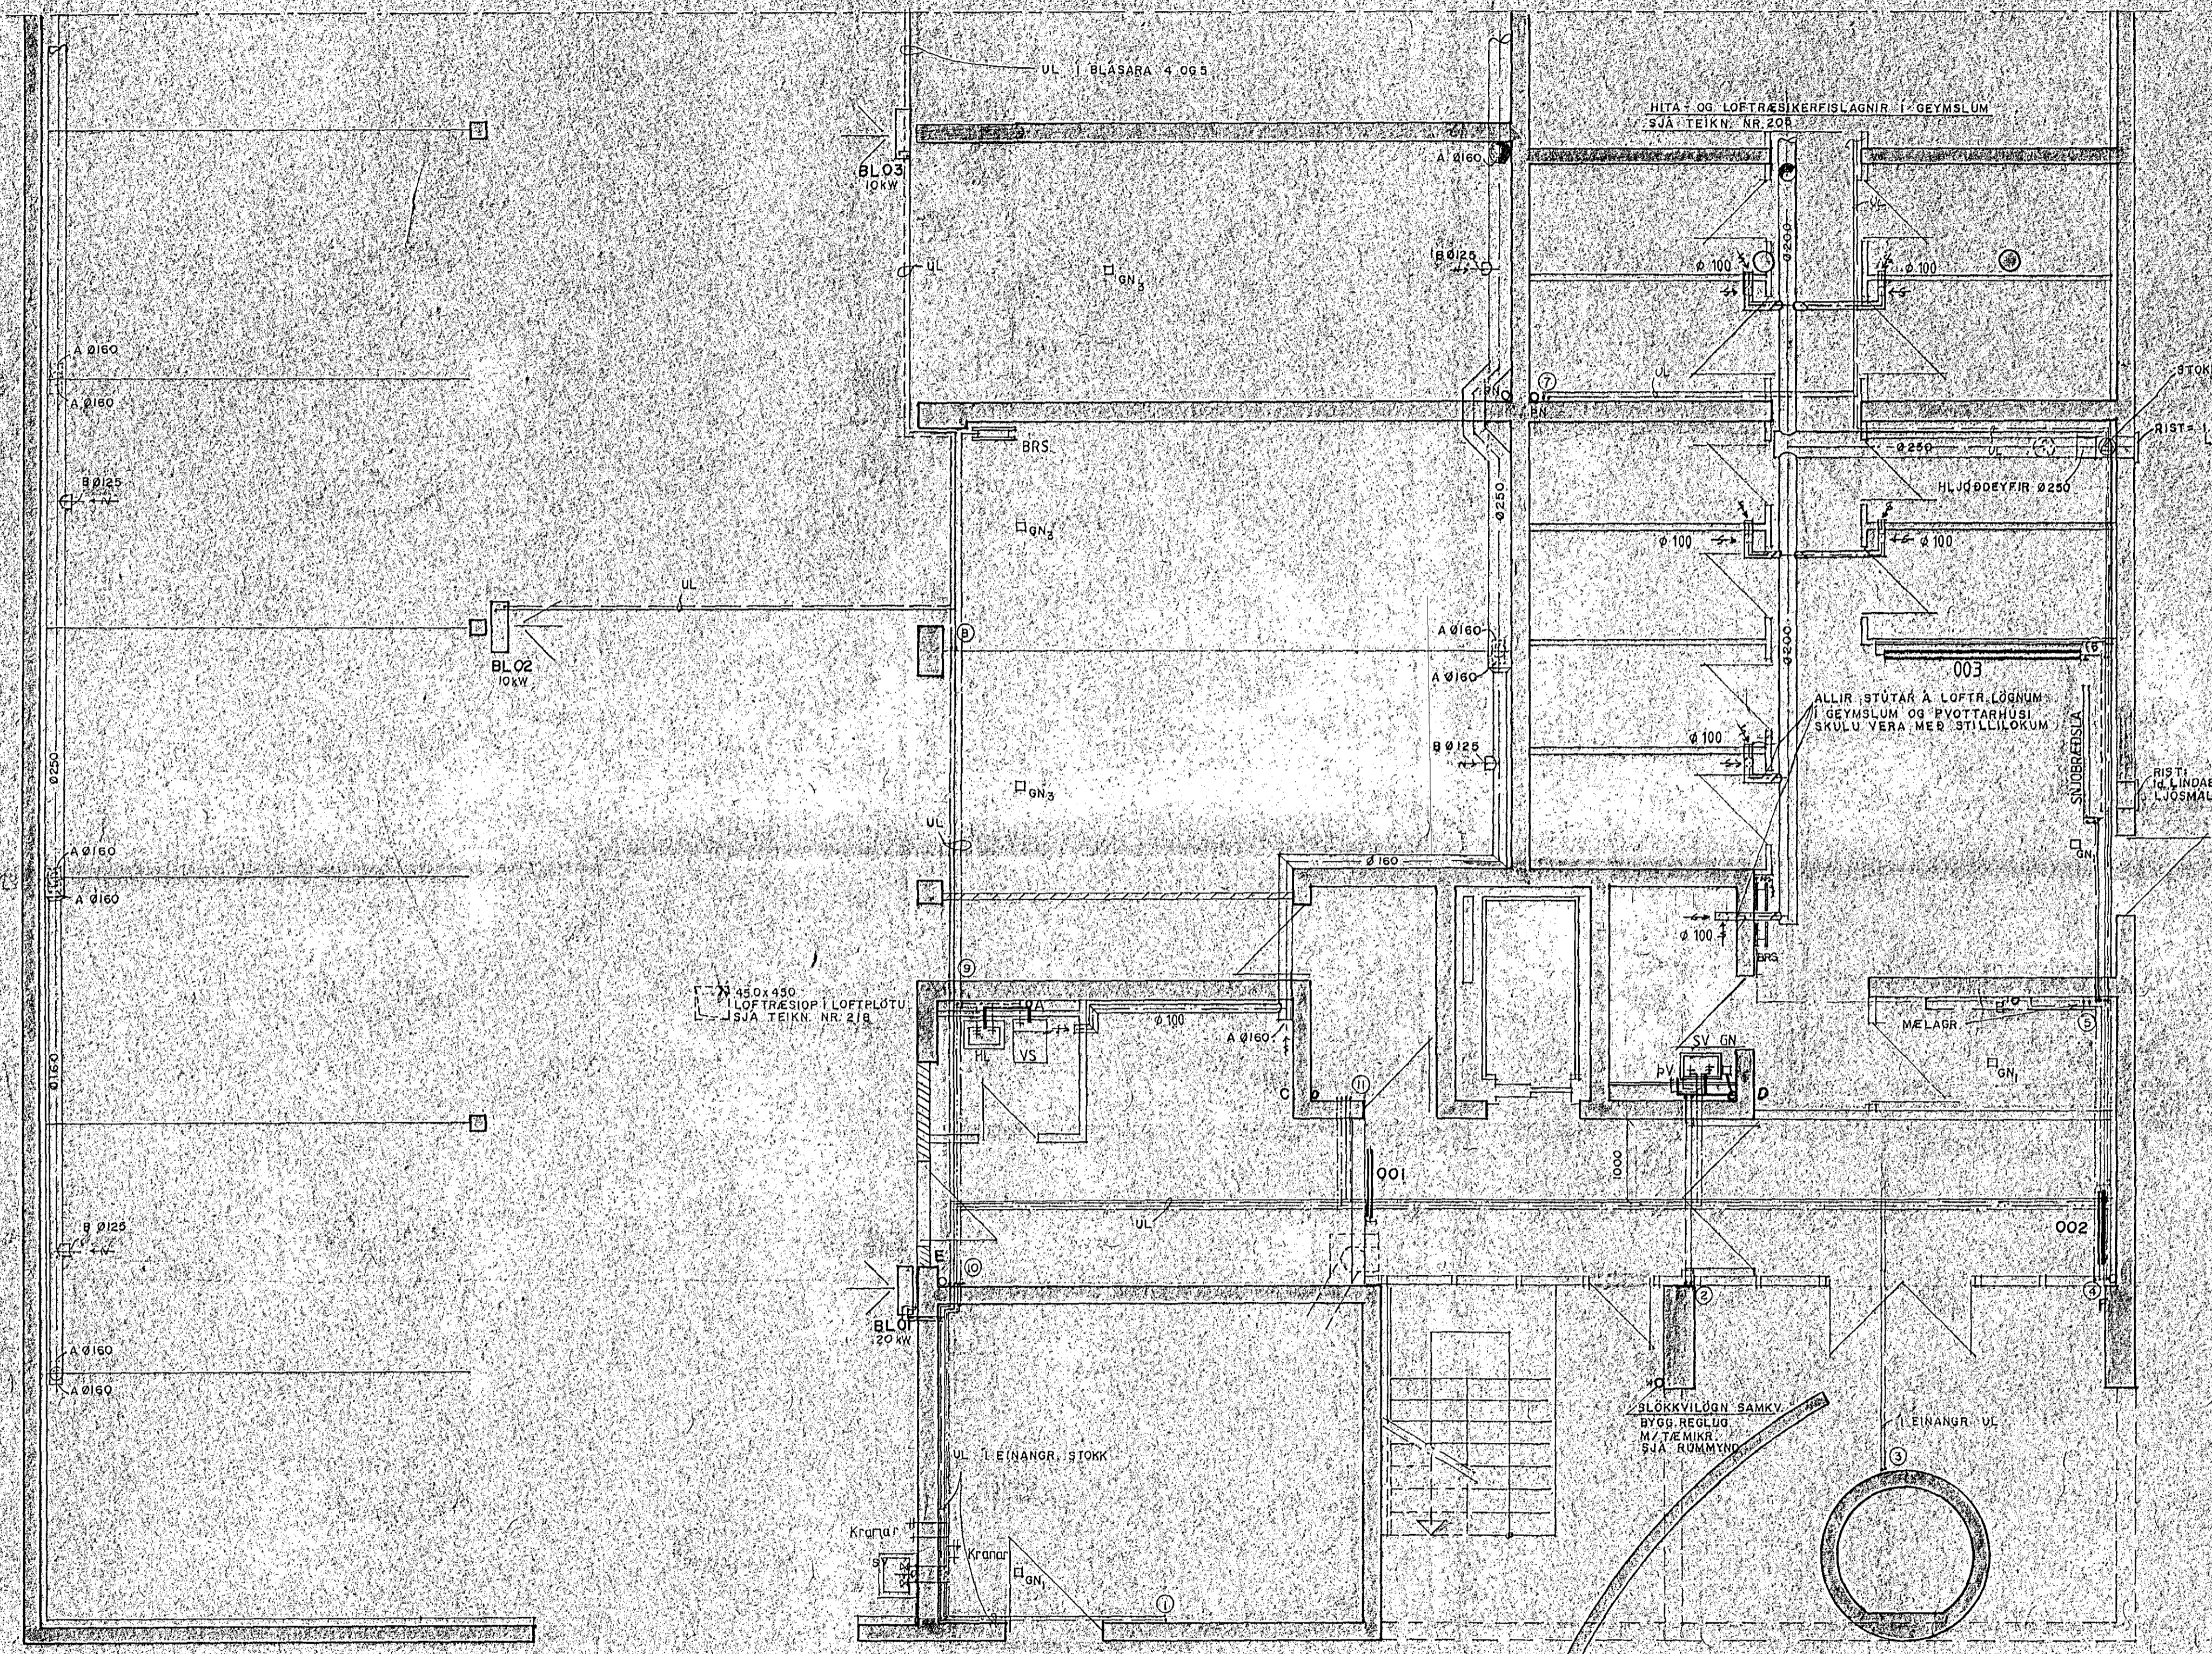

BYGGDAVERK HF.
REYKJAVIKURVEGI 60
SÍMI 54644

Breytingar				
Nr.	Dags.	Nain		
1	15/10/93	OK		
2	7/11/93	VB		
EYRARHOLT 6, HAFNARFIRÐI				
Asmundur Asmundsson verkfræðingur			HAFNARFIRÐI	
Hamraborg Kóp. sími 44473			M 1:50/20	
HITA- OG HREINLETTISLAGNIR			M. NO. 153-1993	
GRUNNMYND JARÐH. OG BÍLAG.			Dags. júlí '90	
			204	