



LÆKJARGATA

STRANDGATA

SUDURGATA

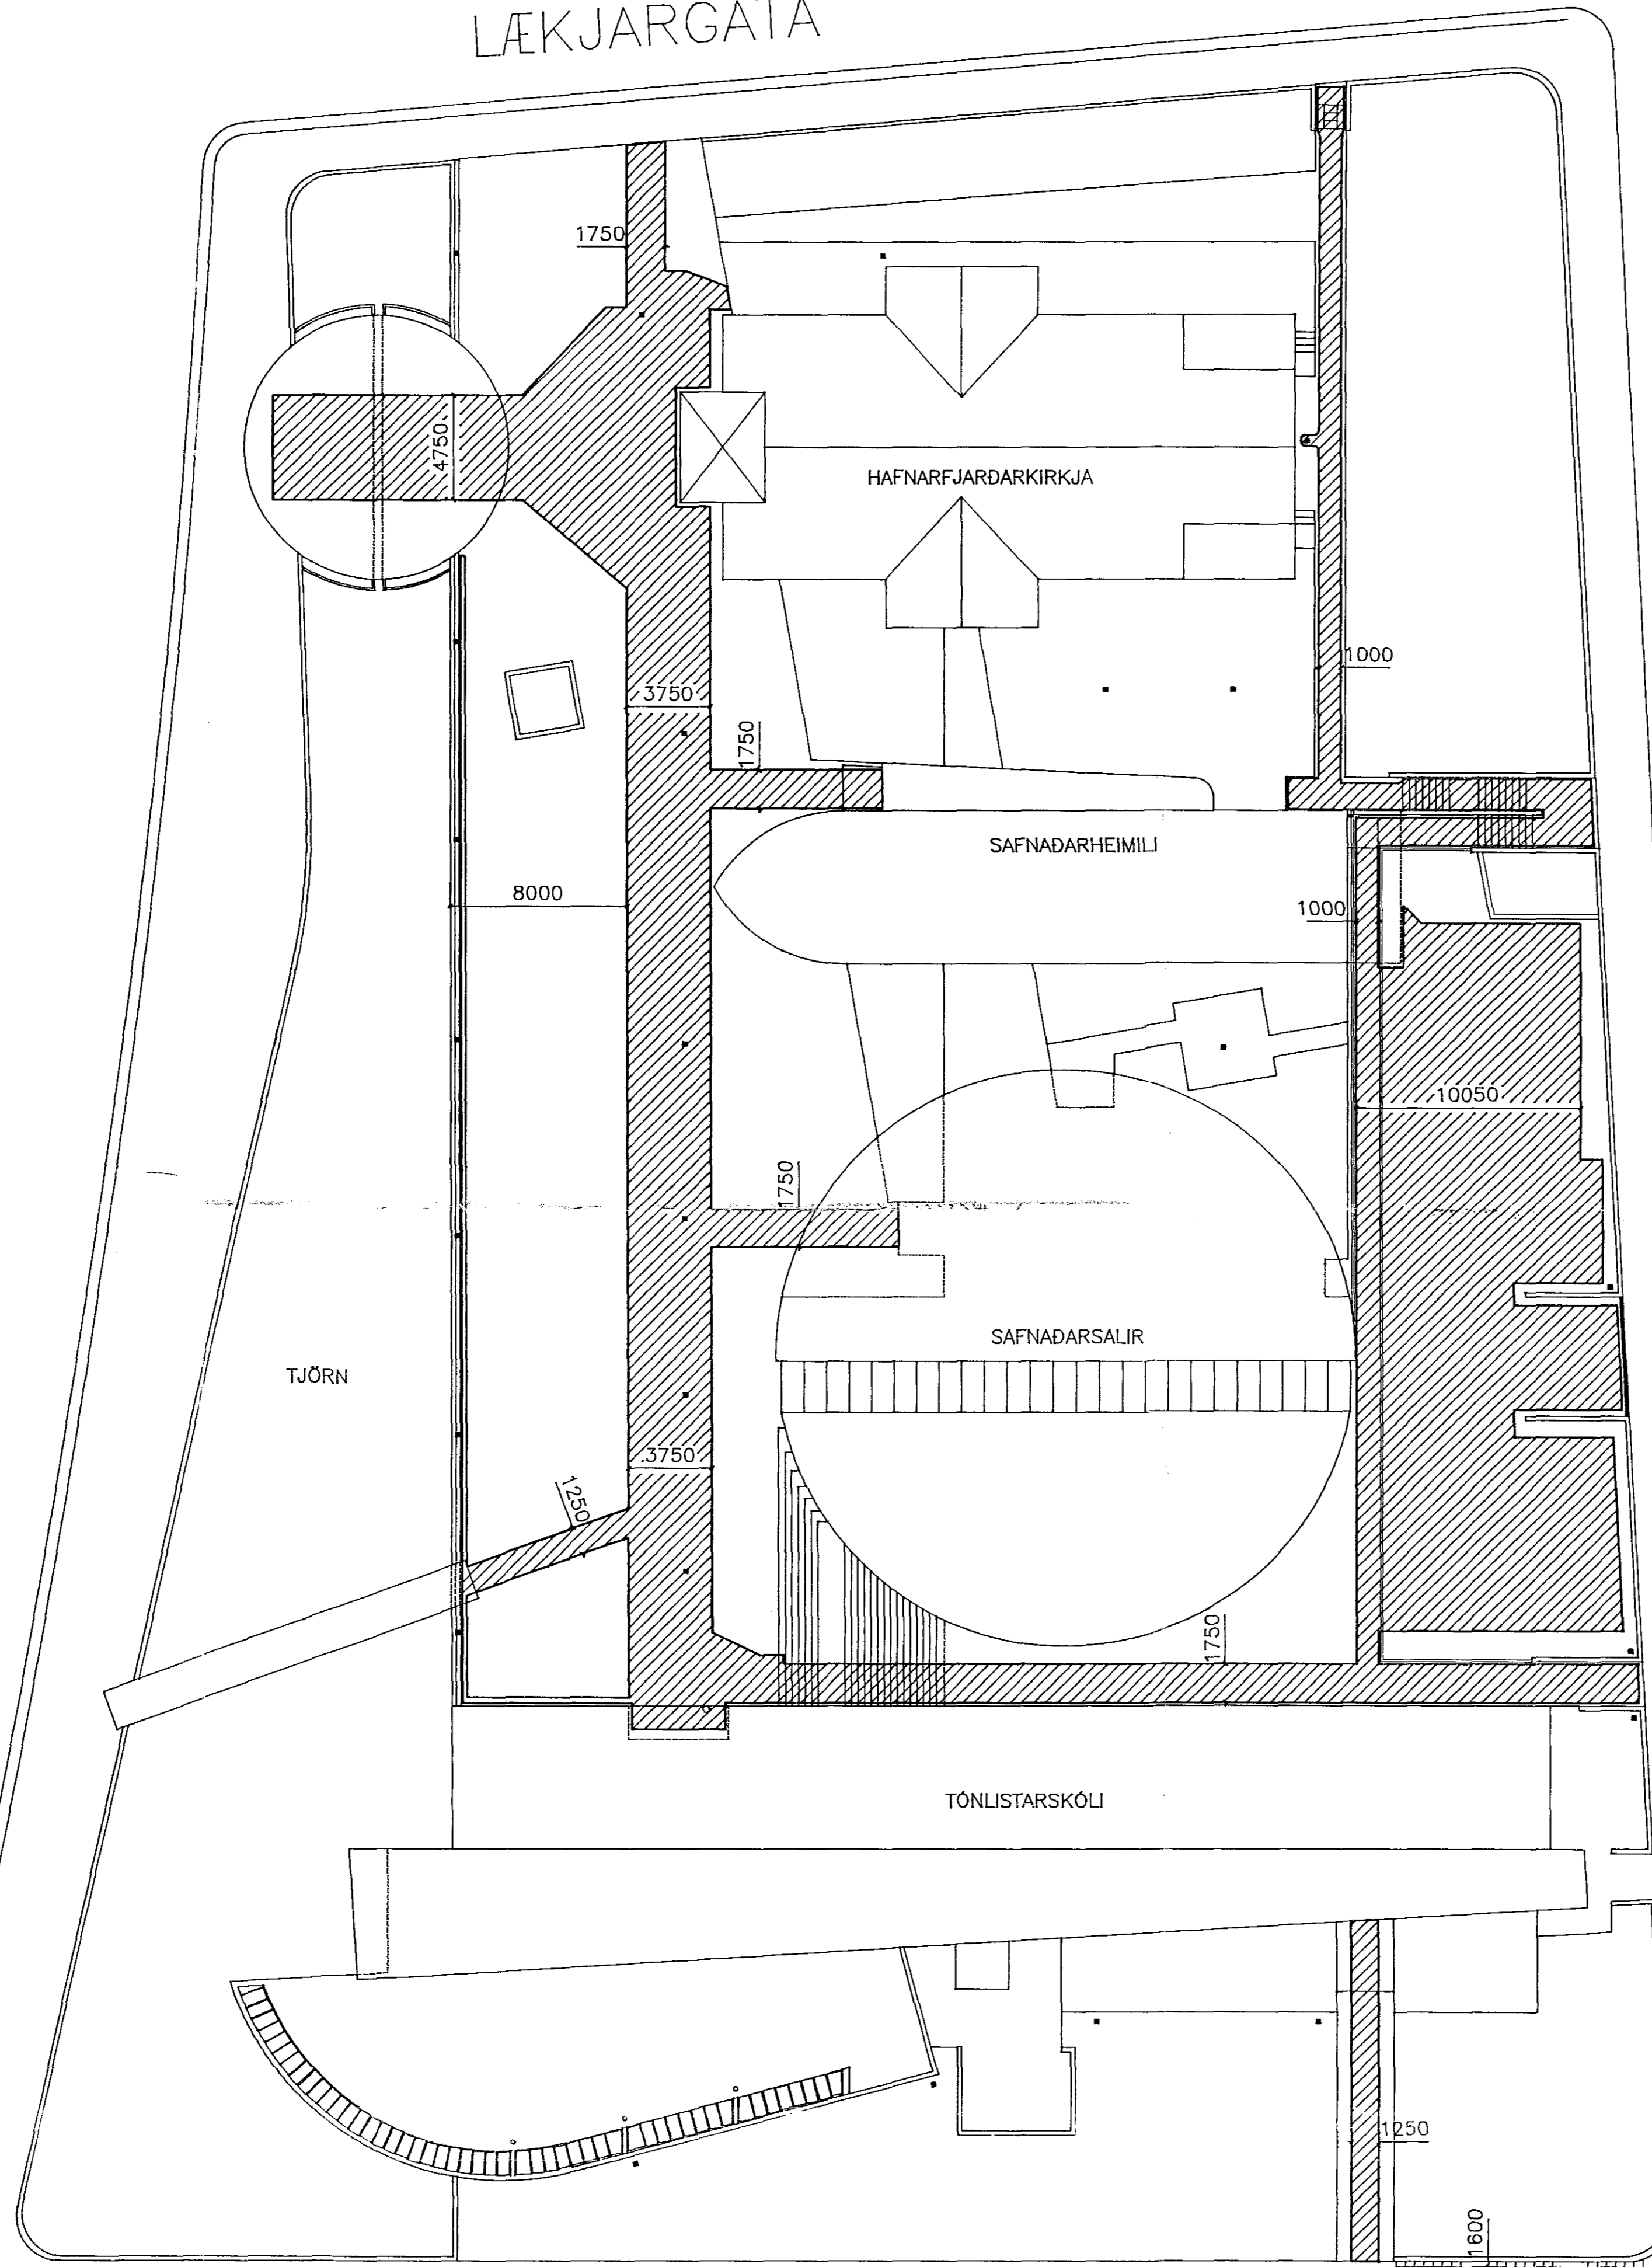

SNID SNJÓBRÆDSLULAGNA Í PLÖNUM

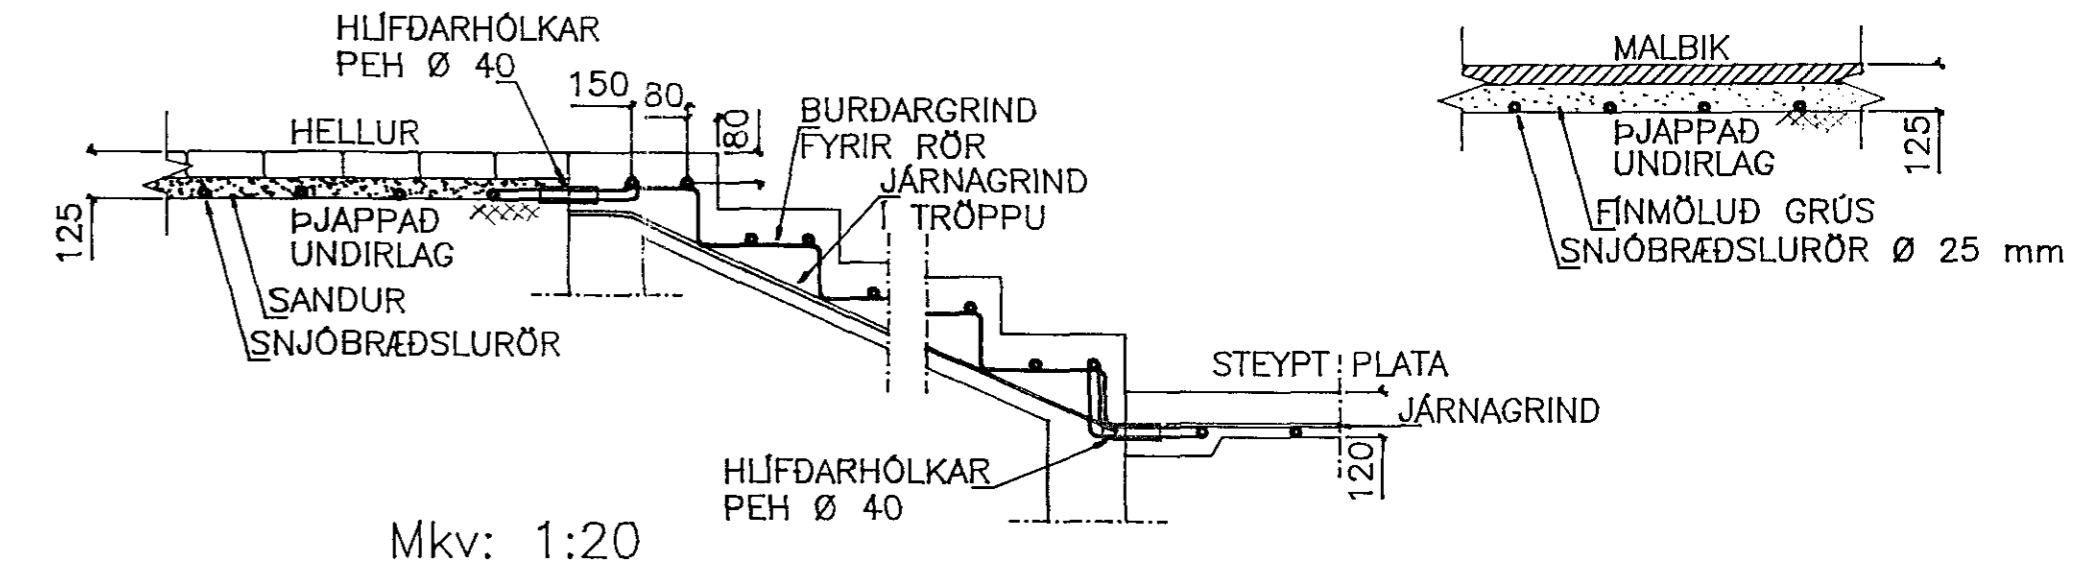

STÆRDIR

FLATARMÁL SNJÓBRÆDSLUSVÆDIS

KIRKJA	= 170 m <sup>2</sup>
SAFNADARHEIMILI OG SAFNADARSALIR	= 385 m <sup>2</sup>
TÓNLISTARSKÓLI	= 428 m <sup>2</sup>
ANNAD	= 21 m <sup>2</sup>
<b>SAMTALS:</b>	<b>= 1004 m<sup>2</sup></b>

LENGDIR Á SNJÓBRÆDSLURÖRUM

KIRKJA	= 676 m
SAFNADARHEIMILI OG SAFNADARSALIR	= 1687 m
TÓNLISTARSKÓLI	= 1743 m
ANNAD	= 101 m
<b>SAMTALS:</b>	<b>= 4.207 m</b>

ORKUÞÖRF BYGGINGA (m.v. Δt=35°C)

KIRKJA	= 21.000 W
SAFNADARHEIMILI OG SAFNADARSALIR	= 74.500 W
TÓNLISTARSKÓLI	= 91.000 W
<b>SAMTALS:</b>	<b>= 186.500 W</b>



HITASTIG OG AFKÖST SNJÓBRÆSLUKERFIS

HITASTIG SNJÓBRÆDSLUNN/ÚT.	= 40°C/20°C
BLÆÐING INN/ÚT	= 80°C/20°C
AFKÖST SNJÓBRÆDSLUSVÆÐA	= 150 W/m <sup>2</sup>
HEILDARORKUÞÖRF SNJÓBRÆSLUKERFIS	= 147.450 W
SNJÓBRÆDSLURÖR Ø 25 mm PLASTPIPUR SAMBÆRILEGT VID VARMÖR	

BLÆÐING INN Á SNJÓBRÆSLUKERFI

KIRKJA	= 3,58 l/mín
SAFNADARHEIMILI OG SAFNADARSALIR	= 4,91 l/mín
TÓNLISTARSKÓLI	= 4,85 l/mín
<b>SAMTALS:</b>	<b>= 13,34 l/mín</b>

23 OCT 1992

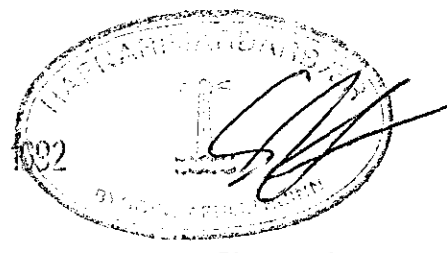

<b>SAFNADARHEIMILI OG TÓNLISTARSKÓLI VID HAFNARFJARDARKIRKJU</b>		VERK NR: 099HA001
SNJÓBRÆDSLUKERFI		KVÆÐI 1:200, 1:20
YFIRLITSMYND		REIKN: FSK/HBG
<b>LAGNÁTKNI HF.</b>		TEIKN: HBG
LAUGAVEGI 16B 105 REYKJAVÍK Sími: 91-621750		DAGS: 06-1992
NR:	DAGS	BREYTING
AF:	SAMP: <i>Judith S. Jónsdóttir</i>	
		BLAD NR: <b>H.01</b>