Format A1 (841x594 mm) is 20 mm outside of this frame

TRANSFORMER BAYS, PLAN VIEW, 1:50

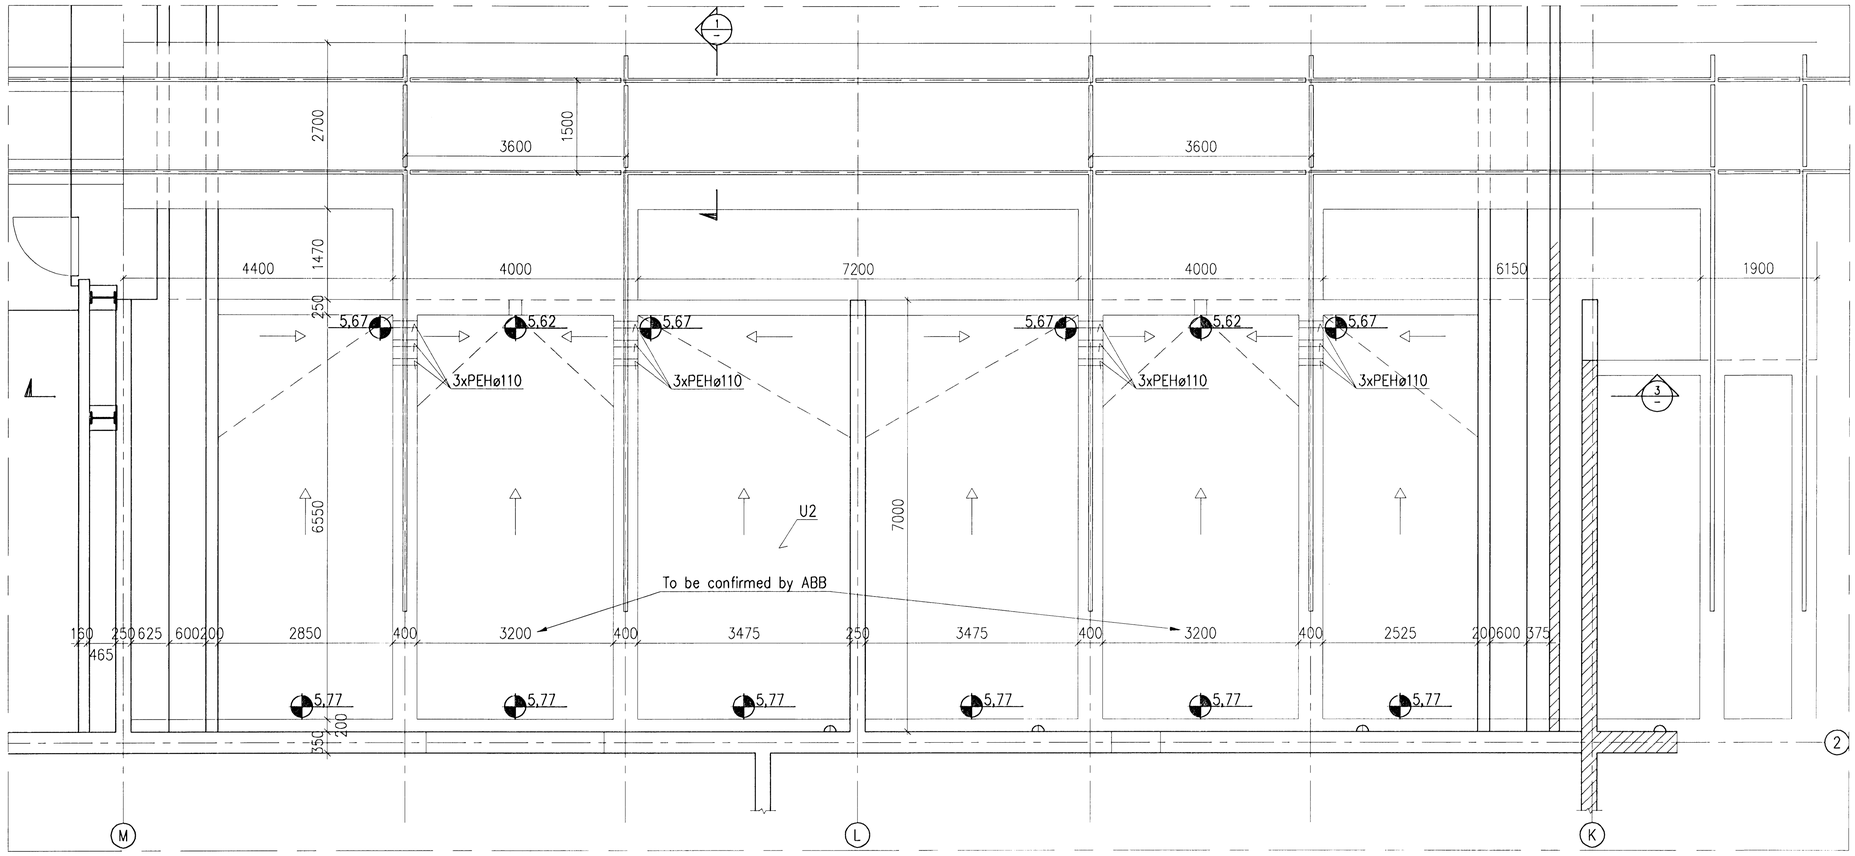

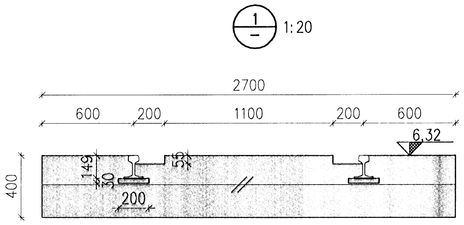

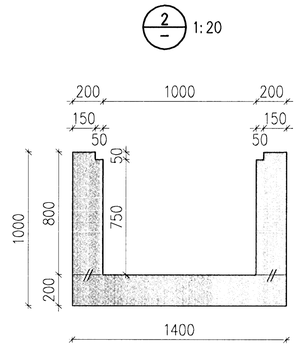

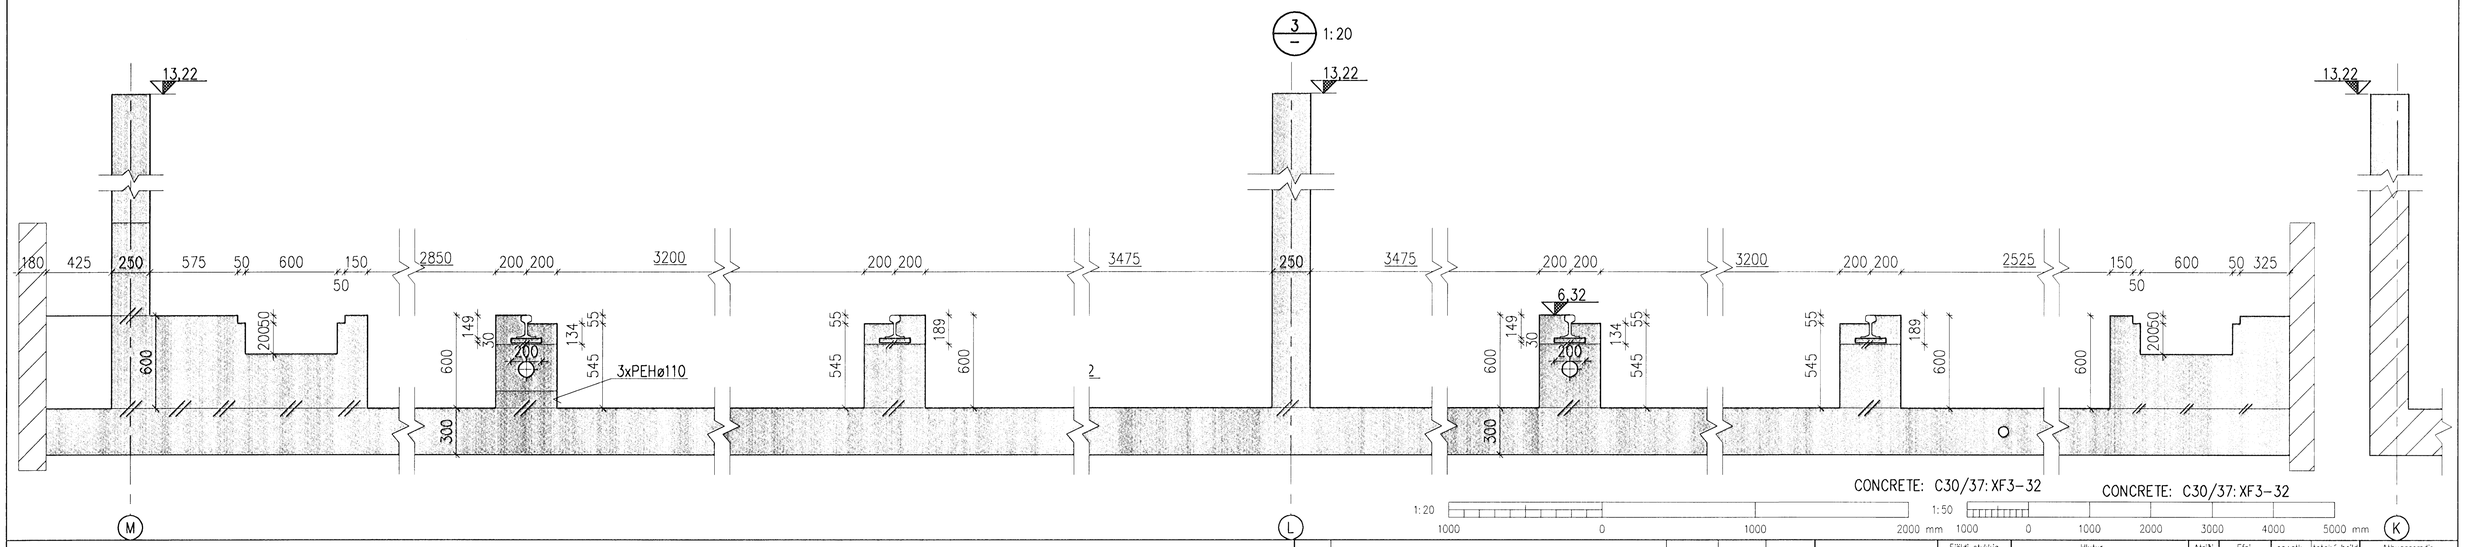

Skýringar:
Explanations:

HRV ENGINEERING

Breyt. Rev.	Breyting Revision	Dags. Date	Samb. Approved	Notk. heimil Released
1	Issued for use	08.12.18		

Tilv.teikningar nr. ÍSAL / Ref.drawing no. of ÍSAL

Samsetn.teikningar nr. ÍSAL / Assembly drawing no. of ÍSAL

This drawing is the property of the Rio Tinto Alcan Iceland Ltd. and handed out for personal use only. It may neither be copied nor made available to others without permission of the Rio Tinto Alcan Iceland Ltd. The receiver is liable for any misuse.

Fjöldi stykkja / Number of pieces: IV III II I

Hlutur Object	Atriði Item	Efni Material	ea.: stk. Weight	Totals: í heild (eg) byggi	Athugasemdir Remarks

IDP 410 – SUBSTATION
220 kV SWITCHYARD BLD.
CONCRETE WORK
TRANSEFORMER BAYS

Verktaki / Supplier: HRV

Teiknað / Drawn: LDB 2008.12.01 — Yfirfarið / Checked: NI

Samþykkt / Approved: Niels Indriðason NI kt. 181144-3749

ÍSAL Straumur hf. Alcan Iceland Ltd IS-222 Hafnarfjordur

Teiknað / Drawn — Yfirfarið og stríkað / Checked and filed — Notkun heimiluð / Released

Stærð / Format	Mkv. / Scale	Kostn.nr.-Bún.nr. / CCNo.-Eq.no.	AKS no.
A1	1:20, 1:50	4011	

Teikn.nr. verktaka / Drw.no. of suppl	Breyt./Rev.
IDP-410-CA-000-080	1

Drw.no. of ÍSAL / Teikn.nr. ÍSAL	Breyt./Rev.
250180	1

Samþykkt 10 FEB 2009
Byggingafulltrúinn í Hafnarfirði
F.h. Hrólfur S. Gunnlaugsson
Niels Indriðason NI kt. 181144-3749

C:\IDP\01 IDP\400 – Reduction\410 Substation\Drawings\Civil\IDP-410-CA-000-080.dwg