

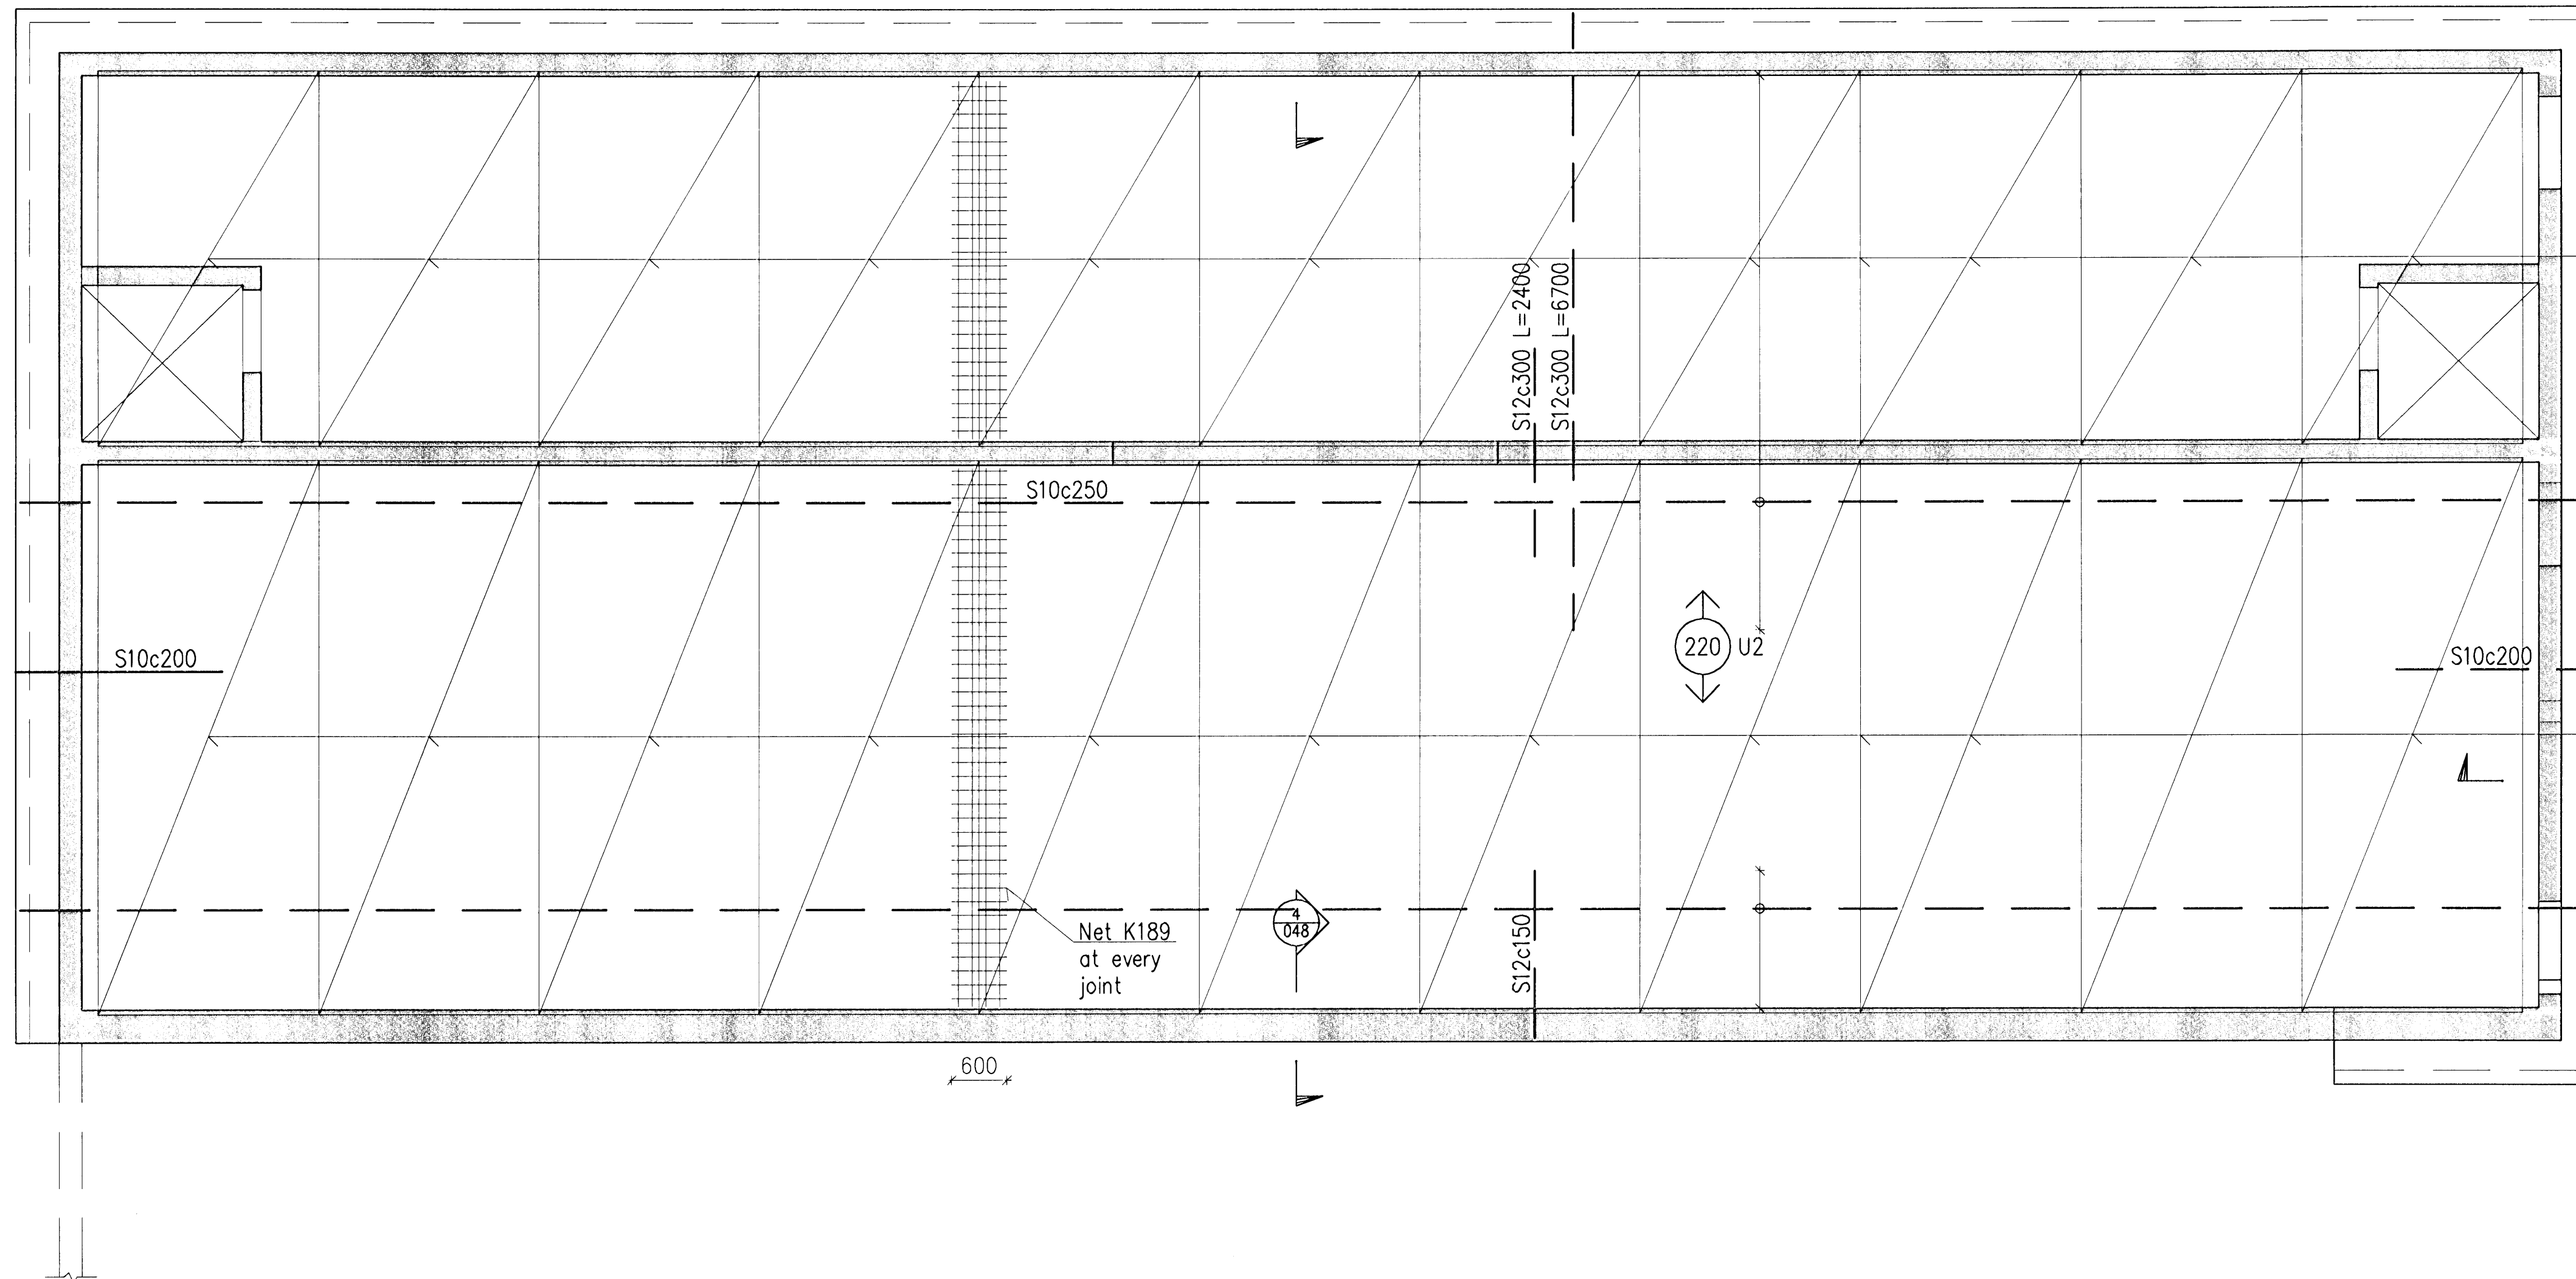


ROOF SLAB




Filigran - Load:
 Selfweight 1,5kN/m²
 Concrete 4,0kN/m²
 Gravel 2,0kN/m²
 Snow 6,0kN/m²
 Total 13,5kN/m²

Filigran - Load:
 Selfweight 1,5kN/m²
 Concrete 4,0kN/m²
 Gravel 2,0kN/m²
 Snow 6,0kN/m²
 Total 13,5kN/m²



Samþykkt bann
 10 FEB 2009
 Byggingafultrúinn / Hafnarfrófi
 F.h. Hrólfur S. Gunnlaugsson
 Níels Indriðsson
 NÍ 40.18/40-3749

FLOOR, PLAN VIEW 11.87

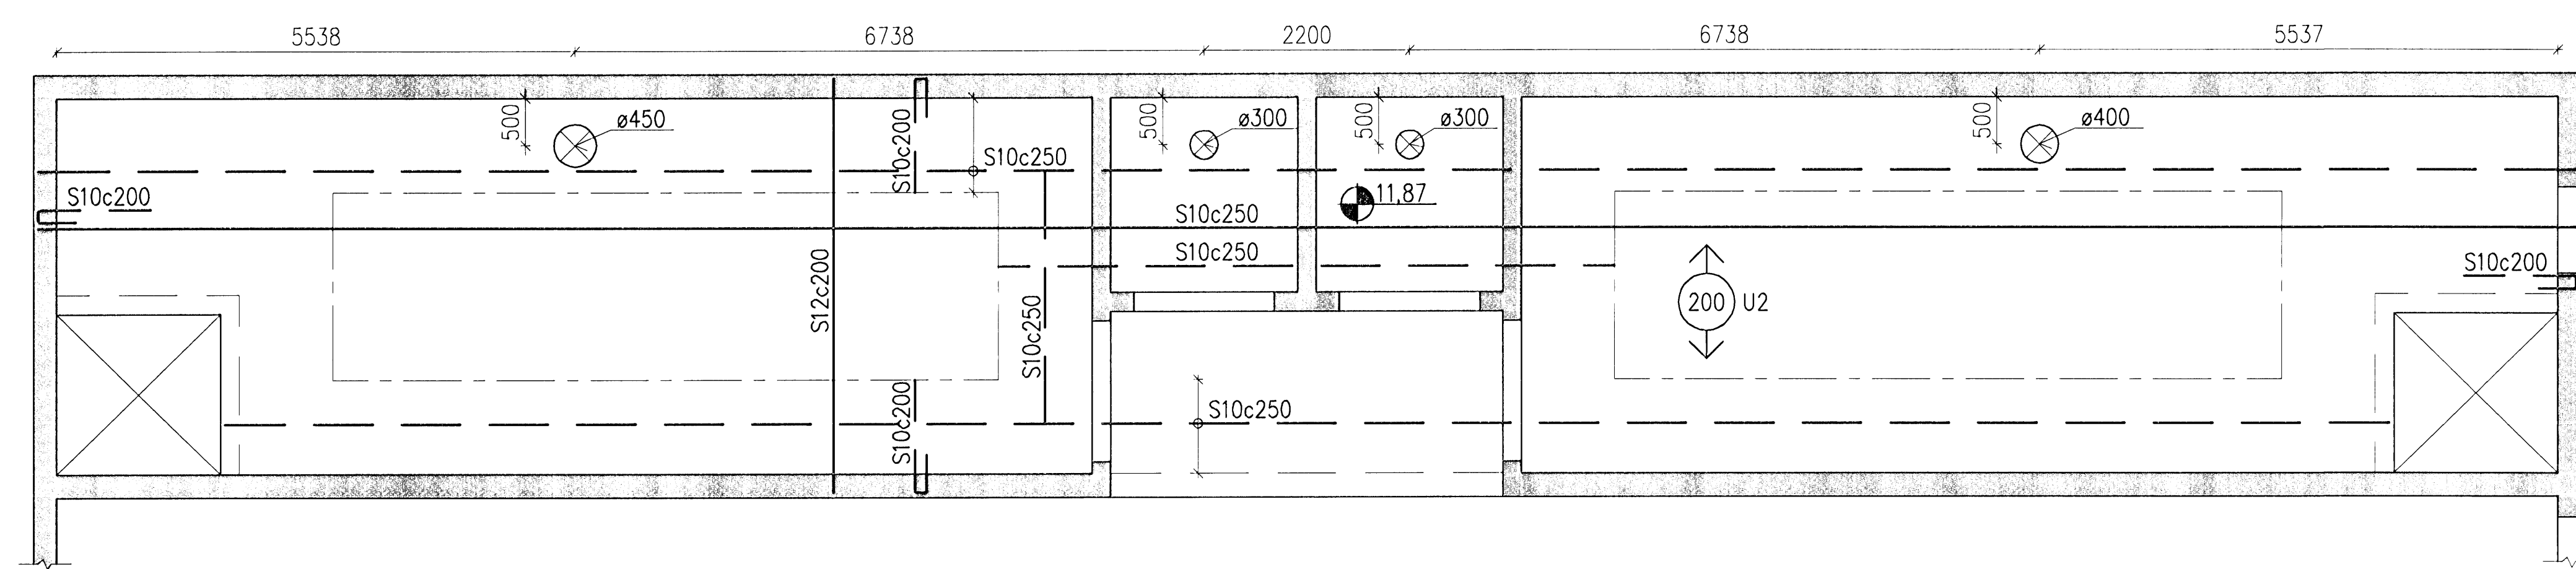

CONCRETE: C30/37:XF3-32

Skýringar:
 Explanations:

Fyllið stökja Number of pieces	Hlutur Object	Atriði Item	Efni Material	Þyngd Weight (kg)	Bygging Bygd	Althugssemdir Remarks
IV III II I	IDP 410 - SUBSTATION 60KV SWITCHGEAR BLD. REINFORCEMENT ROOF SLAB & FLOOR 11,87					
2	Issued for use	08.12.18				
1	Issued for tendering	08.10.01	ÓS			
Breyt. Rev.	Breyting Revision	Dags. Date	Samp. Approved	Nölk. Released		

This drawing is the property of the Rio Tinto Alcan Iceland Ltd and handed out for personal use only. It may neither be copied nor made available to others without permission of the Rio Tinto Alcan Iceland Ltd. The receiver is liable for any misuse.

Stærð Format	A1	Msk. Scale	1:50
Kostnaður - búnaður / Cost - Equip.	4011		
Tekni. nr. / Tech. no.	IDP-410-CA-000-047	2	
Tekni. nr. / Tech. no.	250147	2	

