


Format A1 (841x594 mm) is 20 mm outside of this frame

Sambýkt bann

10 FEB 2009

Byggingafræðingur (Hafnarfrá) Fh. Hrólfur S. Gunnlaugsson

Níel Indriðason
N1 h.t. 18/11/04-2009

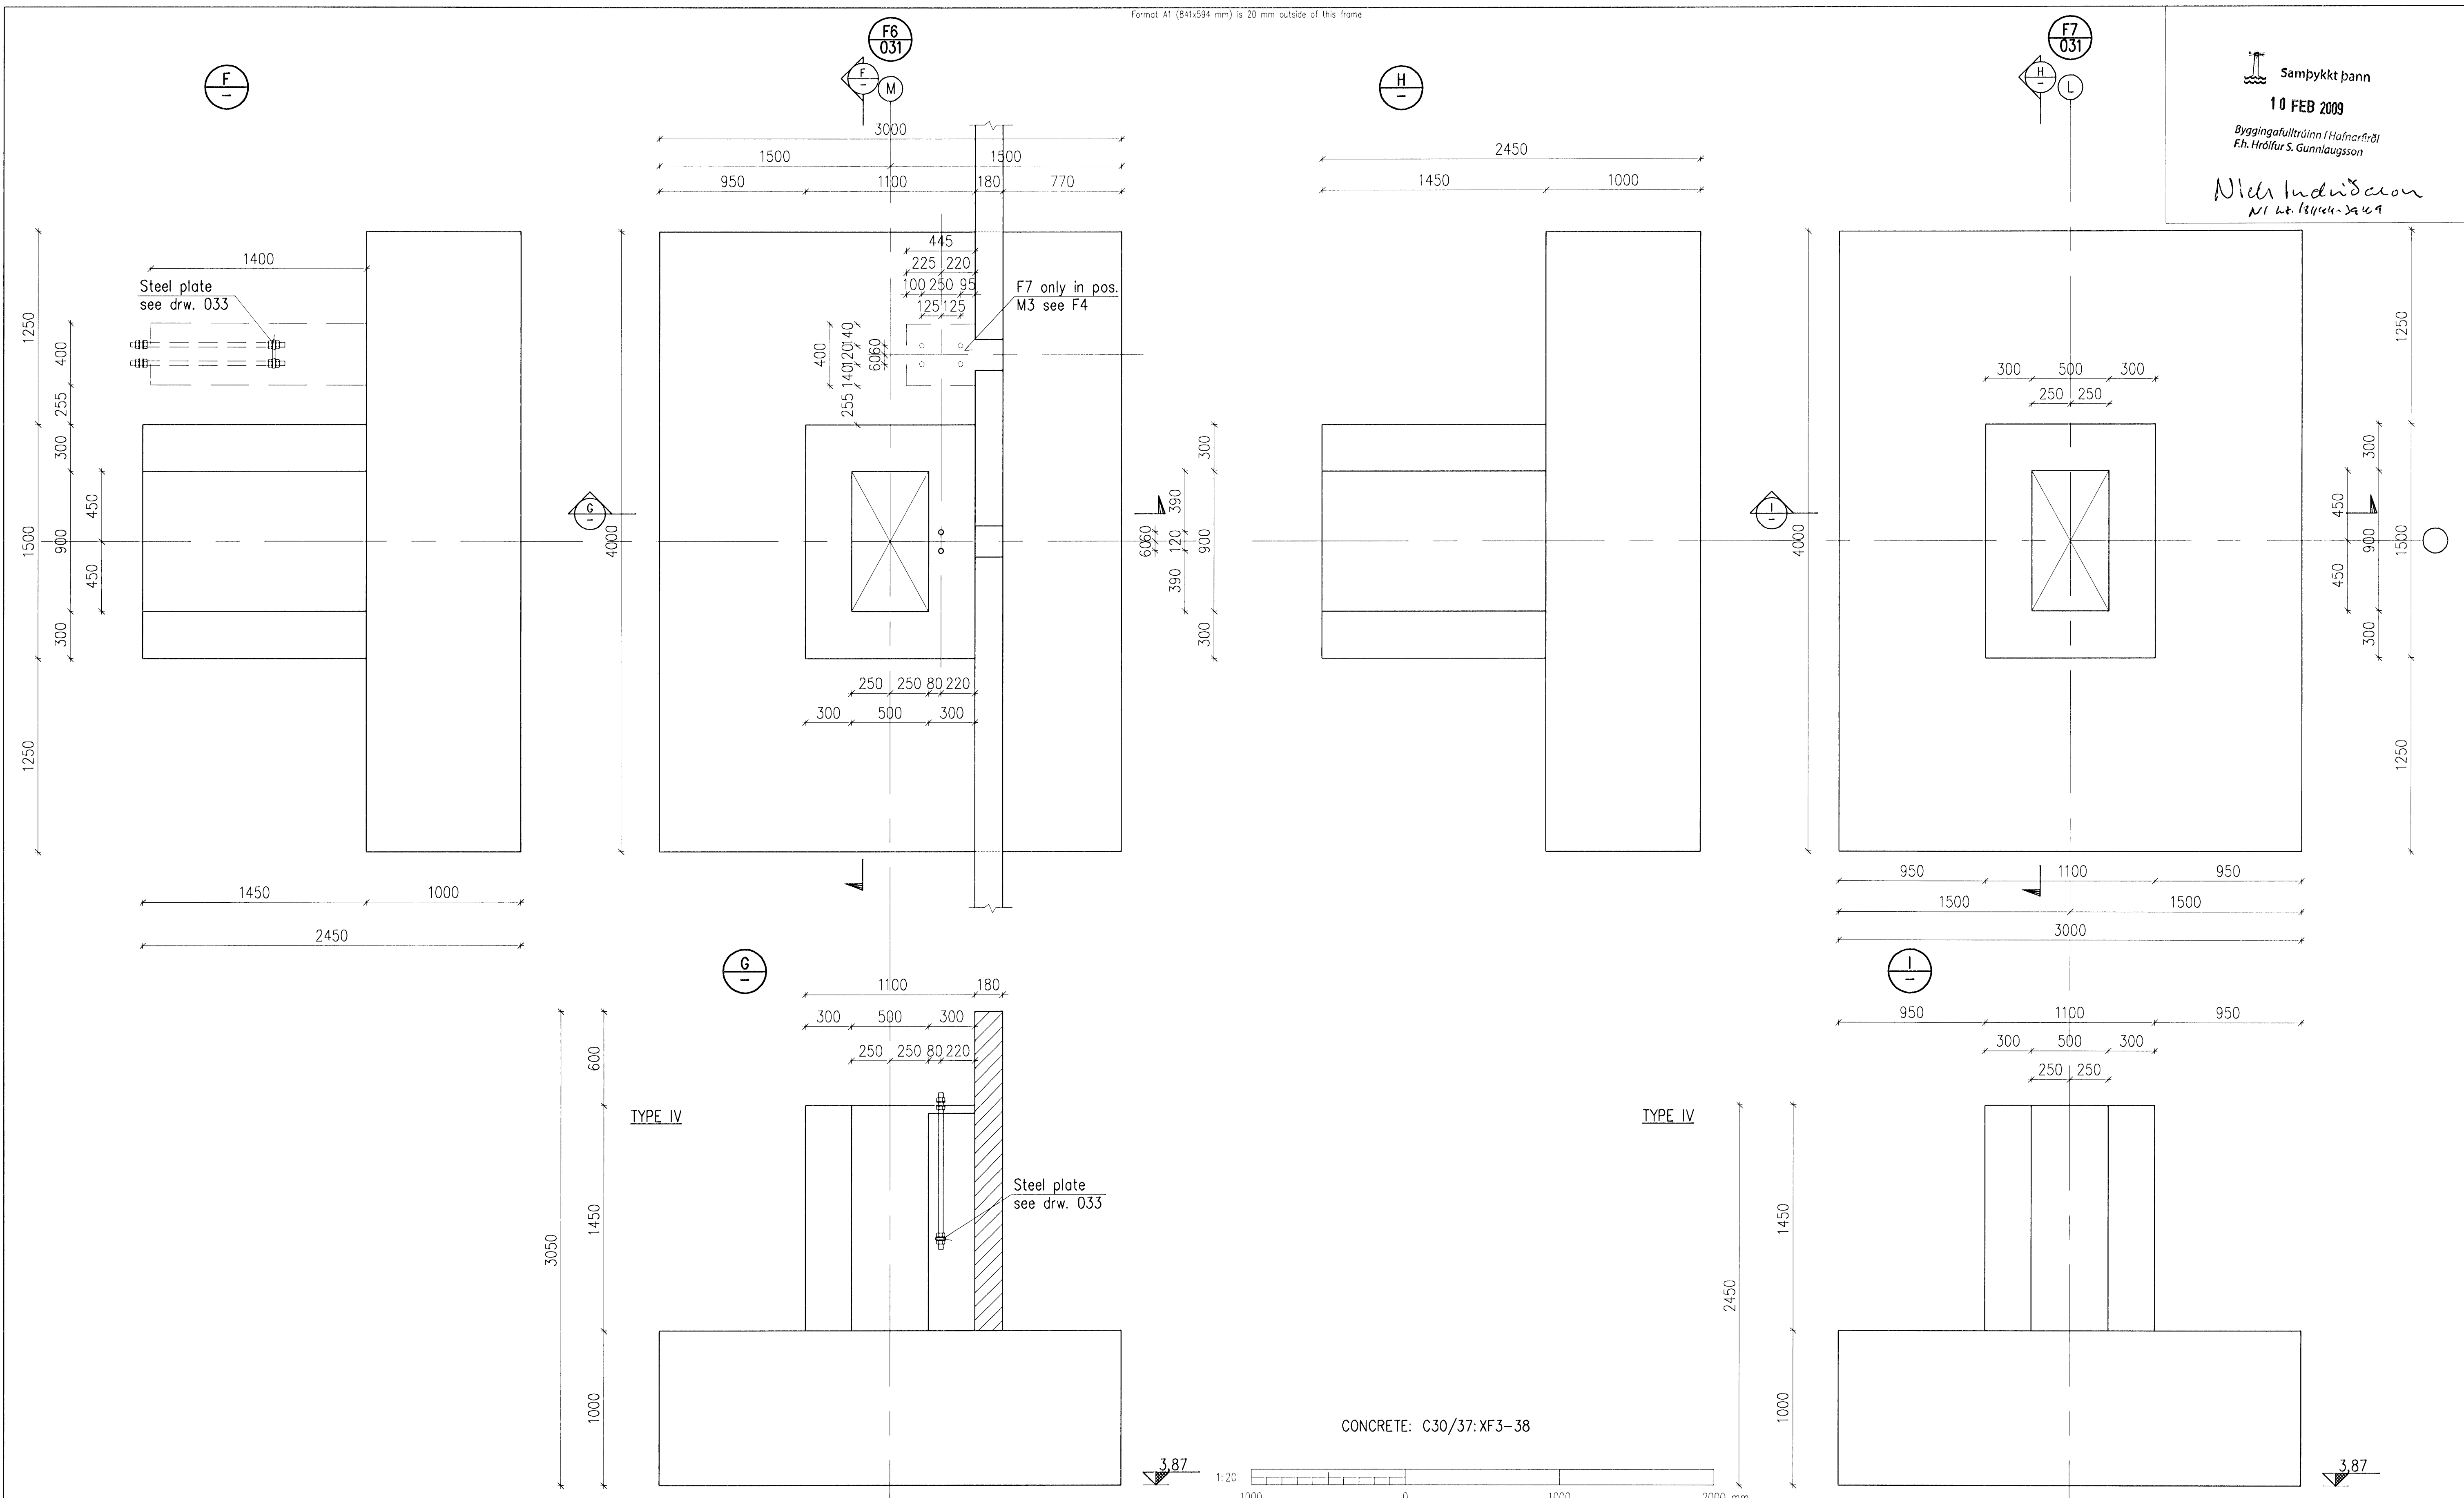

Skýringar:
Explanations:

Fjöldi stykja Number of pieces	Stærð Format	Stærð Format	Stærð Format	Stærð Format	Stærð Format
IV	III	II	I		

This drawing is the property of the Rio Tinto Alcan Iceland Ltd. and handed out for personal use only. It may neither be copied nor made available to others without permission of the Rio Tinto Alcan Iceland Ltd. The receiver is liable for any misuse.		Fjöldi stykja Number of pieces IV III II I	Hlutur Object IDP 410 - SUBSTATION 220 kV SWITCHYARD BLD. AND 60 kV SWITCHGEAR BLD. FOUNDATION, DETAILS AND SECTIONS 3/3	Atriði Item HRV	Efnit Material NI	Þyngd Weight (kg) 250134	Tölur í hella Scale 1:20	Athugasemdir Remarks 4011
Tæknir. / Drawn H.S./LDB 2008.10.01		Yfirfarð / Checked NI		Tæknir. / Drawn HRV		Tæknir. / Drawn 250134		Tæknir. / Drawn 2

