# ROOF, 1:50

Samþykkt þann
04 APR 2011
Byggingarfulltrúinn í Hafnarfirði
F.h. Hrólfur S. Gunnlaugsson

Wich Indication
NI 19/4/11 - 3495

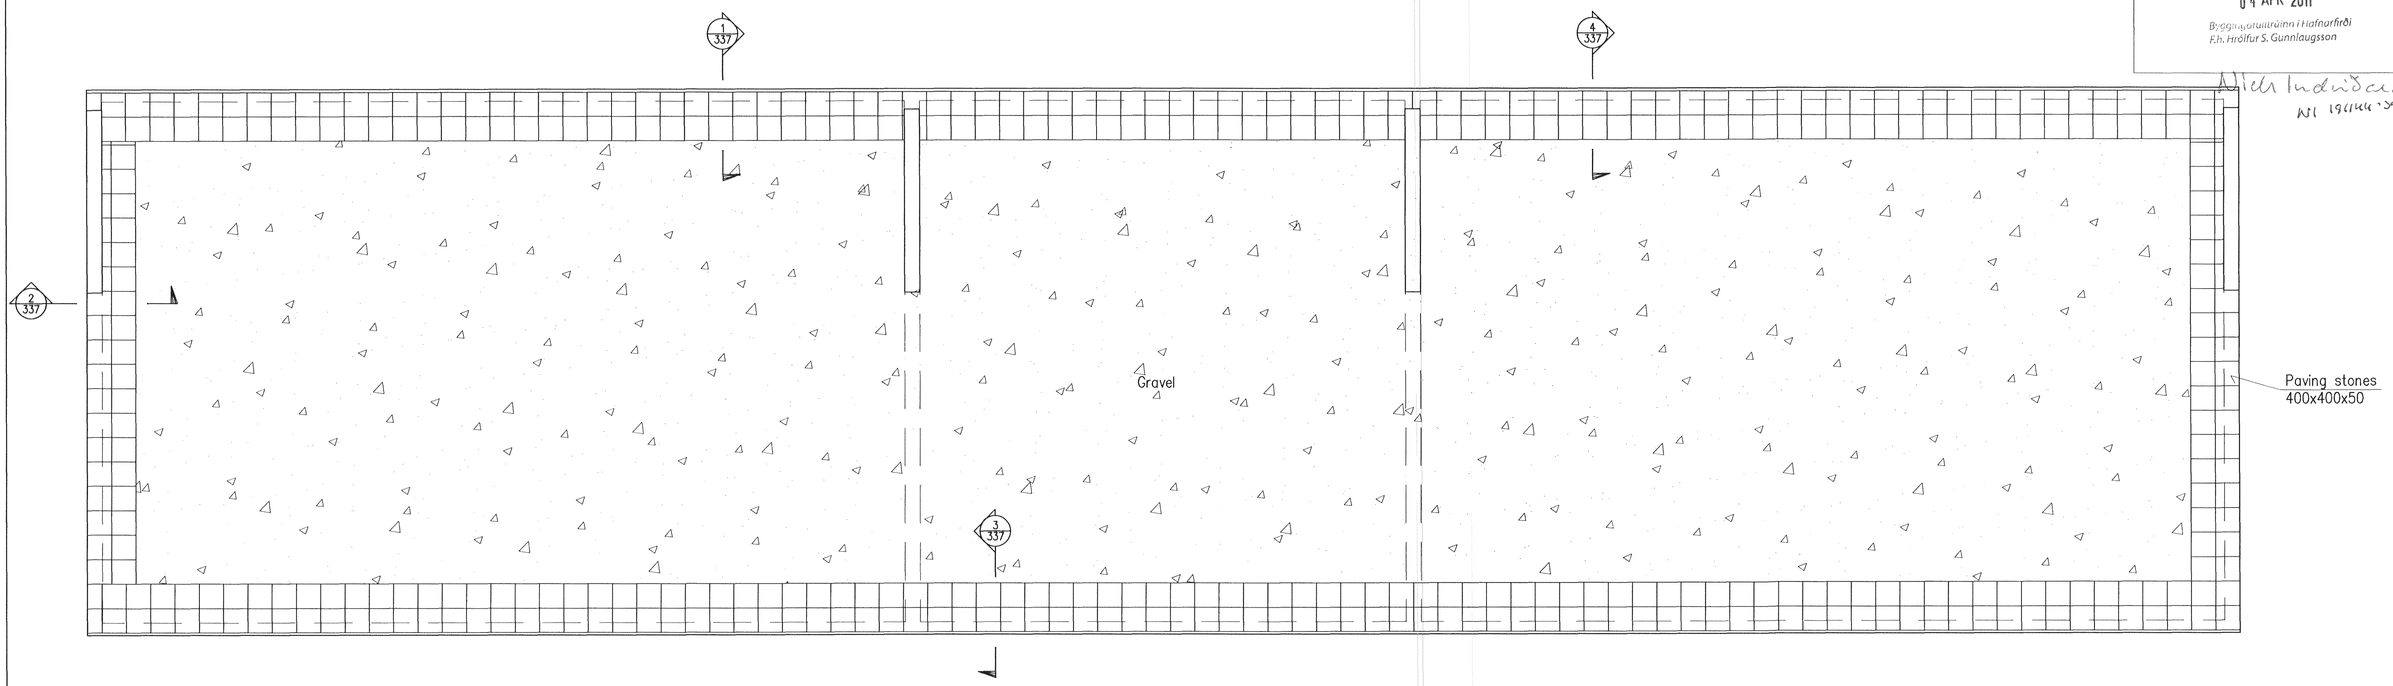


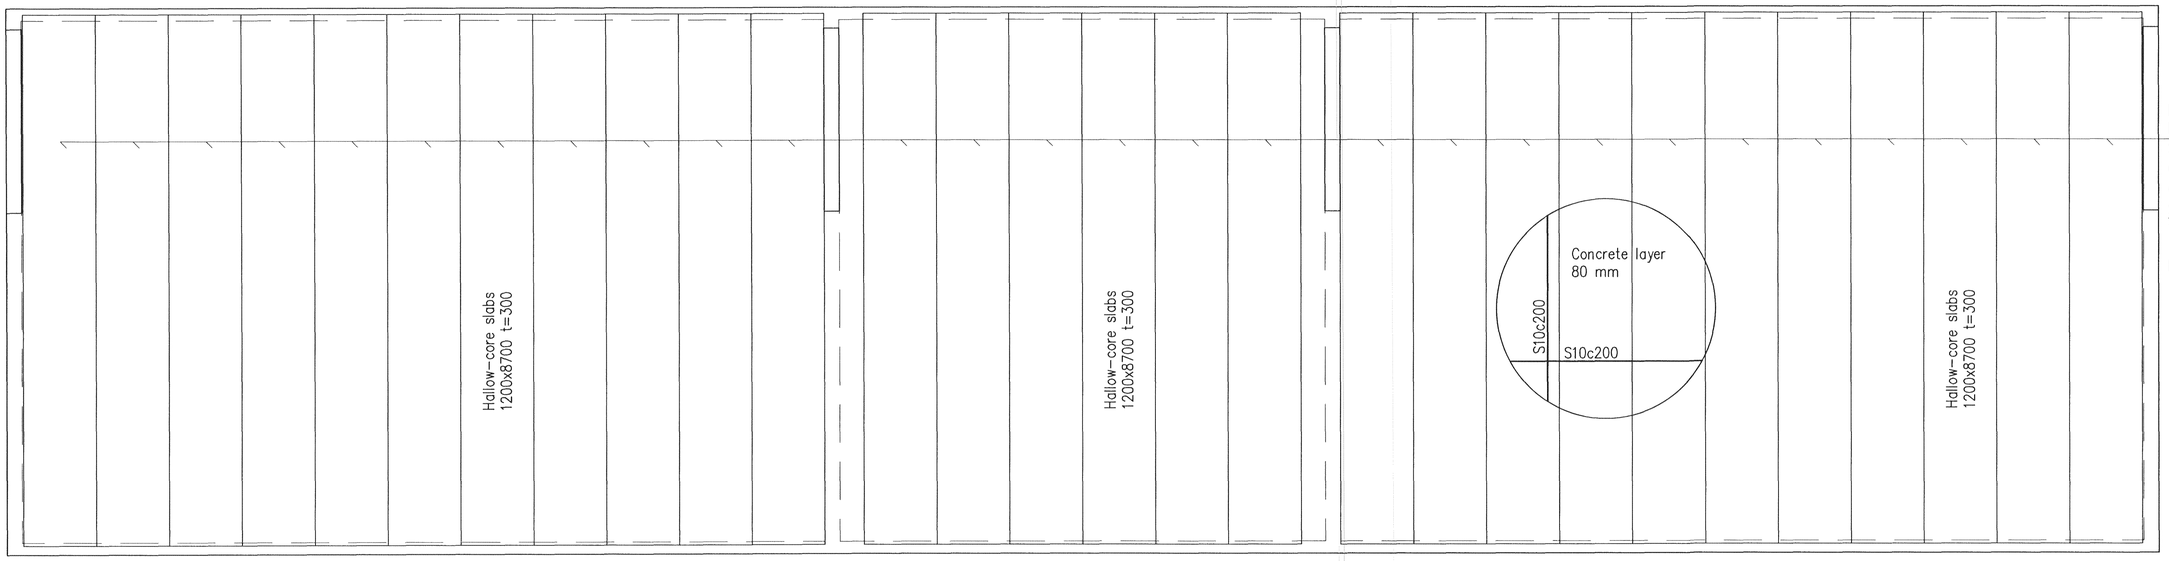


Hollow-core slab
Load:

| | |
|---|---|
| Selfweight | 3,0kN/m² |
| Concrete | 2,0kN/m² |
| Gravel | 2,0kN/m² |
| Snow | 5,0kN/m² |
| Total | 12,0kN/m² |

Fire resistance REI 180.

1:50 1000 0 1000 2000 3000 4000 5000 mm

Skýringar:
Legend:

C:\IDP\01 IDP\400 – Reduction\410 Substation\Drawings\Civil\IDP-410-CA-015-336.dwg

| Útg nr Rev no | Lýsing Description | Dagsetning Date | Han/Tkn Des/Drw | Yfirf Ckd | Notk heim Suppl Ref | Notk heim ISAL Ref |
|---|---|---|---|---|---|---|
| 1 | Issue for construction | 11.03.07 | HS/LDB | NI | ÓS | |

This drawing is the property of Rio Tinto Alcan Iceland Ltd. and handed out for personal use only. It may neither be copied nor made available to others without permission of Rio Tinto Alcan Iceland Ltd. The receiver is liable for any misuse.

Stærð: Format: A1 Mkv: Scale: 1:50
Dimensions without tolerances according to ISO 2768-1 medium.

HRV ENGINEERING

Dagsetning / Date: 2011.03.07
Hannað / Designed: HS
Teikn / Drawn: LDB
Verktaki / Supplier: HRV
Teikn.nr.verktaka / Supplier drw.no.: IDP-410-CA-015-336
Samþykkt / Approved: NI
Yfirf / Chkd: NI
Hluti of: / Part of:

IPU410-RECTIFIER BUILDINGS
B5/S2
ROOF
Teg.teikningar / Dwg. type: BUILDING FITTOUT

Rio Tinto Alcan
ISAL
Alcan Iceland Ltd
Straumsvík
IS-222 Hafnarfjordur
Iceland

Flokkur nr.: | Blað nr.: | Næsta bl.nr.:
Kostn.nr.-Ccno. / Bún.nr.-Eq.no
AKS
Teikn.nr. ISAL /Drw.no. of ISAL
Breyt./Rev.: C

ISAL Yfirfarið og skráð, dags / ISAL Checked, date
ISAL Samþykkt, dags / ISAL Approval, date