



GRUNNMYND 2. HÆÐAR M1:50

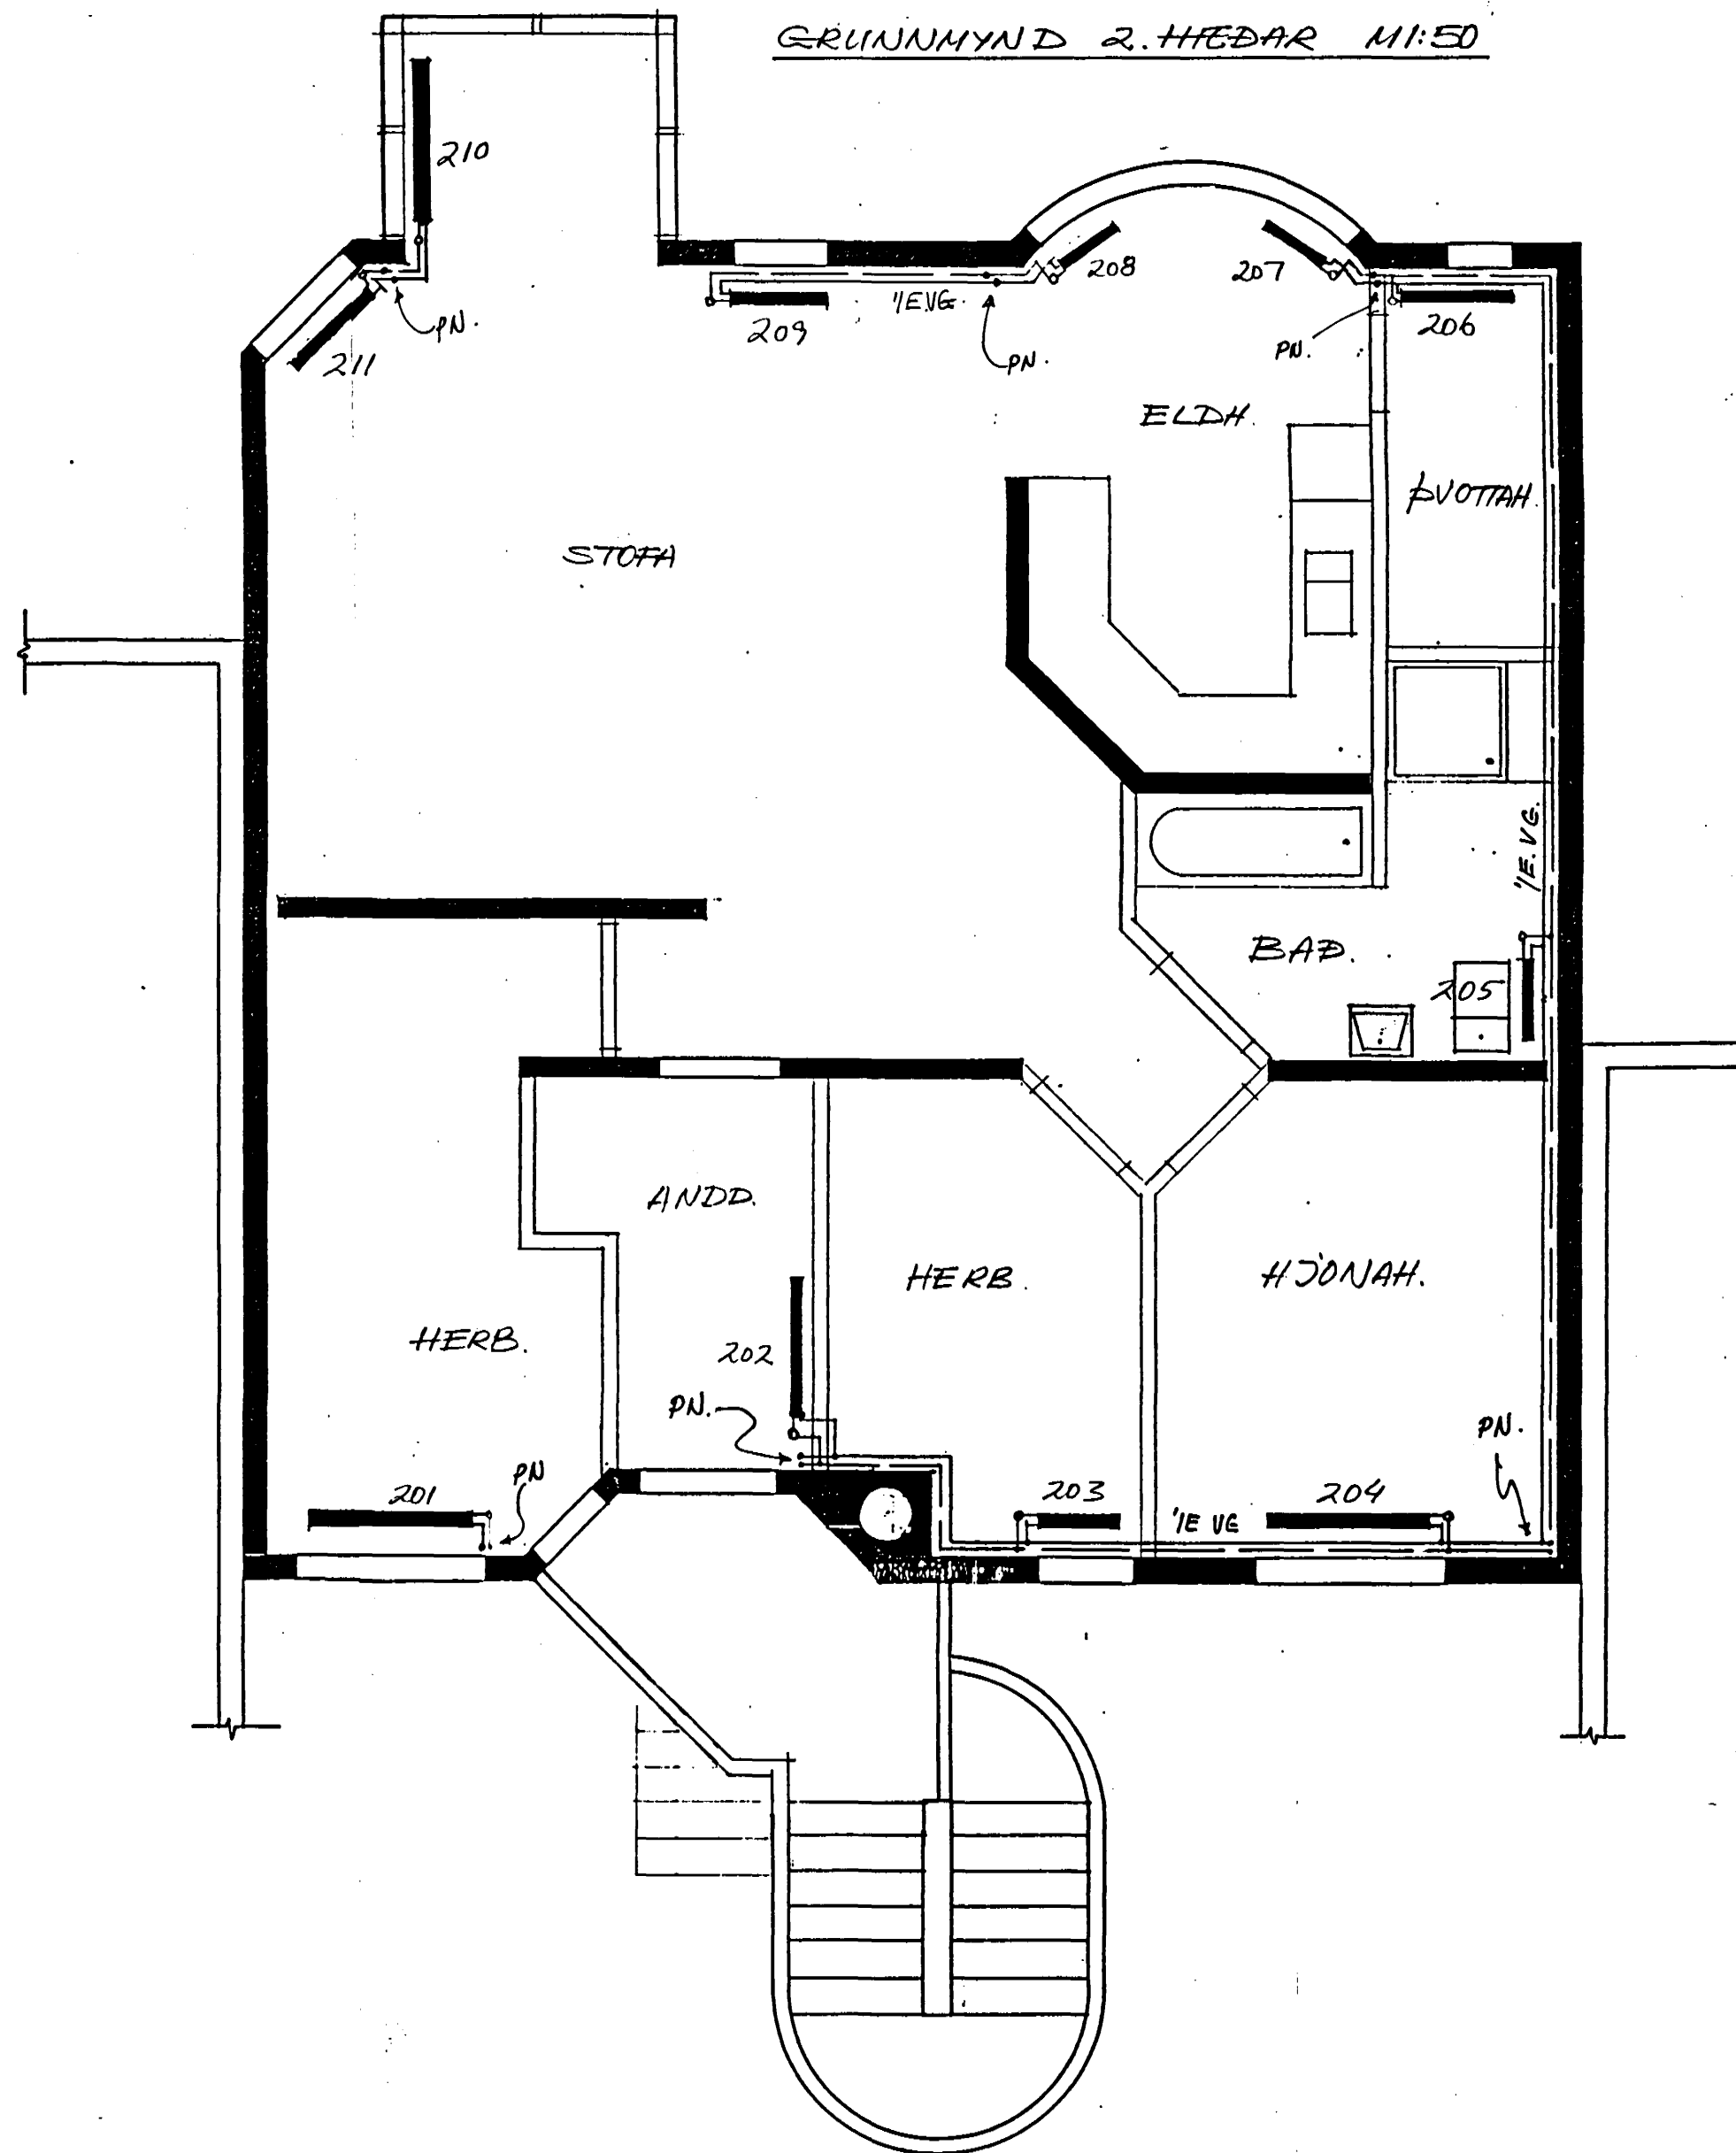

OFNATAFLA

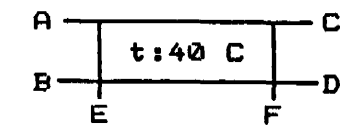

ofn nr.	varma- þörf kcal/h	hámarksstærð ofns		tenging	danfoss ofnlokar
		lengd sm.	hæð sm.		
001	600	130	56	A-B-3/8	FJVR
002	300	100	56	C-D	FJVR
003	500	130	56	C-D	FJVR
004	300	100	56	A-B	FJVR
101	1010	120	56	A-B	FJVR
102	620	100	56	C-D	FJVR
103	810	60	56	C-D	FJVR
104	920	120	56	A-B	FJVR
105	750	60	56	A-B	FJVR
106	555	80	56	A-B	FJVR
107	400	50	40	C-D	FJVR
108	400	50	40	A-B	FJVR
109	550	70	56	A-B	FJVR
110	750	120	21	C-D	FJVR
111	1000	80	56	C-D	FJVR
201	1150	120	56	A-B	FJVR
202	620	100	56	C-D	FJVR
203	910	60	56	C-D	FJVR
204	1050	120	56	A-B	FJVR
205	750	60	56	A-B	FJVR
206	555	80	56	A-B	FJVR
207	400	50	40	C-D	FJVR
208	400	50	40	A-B	FJVR
209	1150	80	56	A-B	FJVR
210	750	120	21	A-B	FJVR
211	1000	80	56	C-D	FJVR

17 DEC 1991



Jón R Sigmundsson tæknifr.

SÍMI 68846	ALFHOLT 8 HF.	NR.
REYKJAVÍK	HITI.	199-H-2
M: 1:50	2. HÆÐ	
HANNAÐ: JRS.	GRUNNMYND.	
TEIKNAD: JRS.		
DAGS. 26.10.91.	Jón R. Sigmundsson.	