



23/9 '11 JL


Niel Indriðadóttir
 66. 18844-34147

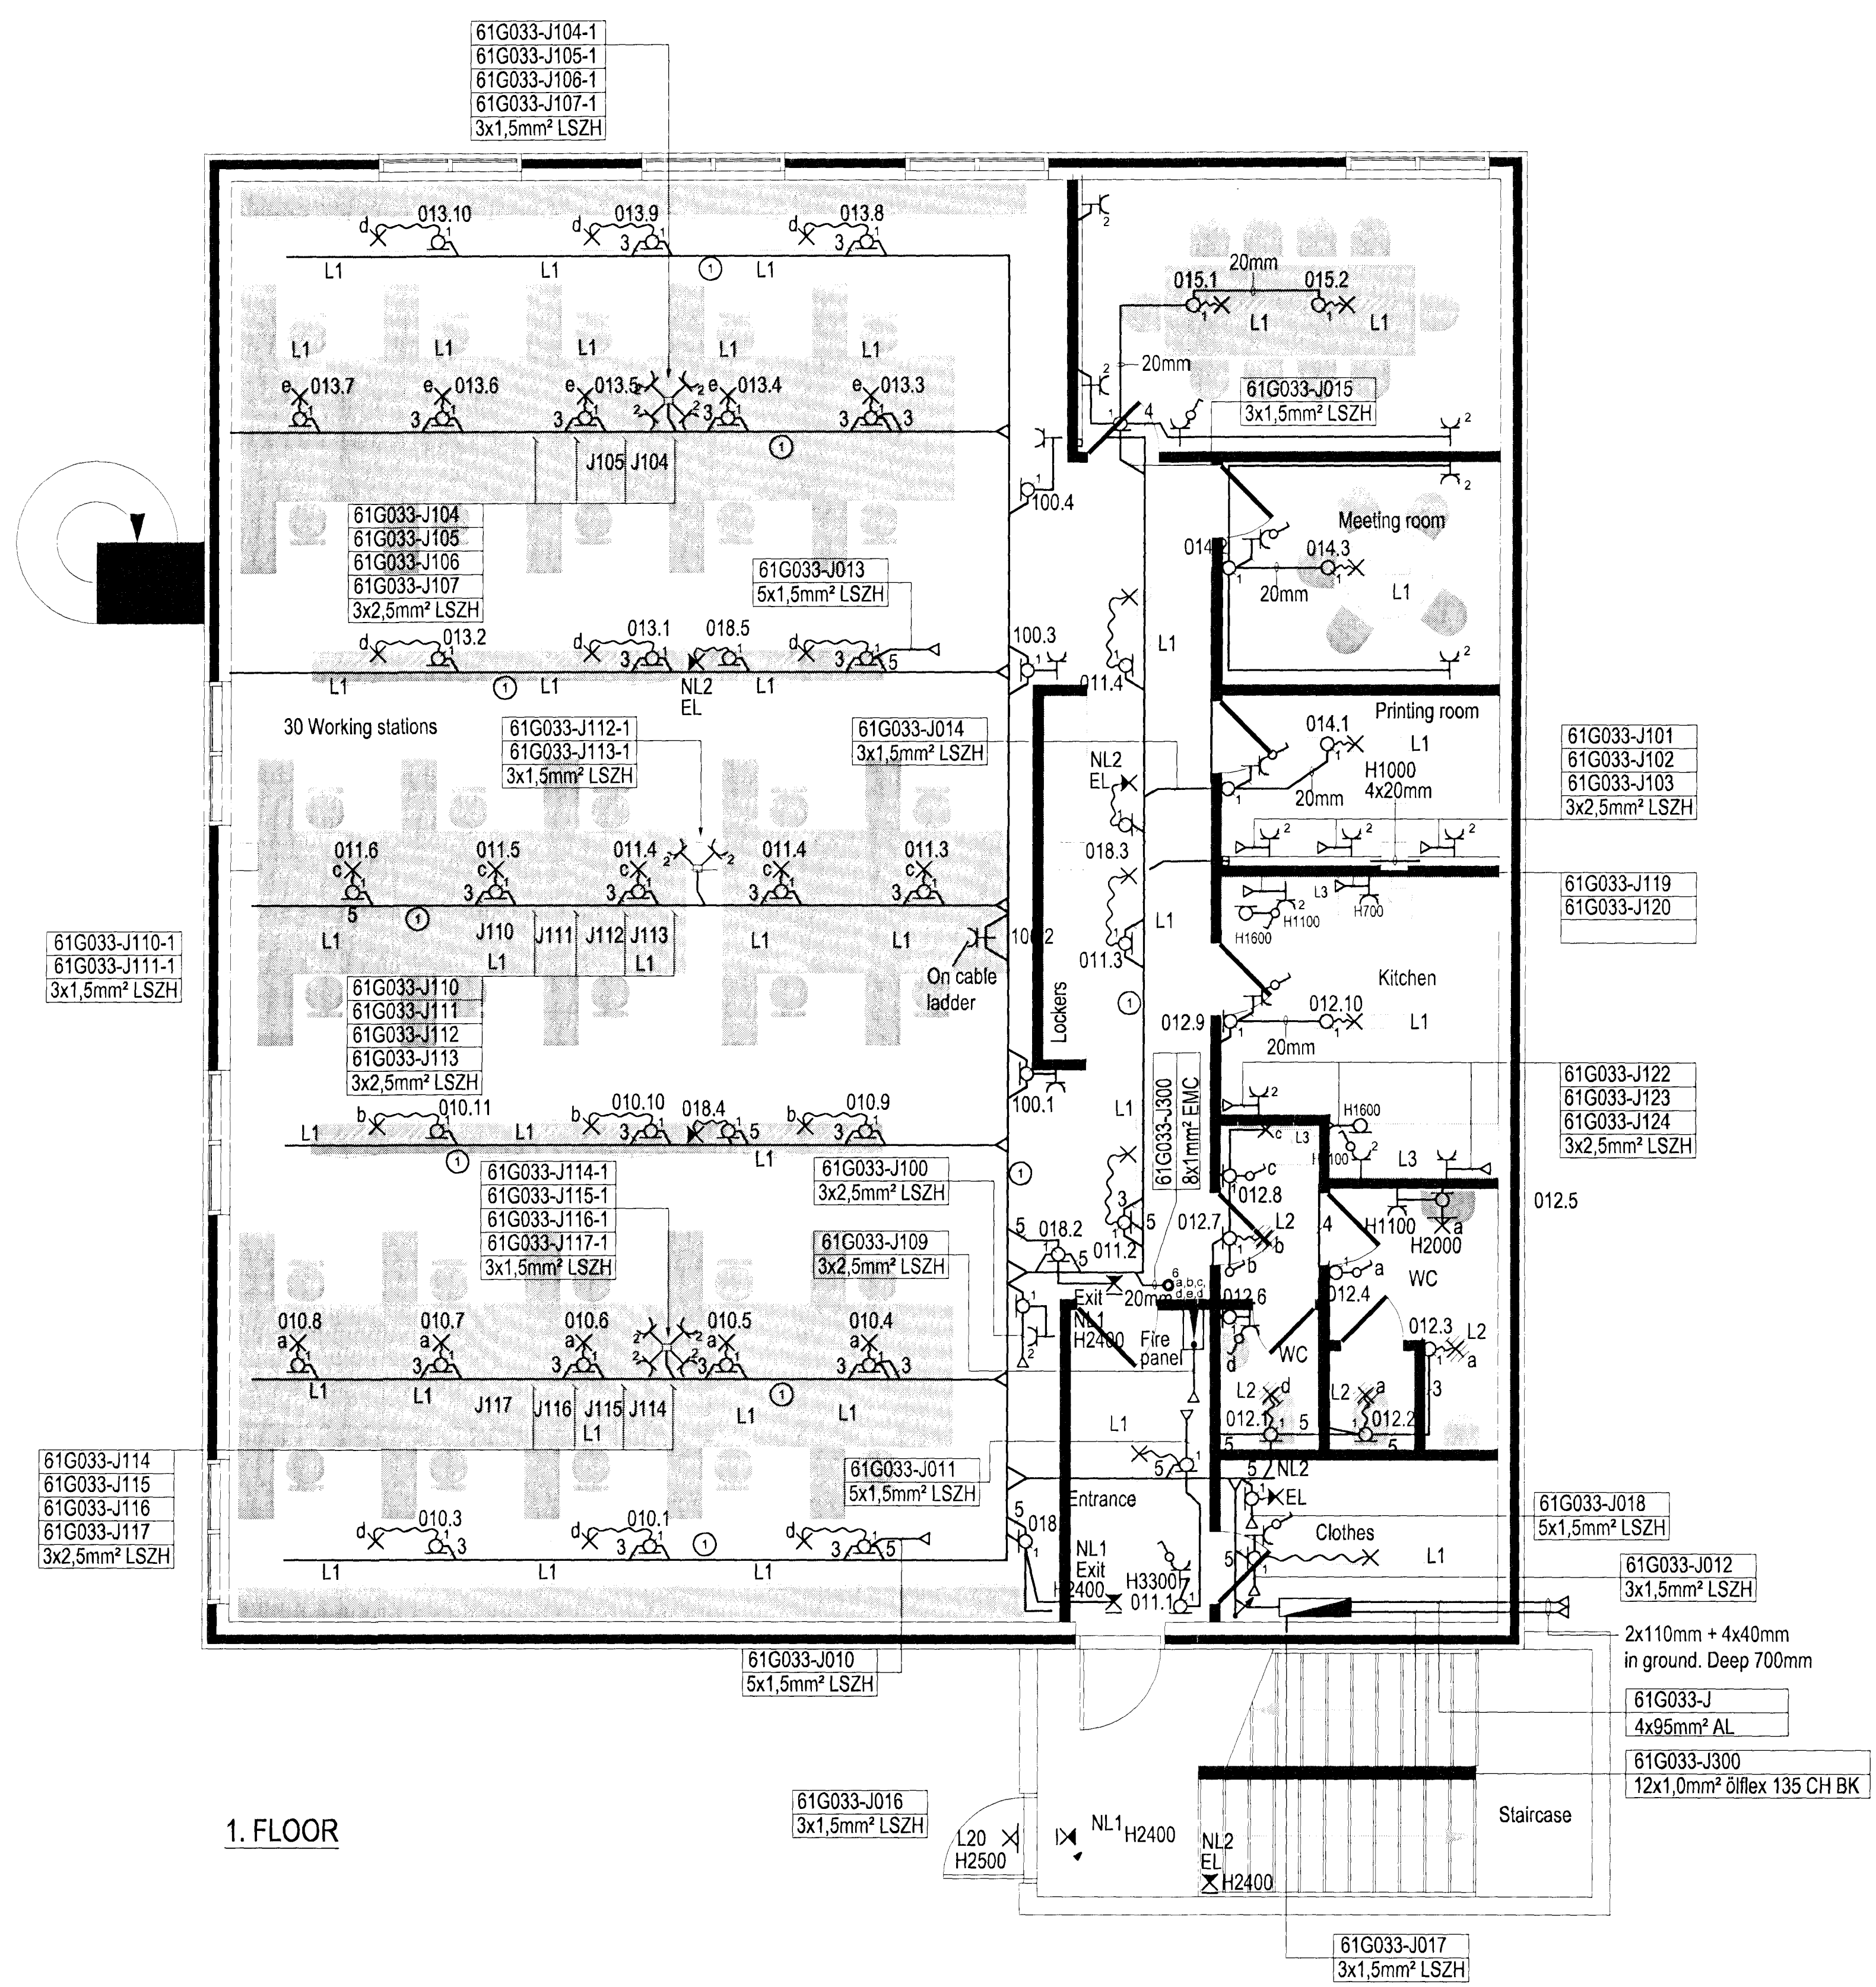

1. FLOOR

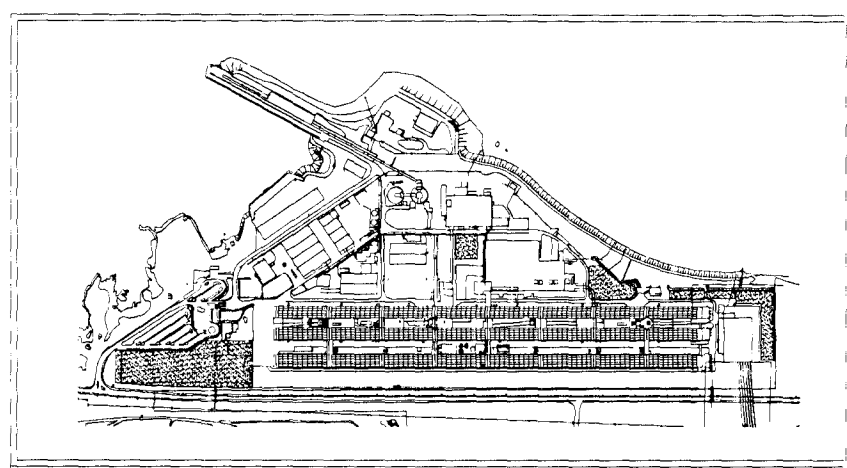

IPU Keyplan - Scale: 1:15000



- Skýringar:
 Legend:
- ① Cables in cable ladder
 - ② Outlets, vertical cable trunks
 - ③ All electrical installation is surface mounted in staircase

Slp. nr. Rev. no.	Lýsing Description	Dagsetning Date	Höfundur Des./Drw.	Yfirlit Old	Notk. heim. Suppl. Ref.	Notk. heim. ISAL Ref.
5	UPDATE DRAWING	2011.09.08	GJ	ARE		
4	CHANGE IN KITCHEN AND PIPES IN GROUND	2011.04.18	GJ	ARE	OS	MCBW
3	CHANGE IN STAIRWELL AND ADD PIPES IN GROUND	2011.03.21	GJ	ARE	ER	MCBW
2	ISSUED FOR CONSTRUCTION	2011.02.25	GJ	ARE	ER	MCBW

This drawing is the property of Rio Tinto Alcan Iceland Ltd. and handed out for personal use only. It may neither be copied nor made available to others without permission of Rio Tinto Alcan Iceland Ltd. The receiver is liable for any misuse.

Stærð: A1
 Mkv. Scale: 1:50
 Formát: Dimensions without tolerances according to ISO 2768-1 medium.



Dagsetning / Date	2010.11.26
Hönnuð / Designed	GJ
Tekni / Drawn	pLI
Verktaki / Supplier	HRV
Tekni nr. verkstaka / Supplier draw no.	IPU-872-FF-507-011
Samp. nr. / Approved	ARE
Yfirlit / Chkd	ARE
Hluti af: / Part of:	

IPU 872 - EPCM SITE OFFICE
ELECTRICAL INSTALLATION
 LAYOUT - 1. FLOOR

Rio Tinto Alcan

ISAL
 Alcan Iceland Ltd
 Straumsvík
 IS-222 Hafnarþorður
 Ísland

Tekni nr. ISAL / Draw no. of ISAL: Breyt / Rev: C

Flókkur nr.: Blað nr.: Nasta bl. nr.:
 Kostn. nr. - Cono. / Bætur - Eqno
 AKS

ISAL ritfarið og skráð, dags. / ISAL Checked, date
 ISAL Samp. nr., dags. / ISAL Approval, date