


SKÝRINGAR.

ALLT LÍFRÆNT EFTIR SKAL FJARKLÆCT OG GRAFIB MIÐUR Á FASTAN BOTN. Fyllingarefni innri í og umhverfis sökkla skal vera froðstærft.

K10 merkir karnstál KS 40. Skentilengd 60cm. Hæðarkótur eru í m og gefnir upp á fullfræðandi gólf. Stéinsteyra í botnplötu og undirstöður er S200. Vatnsementstala: $V/S \leq 0.40 - 0.46$. Loftinnihald: 5-6%. Stéinsteyra í útveggi og stöðsteyra er S250. Sementsmagn: 300 kg/m³ - 350 kg/m³. Vatnsementstala: $V/S \leq 0.55 - 0.60$. Loftinnihald: 5-6%. Sígmál: 8-10 cm.

Dýpt sökkla á fyllingu má vera 90-120 cm. Mesta álag frá sökklum er 2.22 kF/cm² (0.22 MPa).

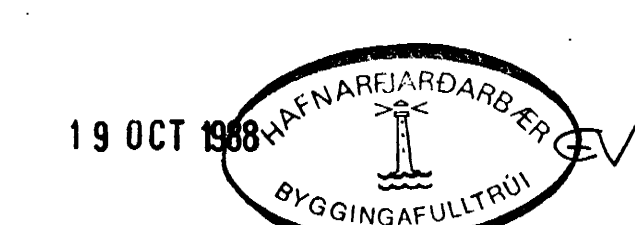

SÍÁ TEIKNINGU L-I	
BIRKIBERG 32 HAFNARFJARÐI	OKTÓBER 1988
SÖKKLAR	MELIKYRÐI
TEKNIÞJÓFUSTI SVEINS KARLSSONAR TFI	TEIKNING
HAFNARFJARÐAR 120 HAFNARFJARÐUR 41-54223	B-I