


TENGIMYND, HÚS A 1: 50



OFNASKRÁ							Δt = 40 °C	
OFN NR	AFL W	GERÐ	HÆÐ mm	LENGD mm	STADS STÚTA	OFNLOKAR	STILLI-HNÉ	ATHS.
HÚS A:								
101	1020	G21	21	2100	C-D	RA2010		
102	2100	G21/2	21	2100	A-B	RA2010		
103	870	VKM49	49	1400	B-C	RA2010		
104	250	V56	56	600	C-D	RA2010		
105	725	VKM63	63	1000	A-B	FJVR		
106	590	V63/2	63	800	C-D	RA2010		
107	505	V63	63	1100	C-B	RA2010		
108	2150	V77/2	77	2400	A-D	FJVR		
201	860	V63/2	63	1200	C-B	RA2010		
202	620	VKM63	63	800	A-B	RA2010		
203	770	VKM63	63	1000	A-B	RA2010		
204	1360	VKM63	63	1800	C-B	RA2010		
205	660	V63/2	63	900	A-B	RA2010		
206	620	V63/2	63	900	C-D	RA2010		
207	200	V63-400	63	400	A-B	RA2010		
HÚS B:								
101	1020	G21	21	2100	A-B	RA2010		
102	2100	G21/2	21	2100	C-D	RA2010		
103	870	VKM49	49	1400	A-D	RA2010		
104	250	V56	56	600	A-B	RA2010		
105	725	VKM63	63	1000	C-D	FJVR		
106	590	V63/2	63	800	A-B	RA2010		
107	565	V63	63	1100	A-D	RA2010		
108	2150	V77/2	77	2400	B-C	FJVR		
201	860	V63/2	63	1200	A-D	RA2010		
202	620	VKM63	63	800	C-D	RA2010		
203	770	VKM63	63	1000	C-D	RA2010		
204	1360	VKM63	63	1800	A-D	RA2010		
205	660	V63/2	63	900	C-D	RA2010		
206	680	V63/2	63	900	A-B	RA2010		
207	200	V63-400	63	400	C-D	RA2010		

SKÝRINGAR SJÁ TEIKN.NR.-402

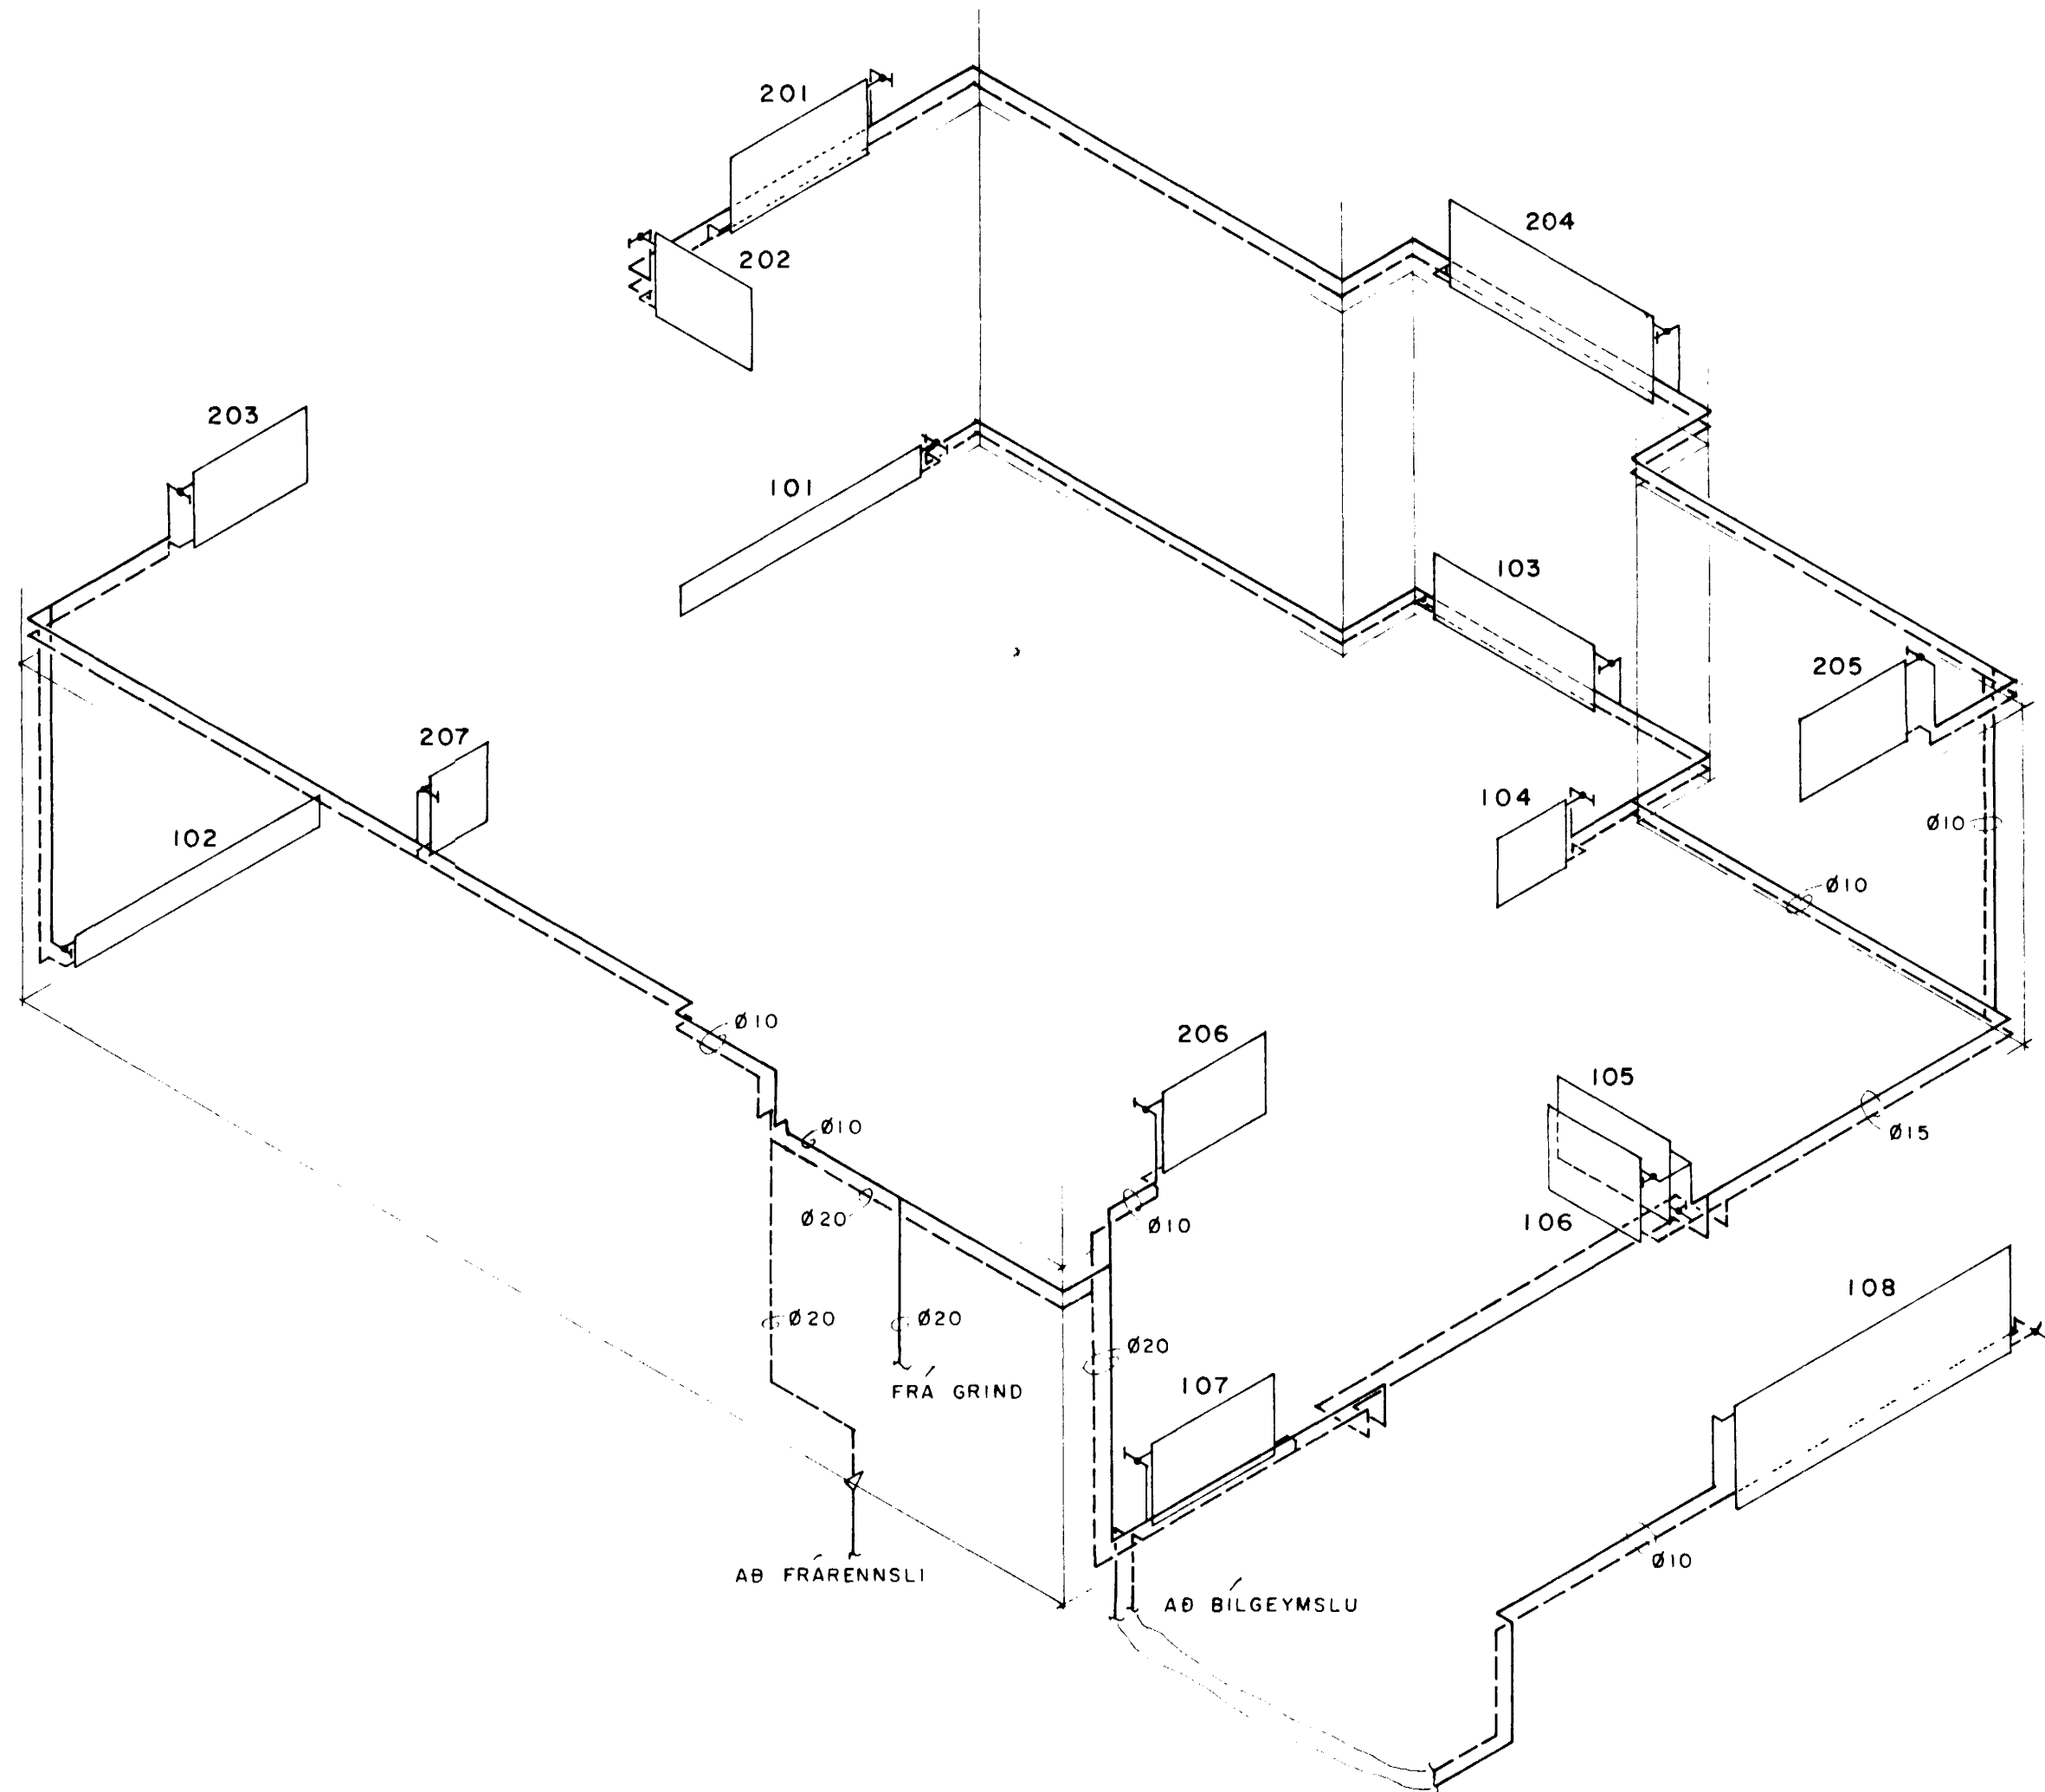

hönnun hf Ráðgjafarverkefningar FRV · Síðumúla 1 · 108 Reykjavík
Sími (91)84311 · Utíbu: Reyðarfjörður · Hvalsvöllur

M.	BREIÐVANGUR 64B	E
H.R.G.S.	HAFNARFIRÐI	D
T.Kaþo	HITAKERFI:	C
Y.	TENGIMYND	B
G. 81-68		A
DAGS 1972.8.7	SAMP Din Signatur	MKV 1:50
		87.398-403