

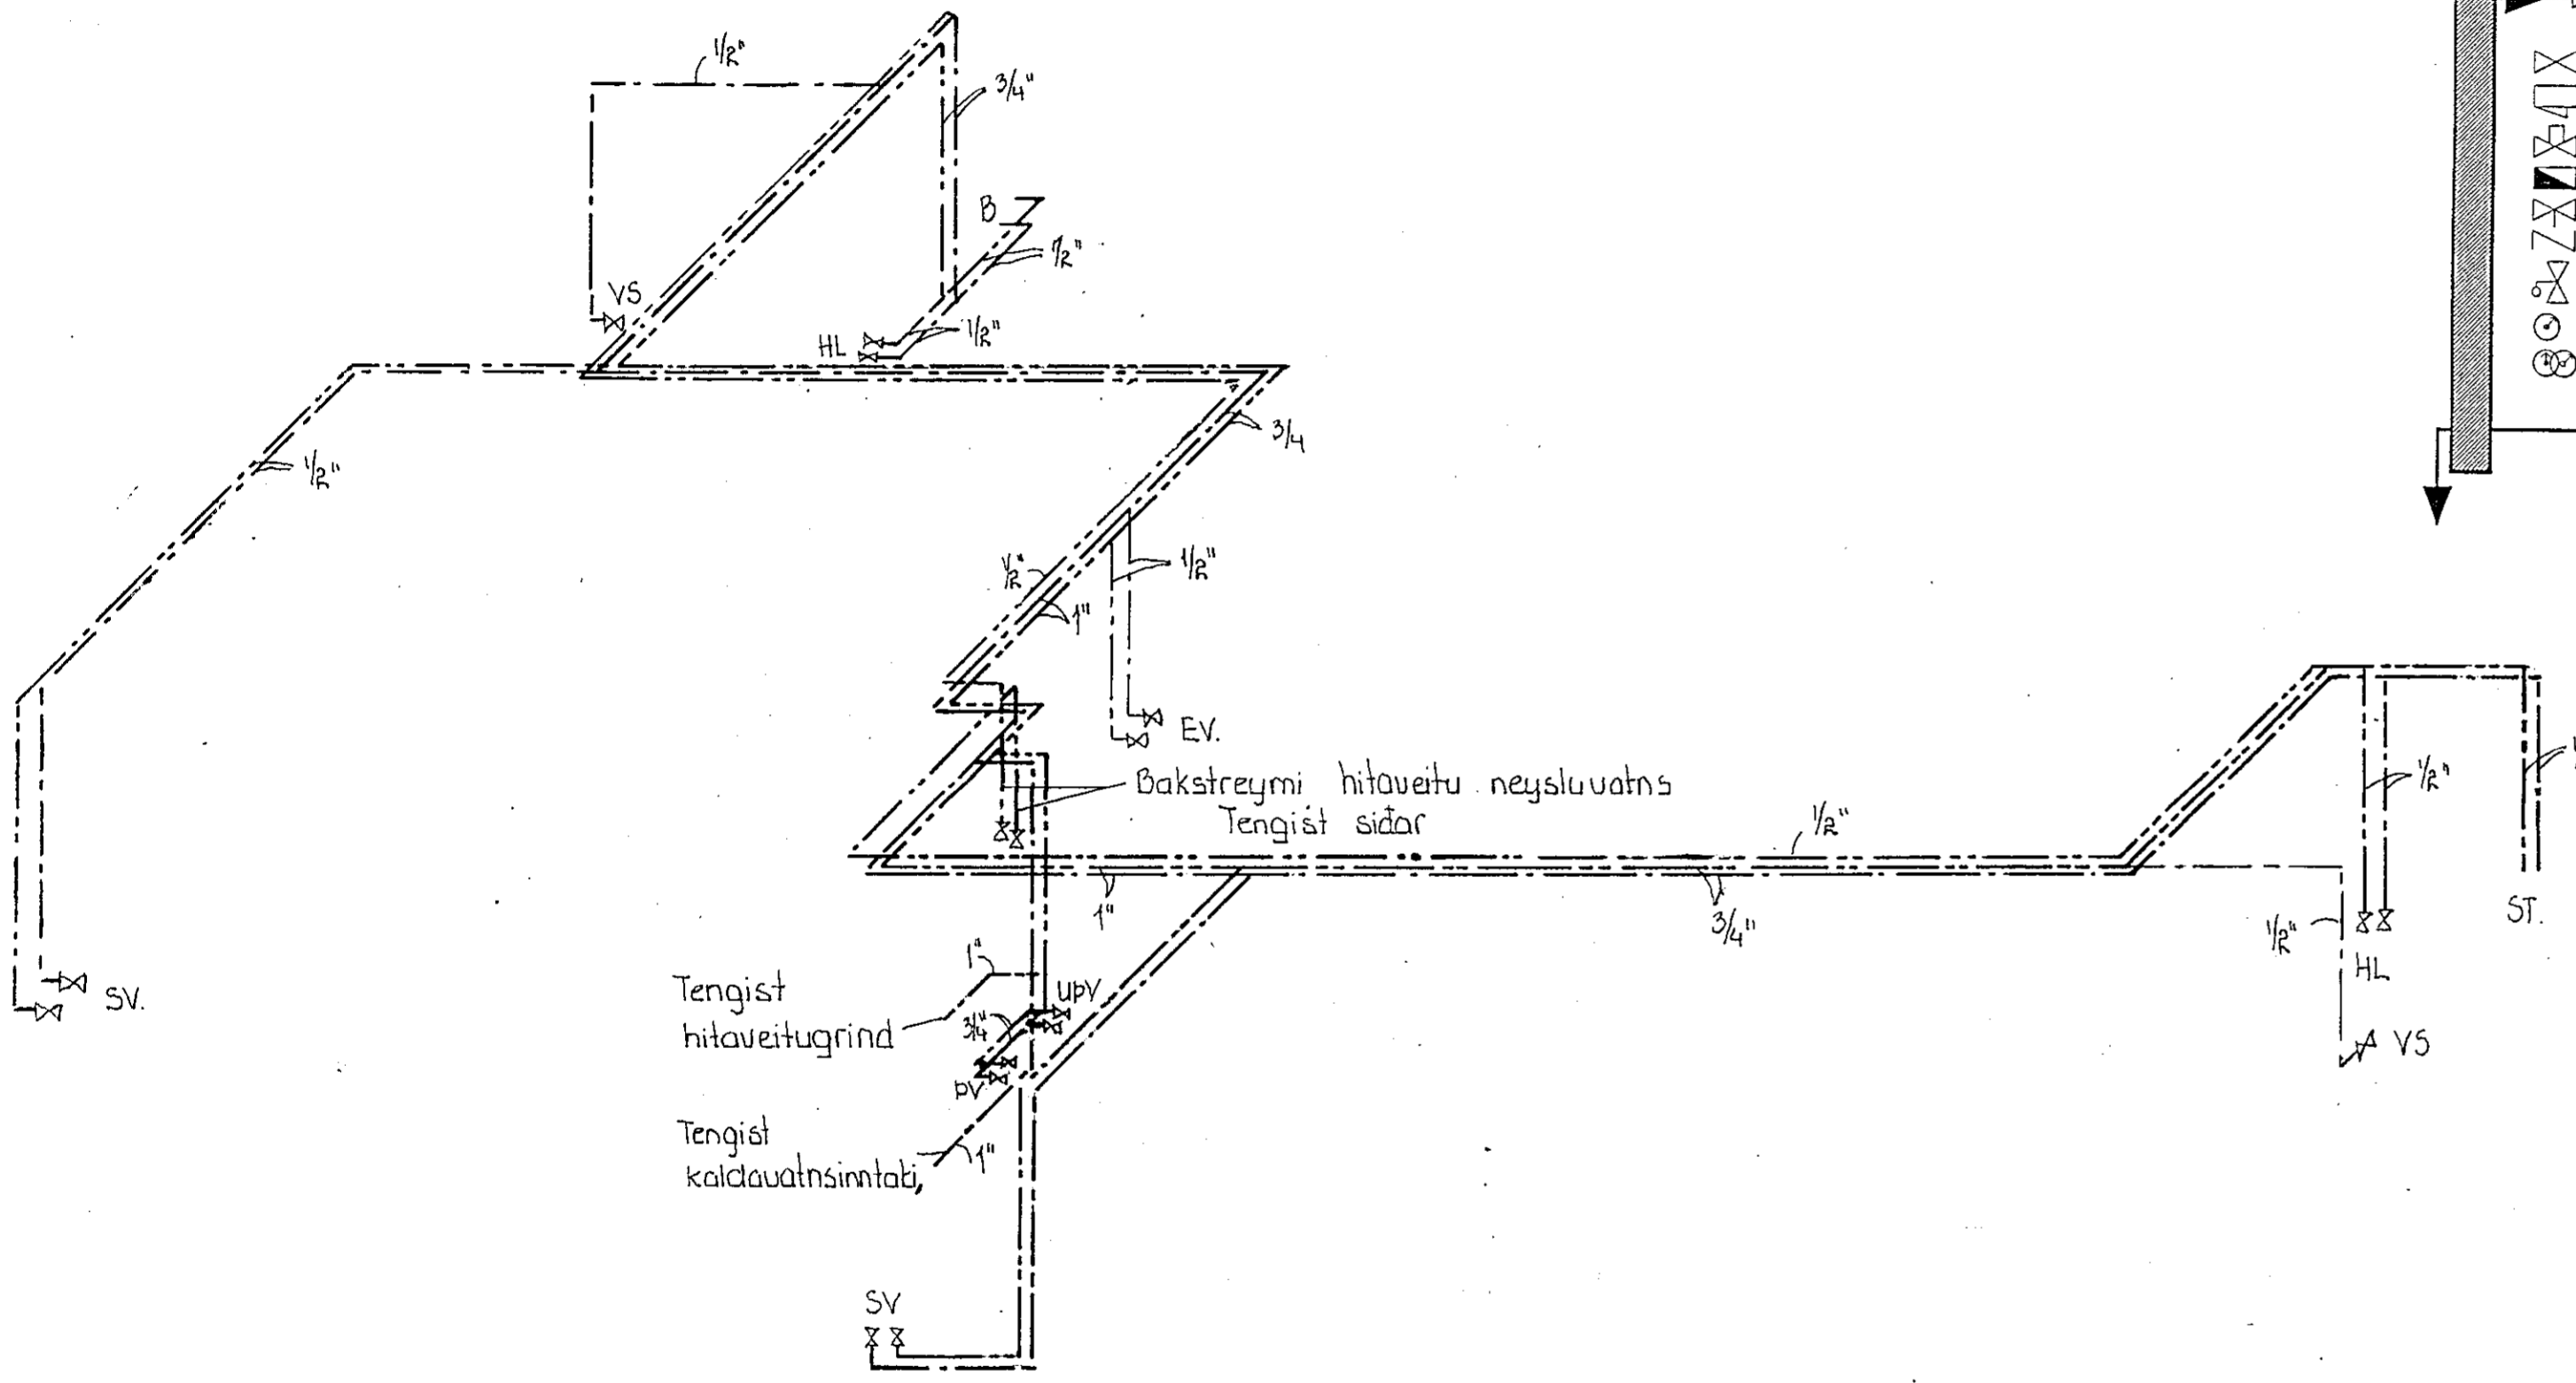


HITAVEITUKERFI
Húsatenging einfalt kerfi

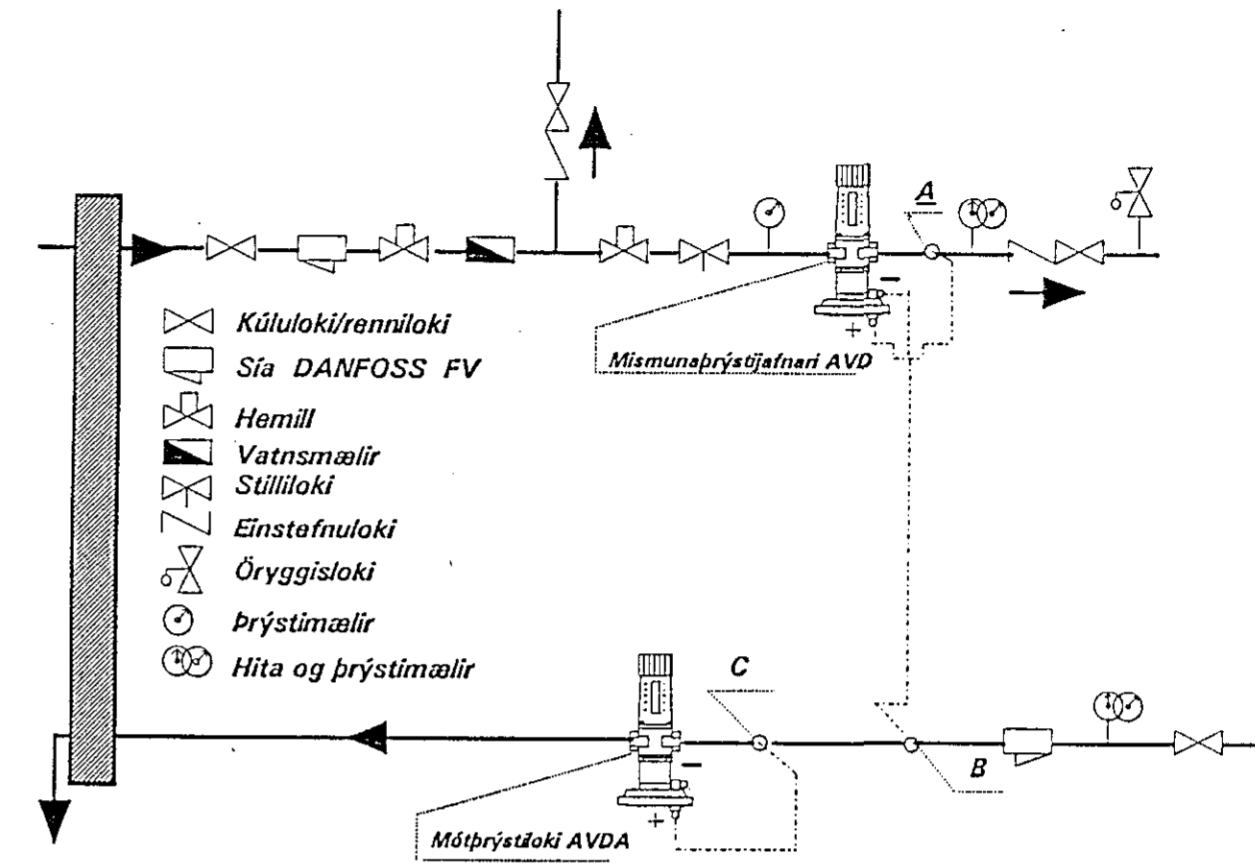

Kaldavatsinntak.

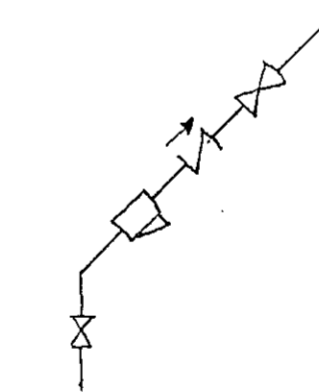

Allar pipur skulu vera galvanhúðaðar og einangrast.

26 NOV 1992

2. Birkiberg 12 Hafnarfirði

Vatnslagnir neysluvatn
nóv. 92

Hönnun: Karl ROSENKRÆÐI FTFI.
Gröndalinn 28.