



Húsvéita nr. \_\_\_\_\_  
 Samþykkt þ. \_\_\_\_\_  
 19\_\_\_\_  
 Teikning nr. \_\_\_\_\_  
 Eftirlitsmaður rafhlagna

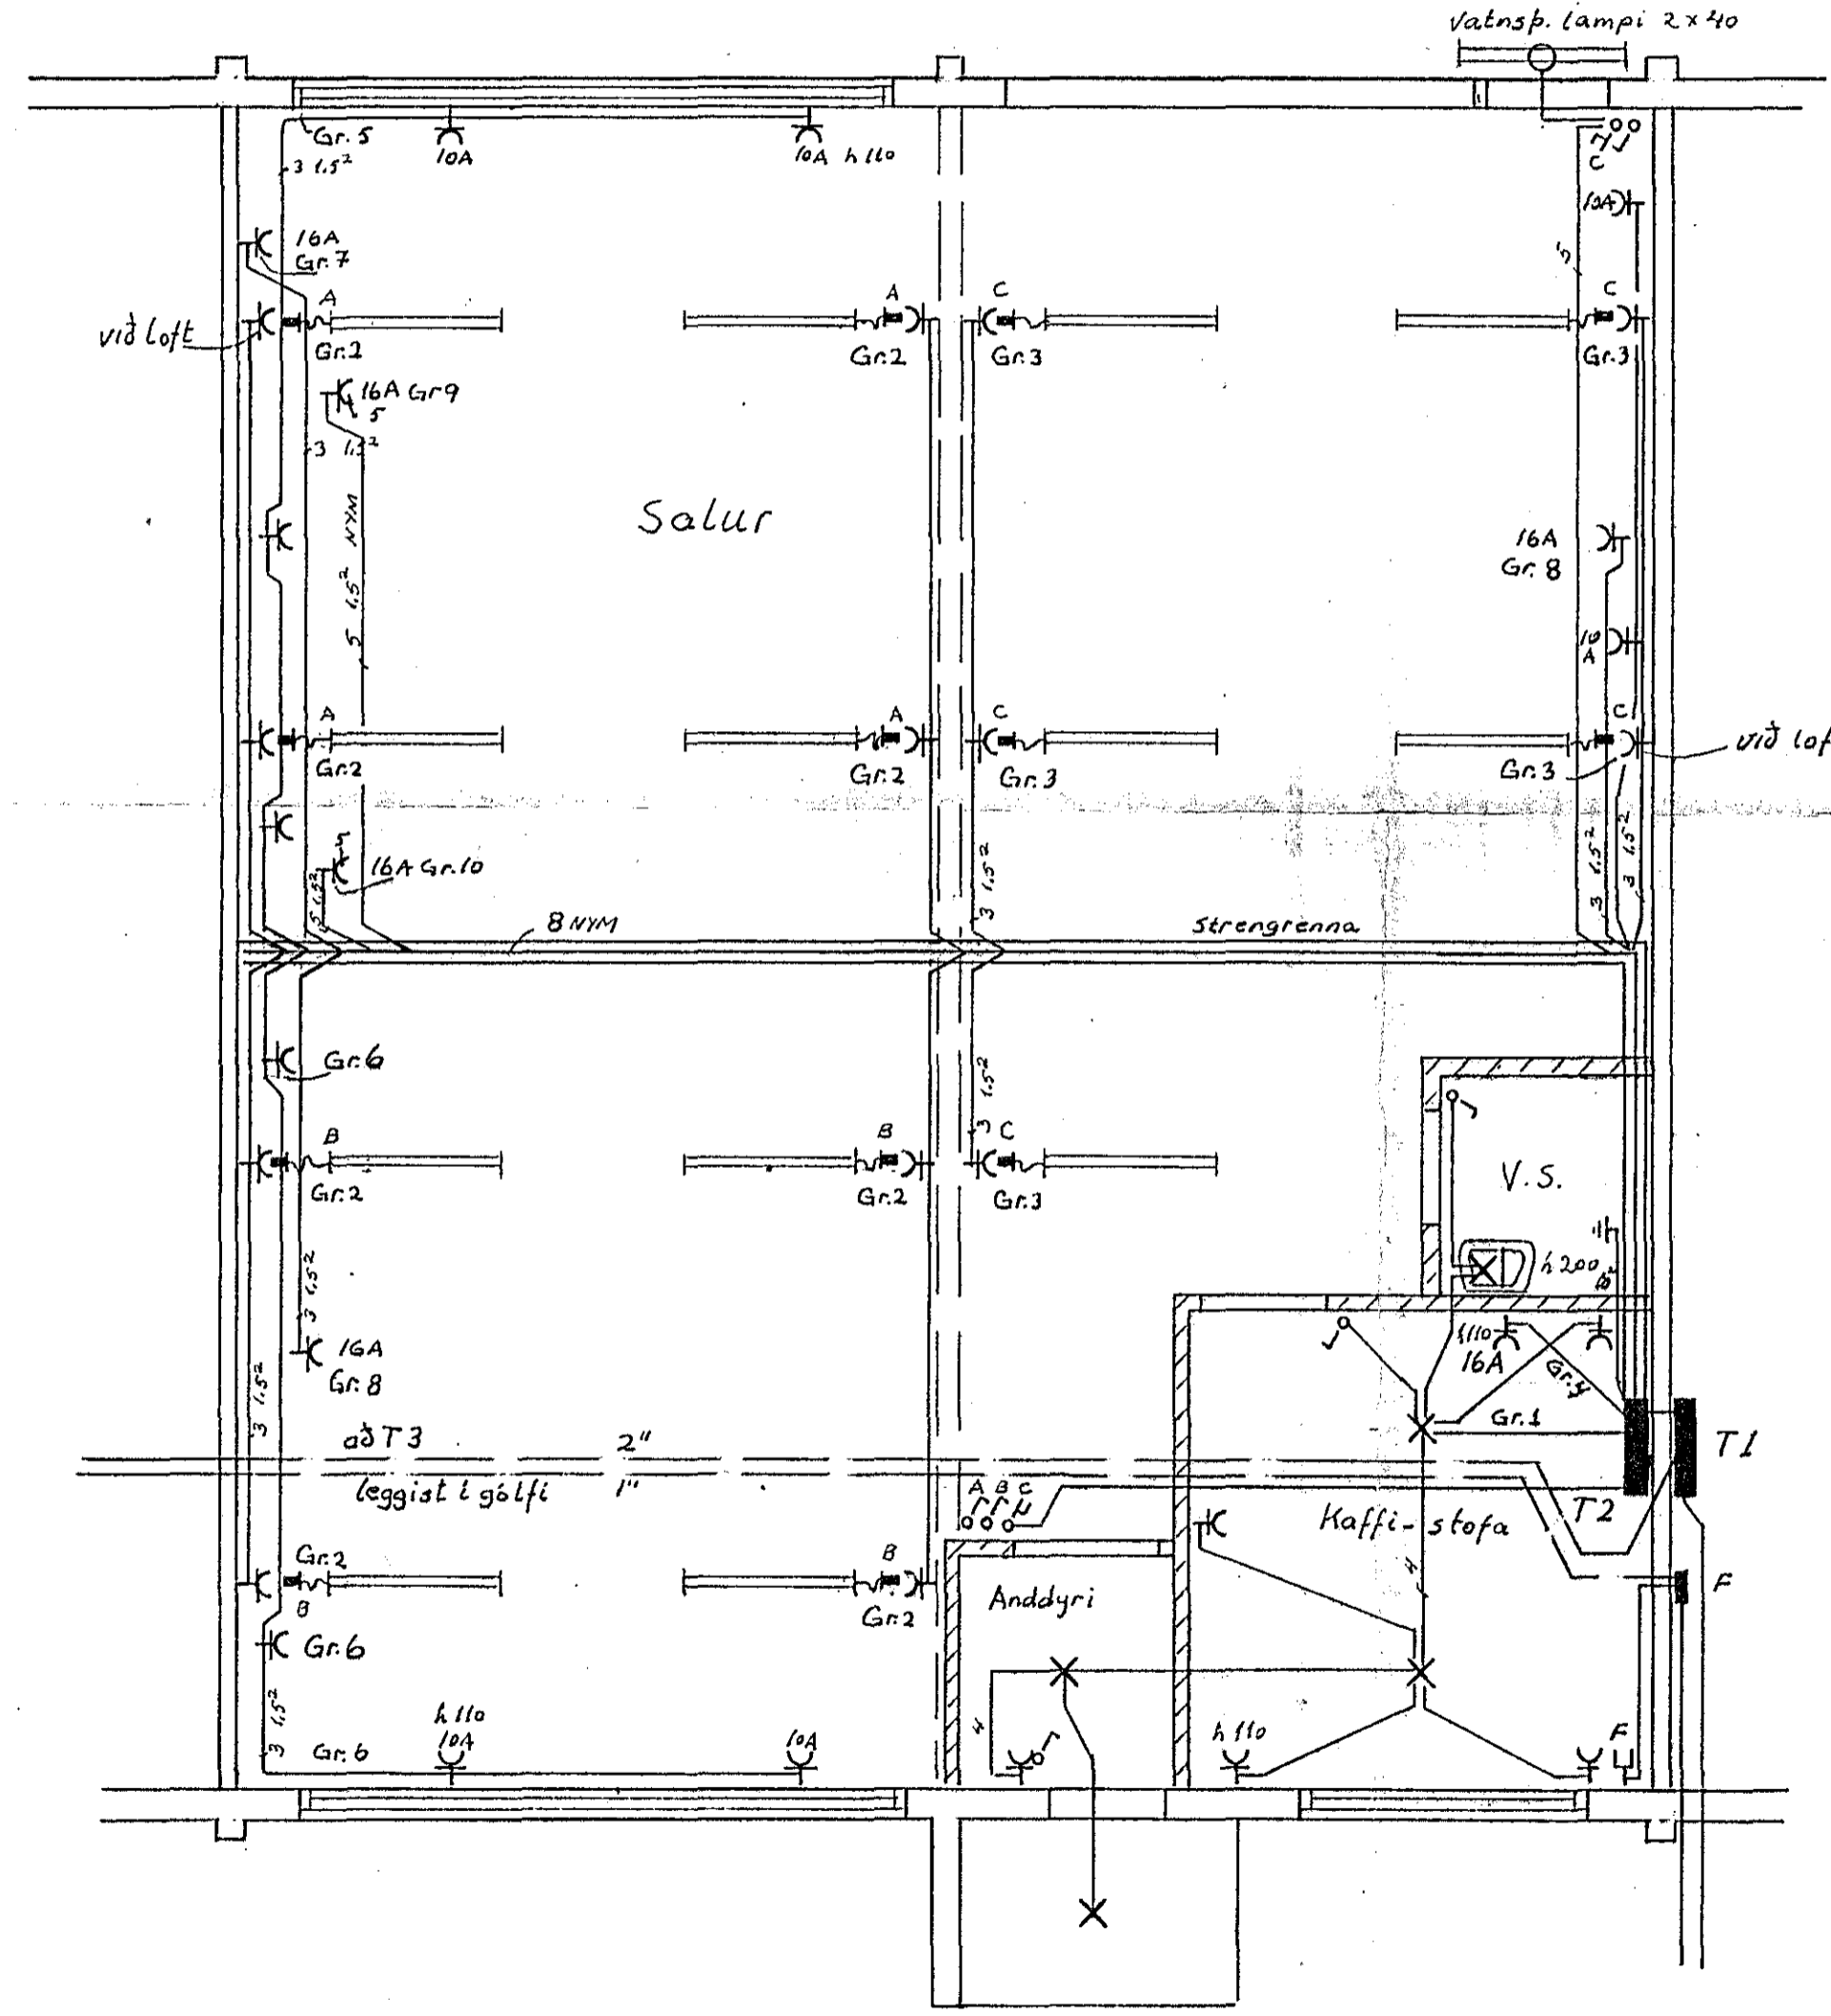

Skýringar:  
 Málstraumur rofa sé 10A  
 ———— tengla sé 10A } Nema annars sé getið  
 Rafpl. plaststrengir  
 Rafpl. rör 3/8", við 1.5"  
 Rafmagnstafla sé nr. 114 J.P.B.  
 Hæð á tenglum sé 110 cm (nema annars sé getið)

Húsvéita nr. 458 Teikning nr. 2094  
 Samþykkt þ. 9. 11. 1982  
 f.h. RAÐVEITU HAFNARFJÁRDAR  
 Eftirlitsmaður rafhlagna

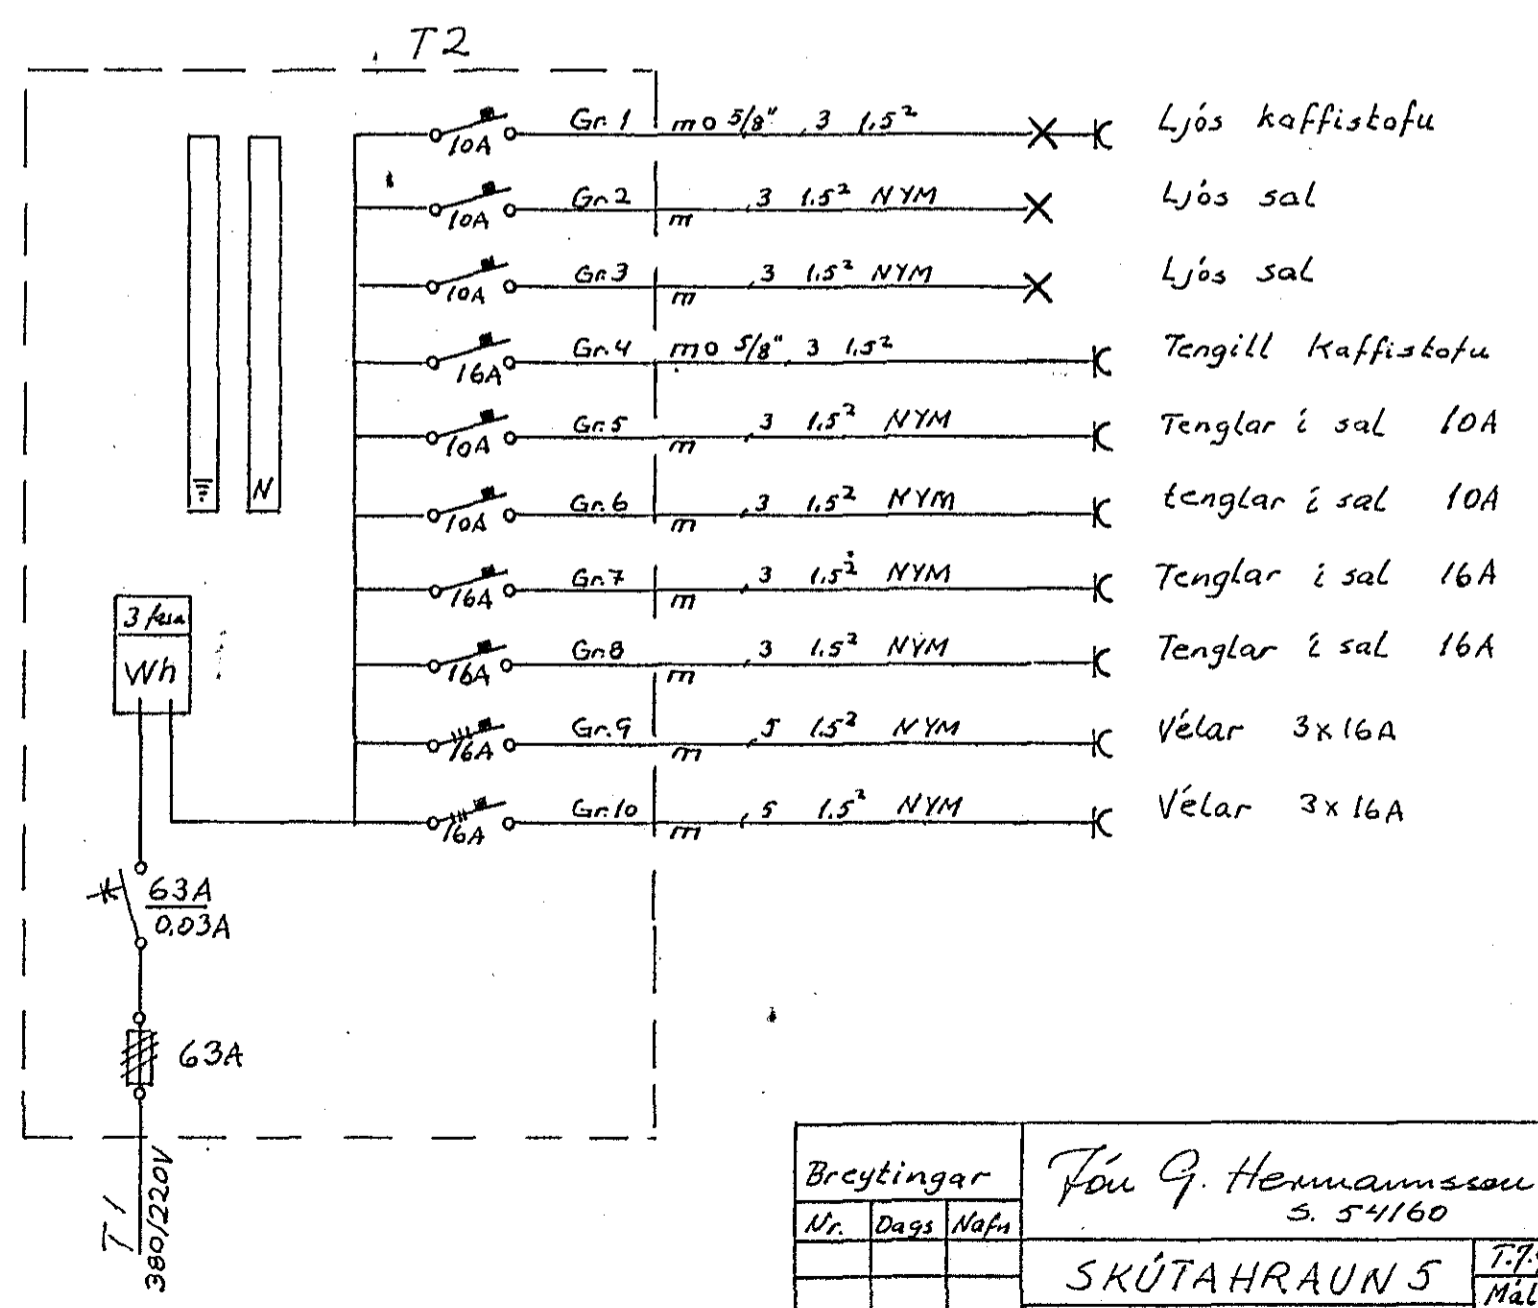

| Breytingar |      |      | Fou G. Henningsson         |                        |
|------------|------|------|----------------------------|------------------------|
| Nr.        | Dags | Nafn | S. 54160                   |                        |
|            |      |      | SKÚTAHRAUN 5               | T. 7. 9. 11. 1985      |
|            |      |      | Rafhlagn, afstæðum þversk. | Mál 1:50, 1:100, 1:500 |
|            |      |      |                            | Blad 1 af              |
|            |      |      |                            | April 1982             |