
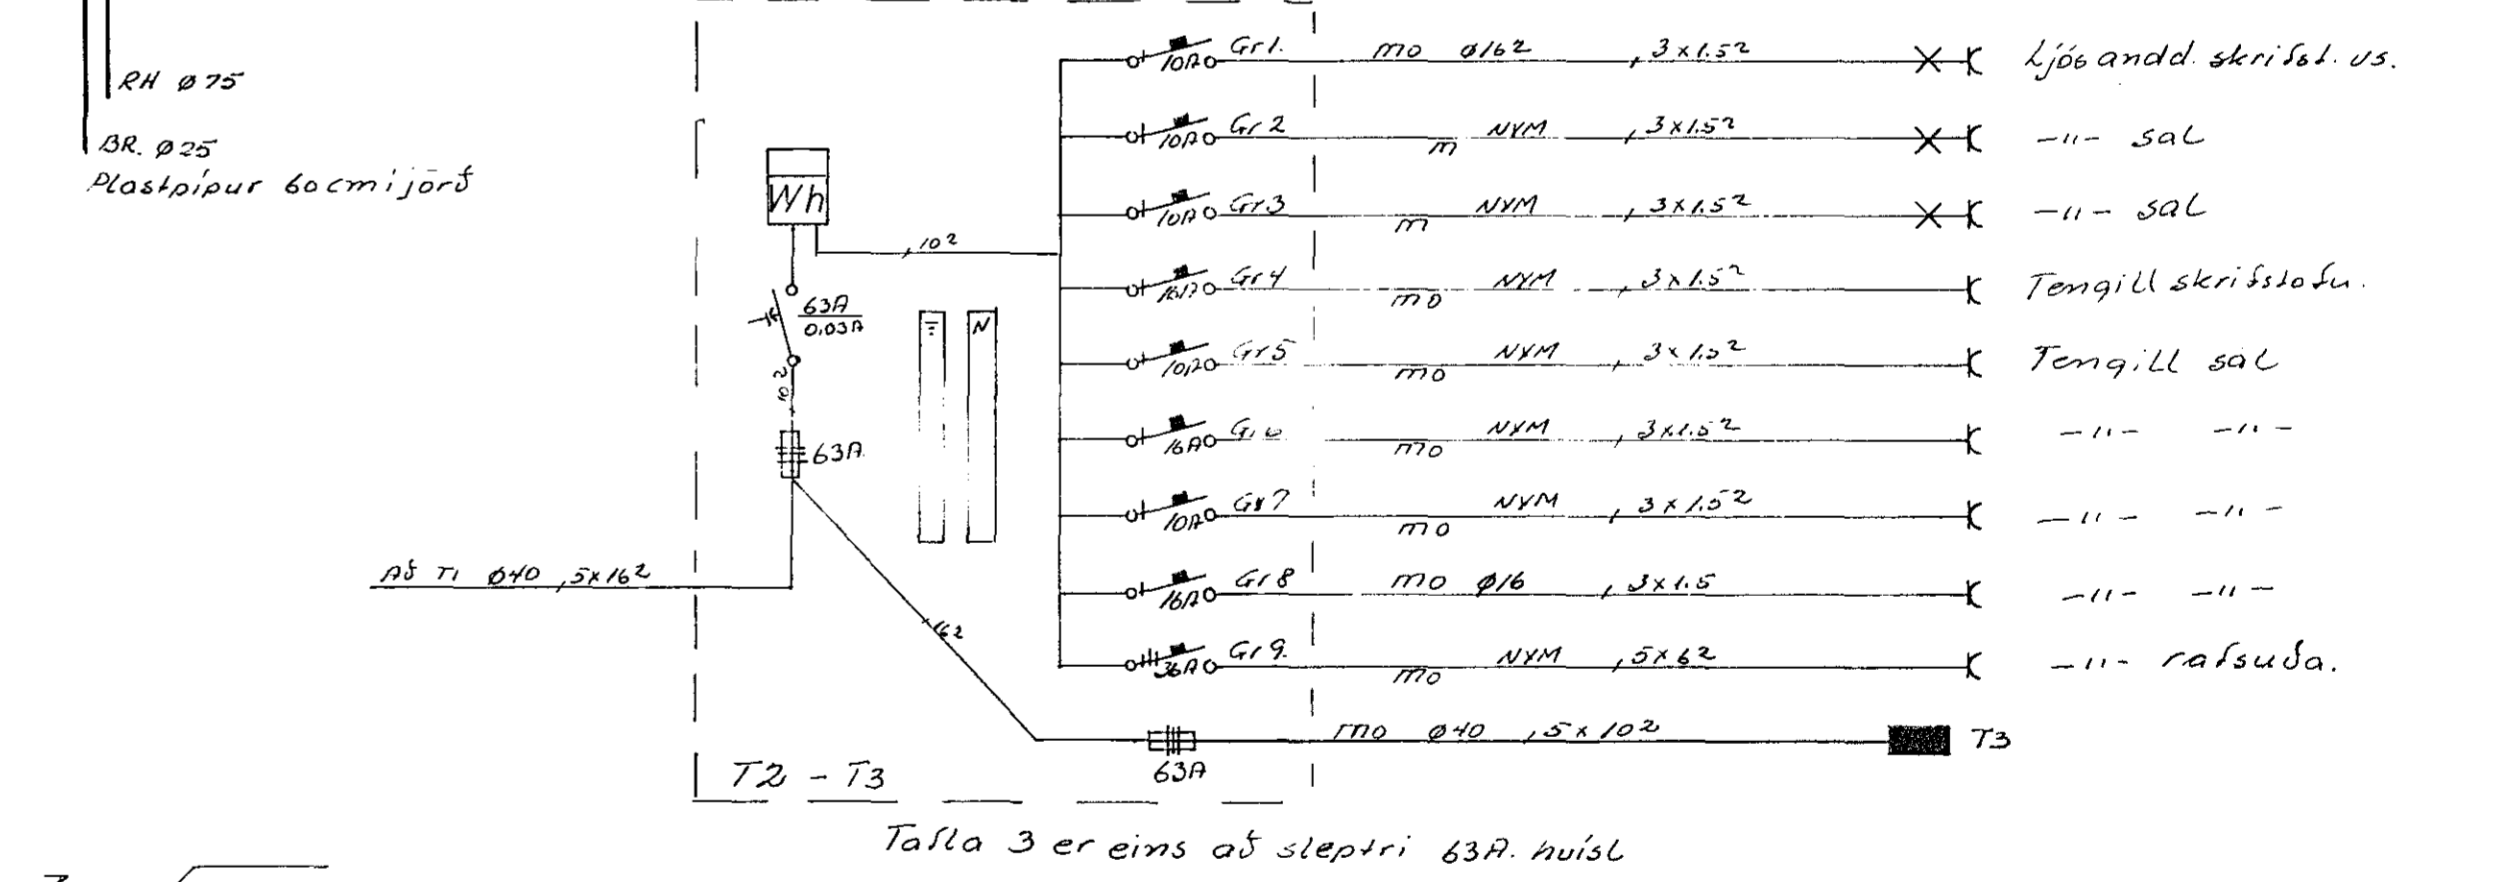
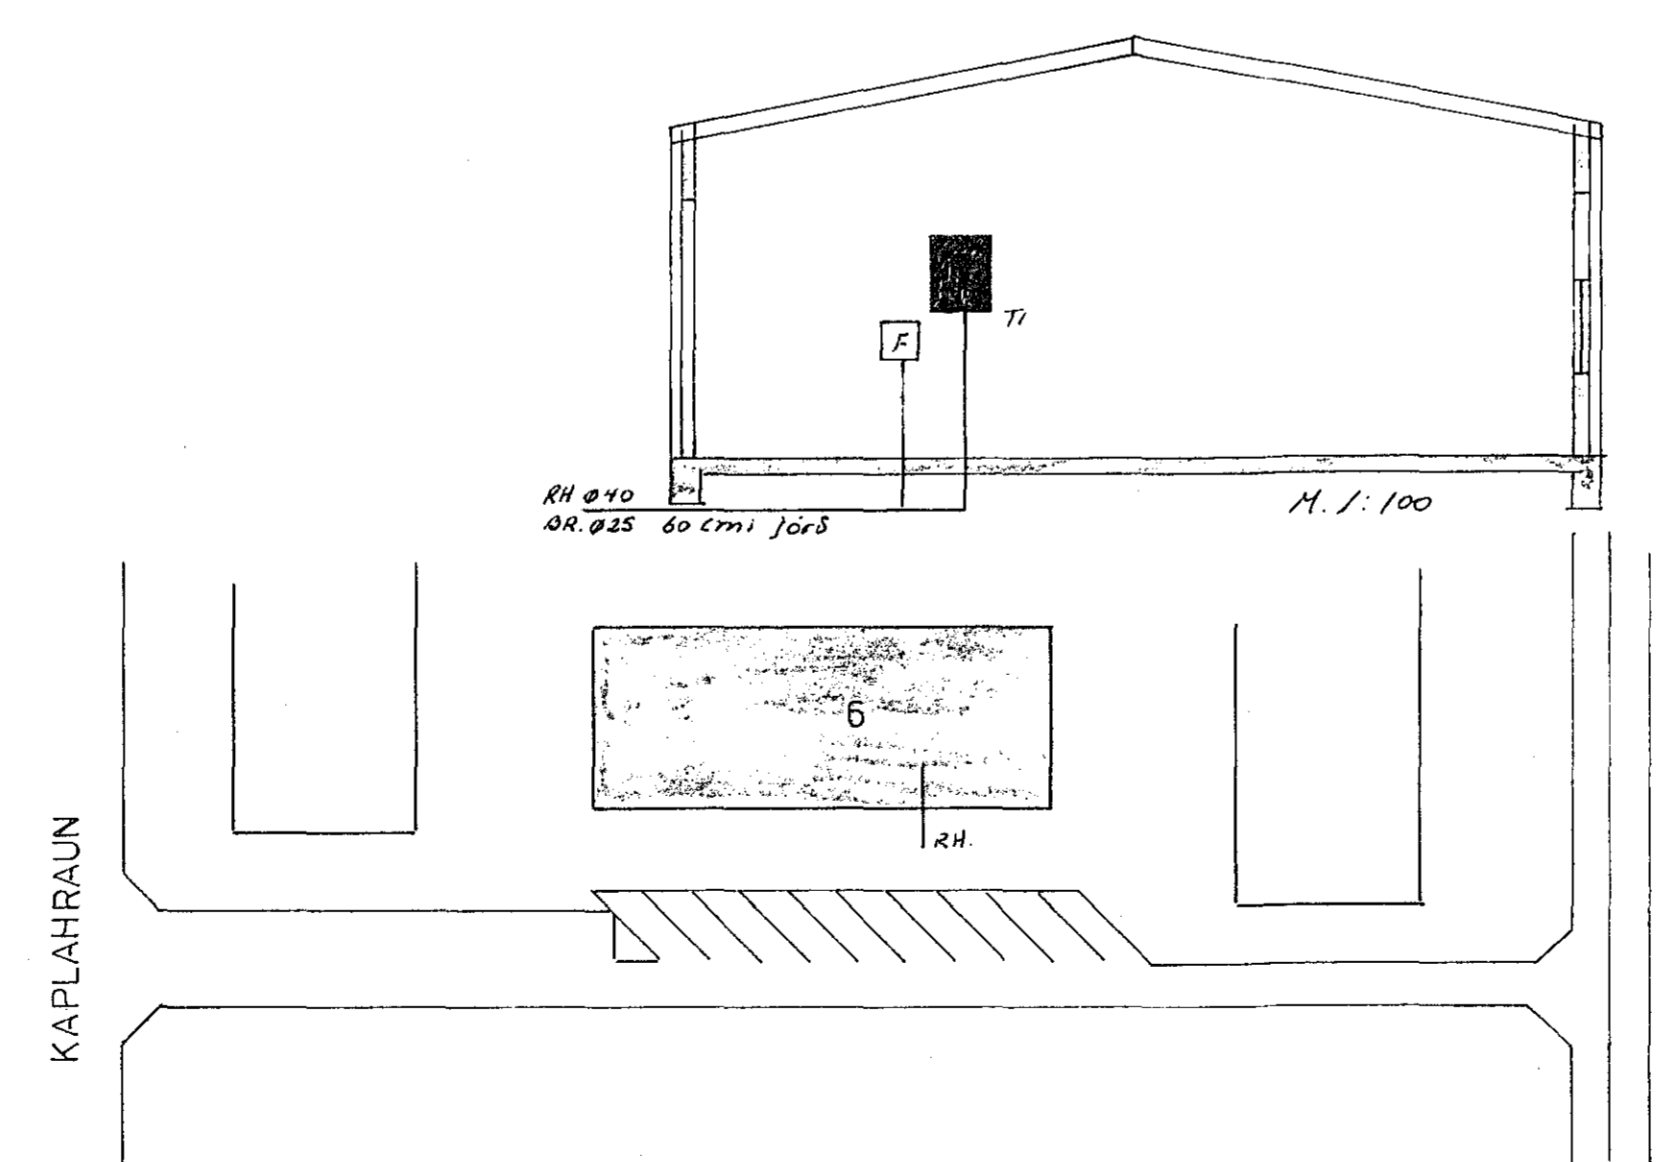
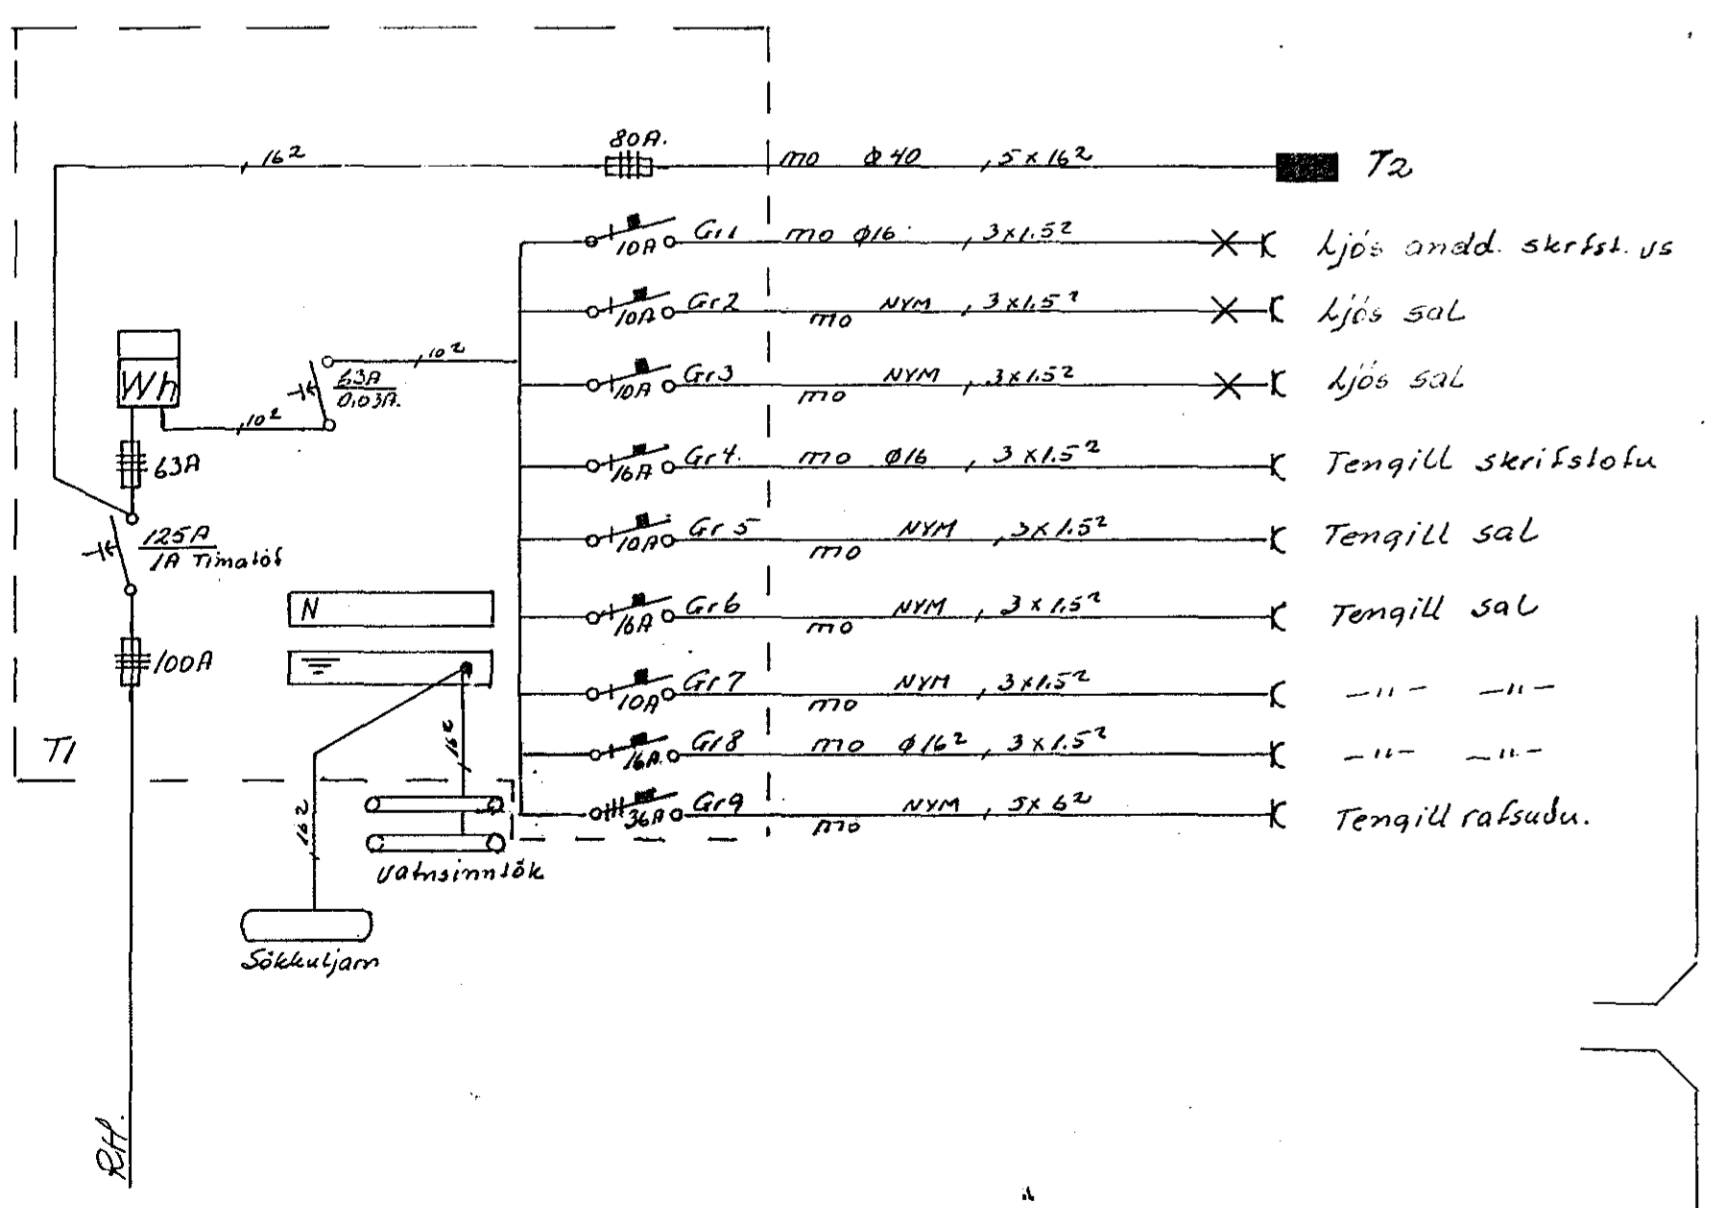


Innsk. númer 17.11. 1983  
 Filbert Kristjánsson

Húsvélti nr. 2943 Teikning nr. 2214  
 Samþykkt þ. 28.11. 1985  
 E. H. KÆRVEITU MATNARFJARDAR  
 Eftirlitshósti rannsókn

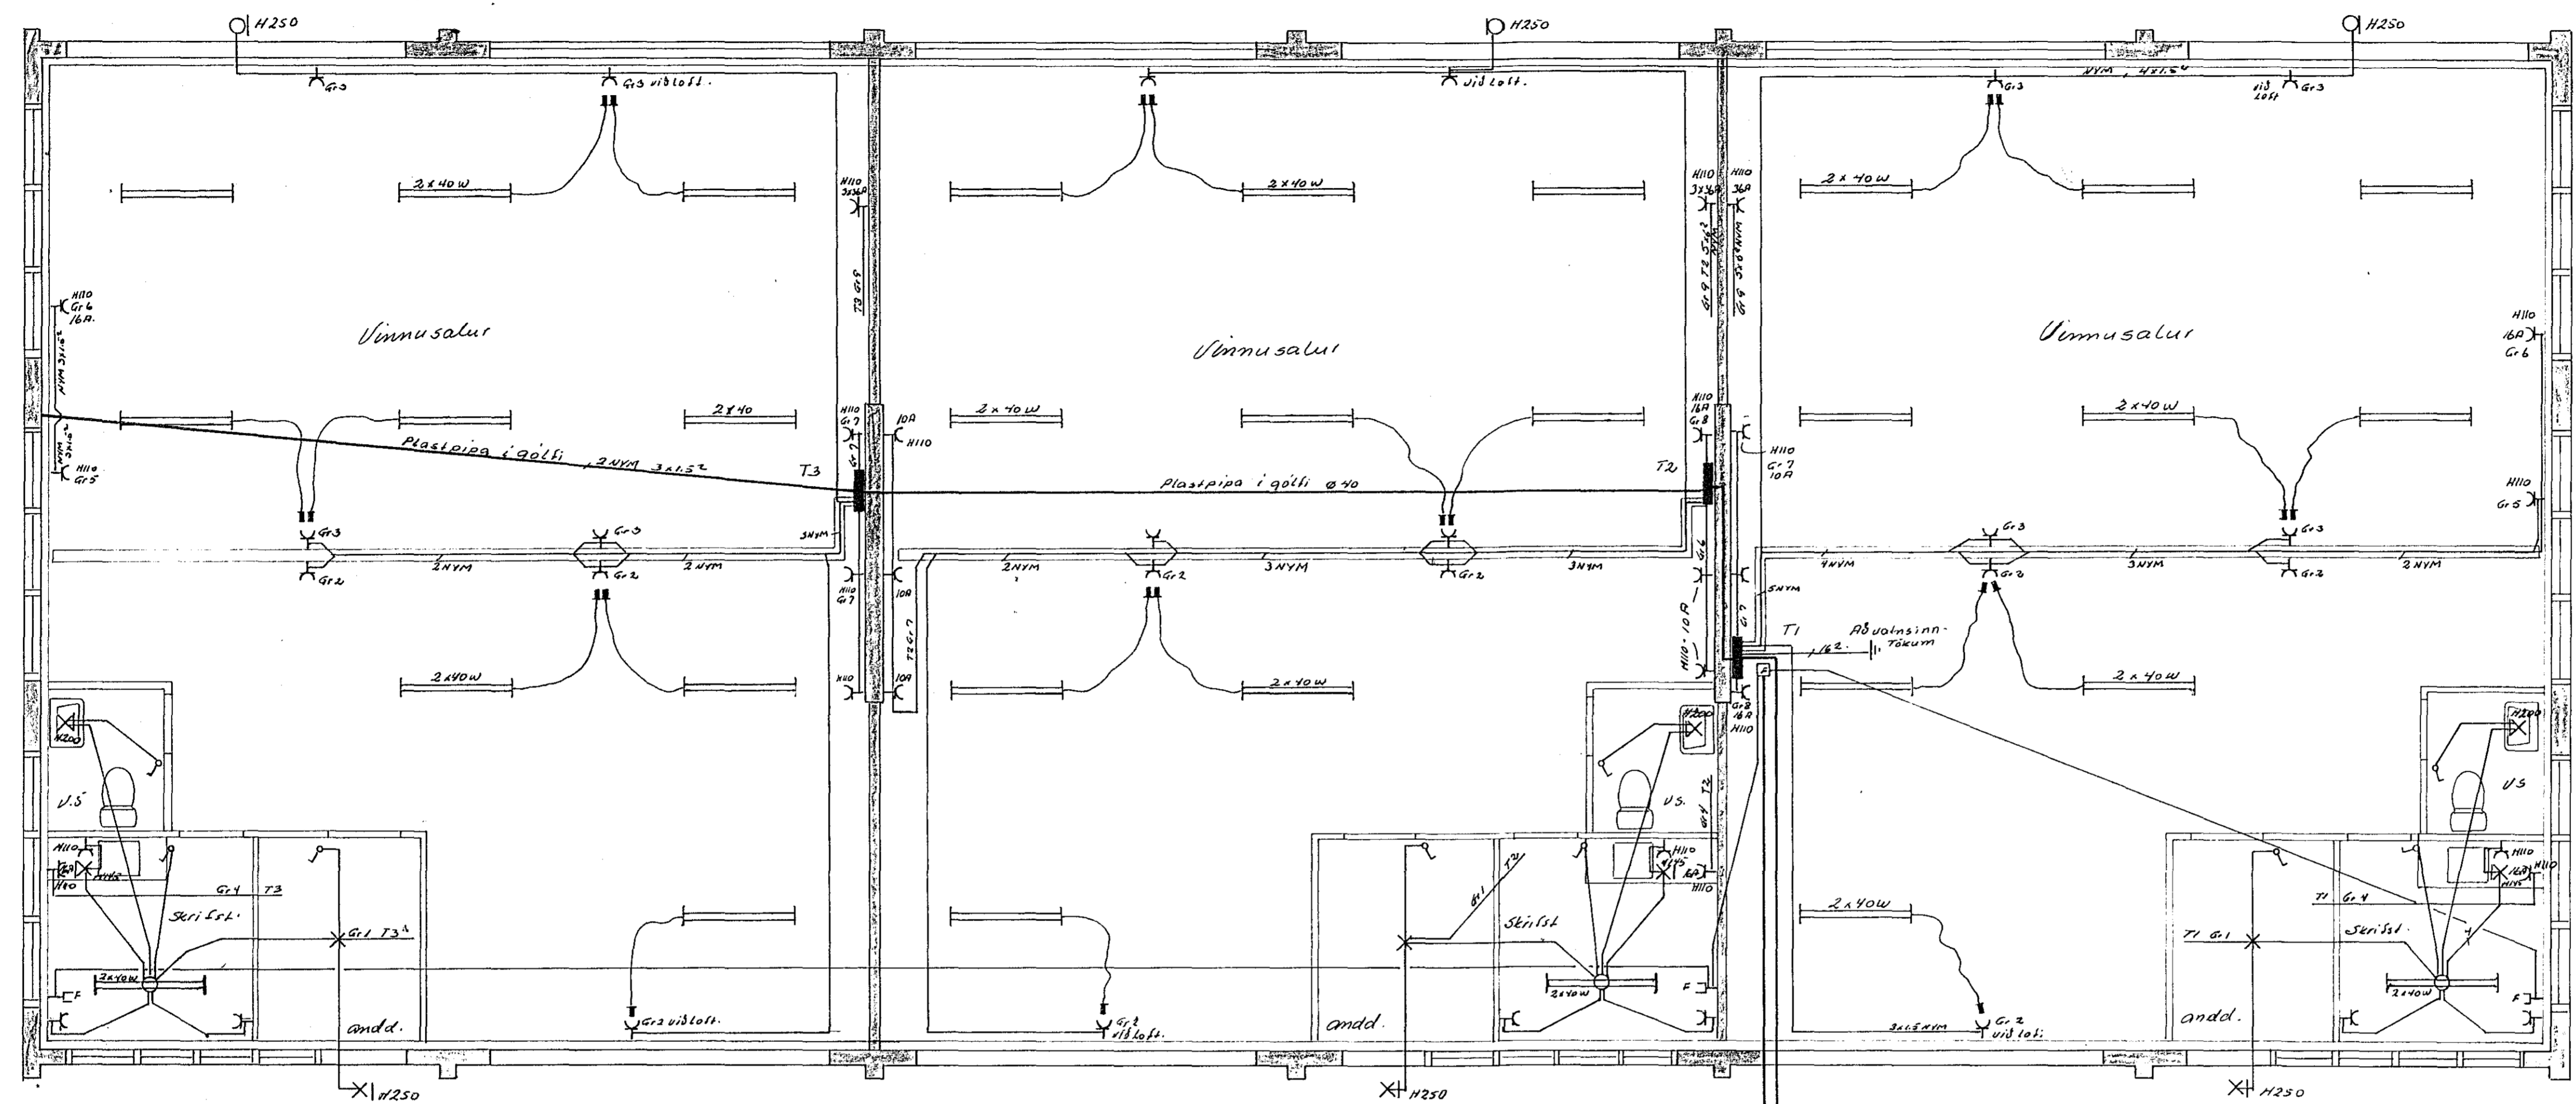

AFSTÖÐUMYND  
 1: 500

Skýringar  
 Malstraumur rofa og tengla sé 10A) nema  
 lagið NYM 3x1.5 samars sé gólið.  
 Töllu séu frá J.B.P. eða samsvarendi.  
 Binda skal saman höfð og kallvatn til spennuþjöfnunar.  
 Binda skal í sökkuljárn.

2214

NR.	BREYTING	DAGS	BR.
<b>KAPLAHRAUN 6</b>			
RAFLÖGN		HANNAÐ	28
		TEIKNAD	28
		DAGS	10 83
		BLAD	1 AF 2
		KYARDI	1: 50
		VERK NR.	065