

**OFNASKRÁ**



OFN NR.	AFKÖST KCAL/H	OFNAR-FUNAFNAR ΔT=40°C	STÓTAR	LOKAR
1	970	LF 58,5 - 150	C-D	HEIMETER (K)
2	530	LF 58,5 - 80	C-D	"- (D)
3	600	L 58,5 - 150	C-D	"- (K)
4	910	LF 58,5 - 150	C-D	"- (K)
5	420	LF 58,5 - 80	A-B	"- (K)
6	620	L 58,5 - 150	C-D	"- (K)
7	320	L 58,5 - 80	C-D	"- (K)
8	500	LF 58,5 - 90	C-D	"- (D)
9.1	700	LF 32,5/2-100	A-B	"- (D)
9.2	1400	LF 32,5/2-200	C-D	"- (K)
10	1790	LF 58,5/2-220	C-D	"- (D)

SAMT. 8760

ALLIR OFNAR SKULU TENGDIR MEÐ STILLITÉ  
OG Á HEIM SKAL VERA LOFTSKRÚFA.

SJÁ AÐRAR SKÝRINGAR Á BL. 303.

AFSTÖÐUMYND 1:500

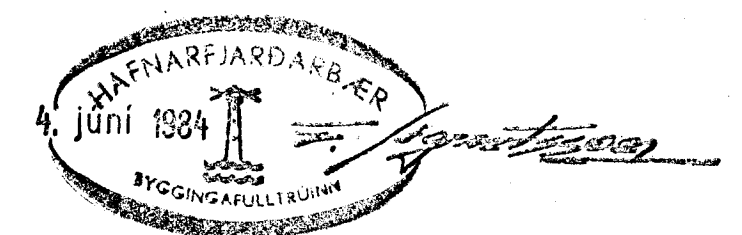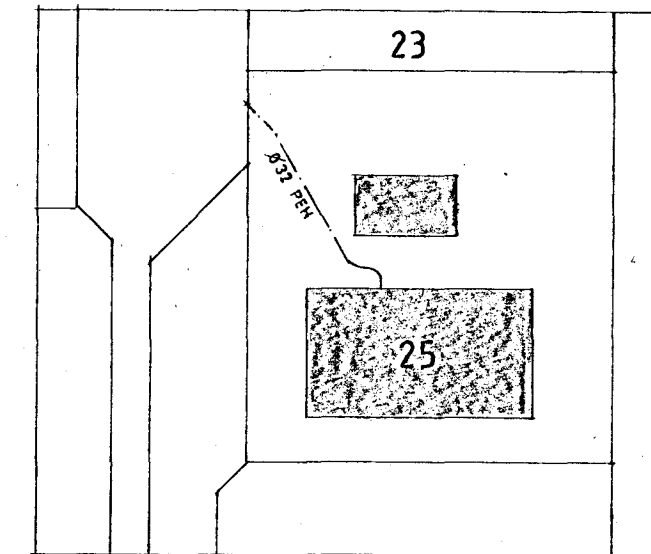

<b>MÁT - HÚS</b> 107		<b>Haukur Margeirsson</b> byggingaverkfr. Verkfræðistofa - Bergstaðastræti 13 101 Reykjavík - Sími 19940	
VERKHEITI	EINIBERG 25, HF.	VERKNR	8426-001
HEITI TEKNI	VATNS OG HITLAGNIR GRUNNMYND OFNASKRÁ	DAGS	AP 84
		HAFNAÐ	HM
		TEKNI	HM
		KVARDI	1:50
		TEKNI NR	301