



GRUNNMYND EFRIHÆÐAR 1:50

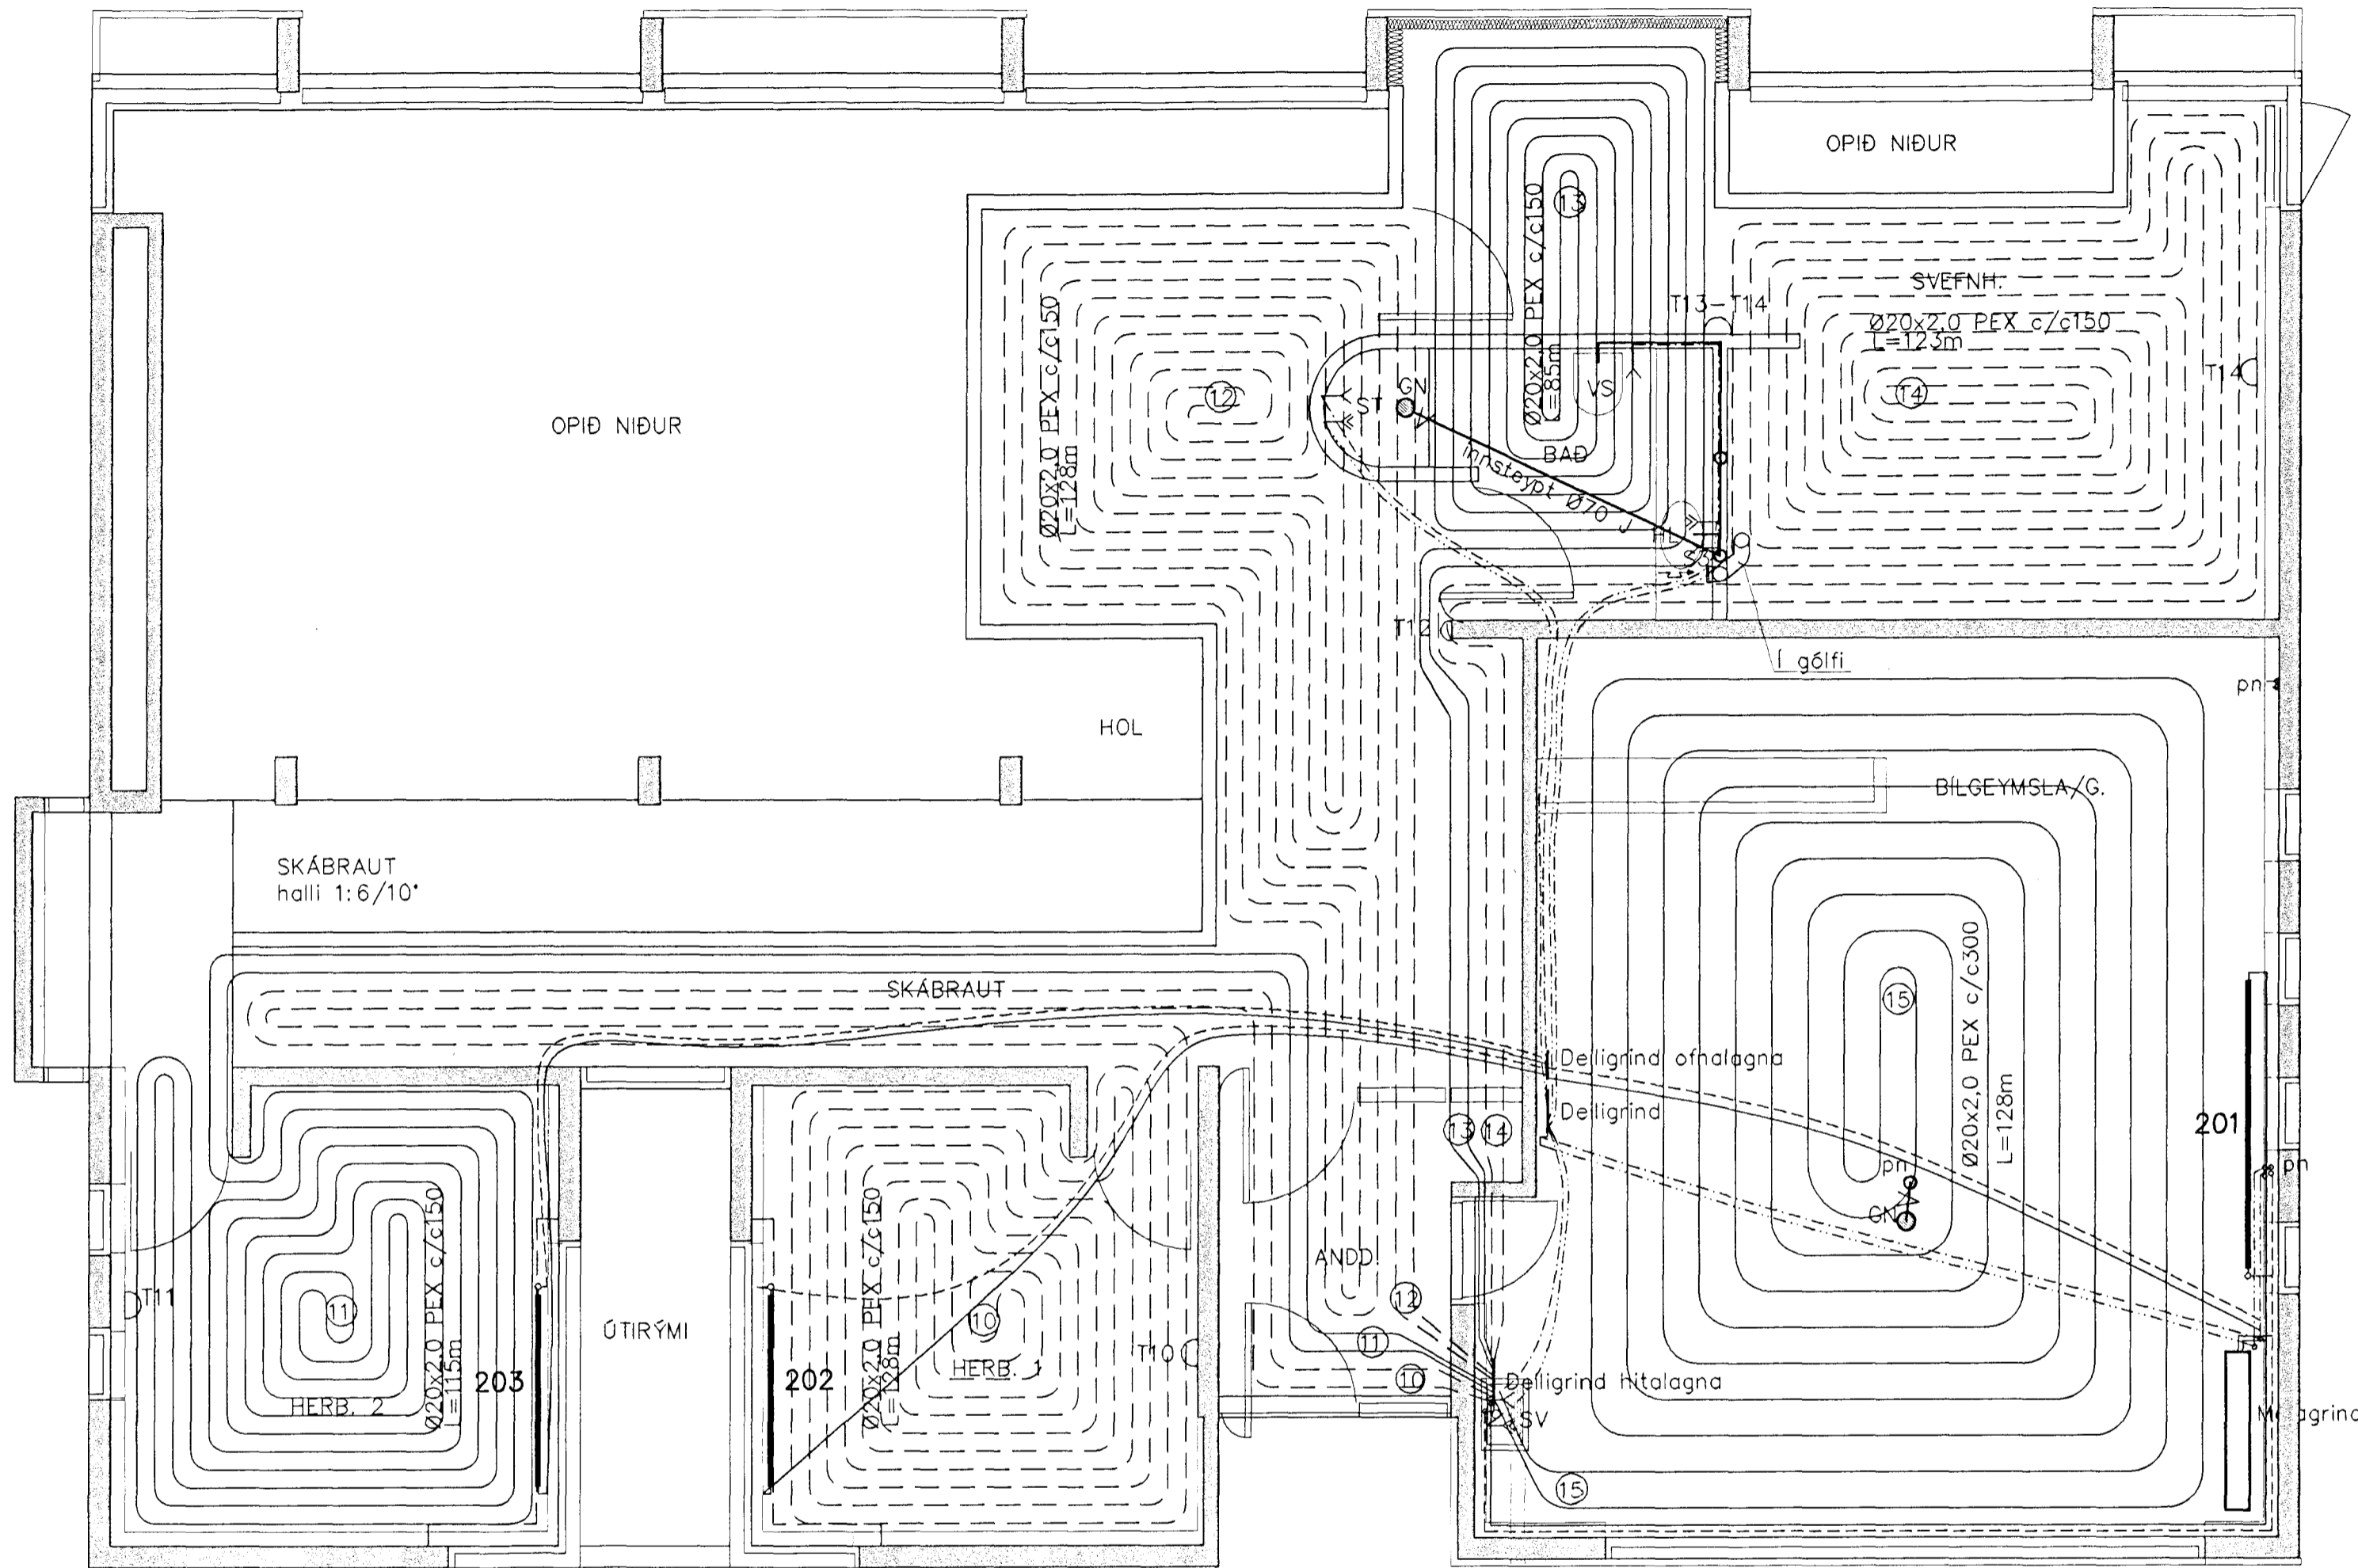

Snið í gólfhita 1:10 Efrihæð

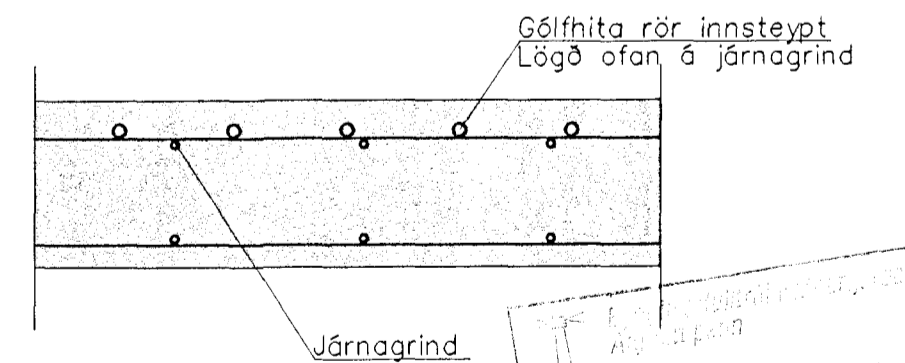

Ofnaskrá

Ofnar skulu vera vottaðir af Rannsóknarstofnun Byggingariðnaðarins samkvæmt ÍST EN-442
Ofnar delta-t=40°C Ofnatengi = 10mm

númer	rými	wött/klst	ofnategund	ofnlöki	stíllitla
201	Bílskúr	2160	P21-500,L=2400	FJVR-10	
202	Herbergi 1	1010	P11-500,L=1600	FJVR-10	
203	Herbergi 2	1010	P11-500,L=1600	FJVR-10	
Samtals wött/klst		3180			

Afköst gólfhita:

Slaufa Nr: 10	120m	1444 wött/klst
Slaufa Nr: 11	115m	1384 wött/klst
Slaufa Nr: 12	128m	1540 wött/klst
Slaufa Nr: 13	85m	1023 wött/klst
Slaufa Nr: 14	123m	1480 wött/klst
Slaufa Nr: 15	128m	1230 wött/klst
Samtals	699m	8101 wött/klst

*1 Gólfhiti í bílskúr, rör í rör að ofnum og dælligrindum, rörasverleiki í Ø20

Breytingar			ERLUÁS 35, HAFNARFJ.	
Nr.	Dags.	Nafn		
1	12.09.02	BK	Verkfræðistofa Þráinn & Benedikt Laugavegi 178, 105 Rvk. Sími: 553 1770, 568 7775, Fax: 568-7701 Netfang: post@islandia.is	H Þ K T H S S M 1:60 Nr. P201 Dags. feb. '02 090638-4839
			Hiti, vatn, fráfrennsli og loftr. efrihæð	

13 SEPT. 2002