



Skrá yfir gólfhitalagnir – II. hæð

Herbergi	Reiknað hitatap. [w]	nr.	Pípur stærð [mm]	Pípur bil [mm]	lengd [m]	Nauðsynl. afköst [w]	dt-slöngur max. [°C]	Rennsli max. [l/sek]	Stillitölur
Borðst, dagst. & stofa	5.900	09	20x2,0	200	75	5.900			
		10	20x2,0	200	84				
		11	20x2,0	200	78				
		12	20x2,0	200	78				
		13	20x2,0	200	75				
Svefnh.	1.130	14	20x2,0	200	93	1130			
Bað	410	15	20x2,0	100/200	73	410			
Vinnuh.	800	16	20x2,0	150	69	800			
Svefnh.	780	17	20x2,0	200	78	780			
Svefnh.	1370	18	20x2,0	100/200	74	1.370			
Bílskúr	3400	19	20x2,0	200	57	2000			
		20	20x2,0	200	76				

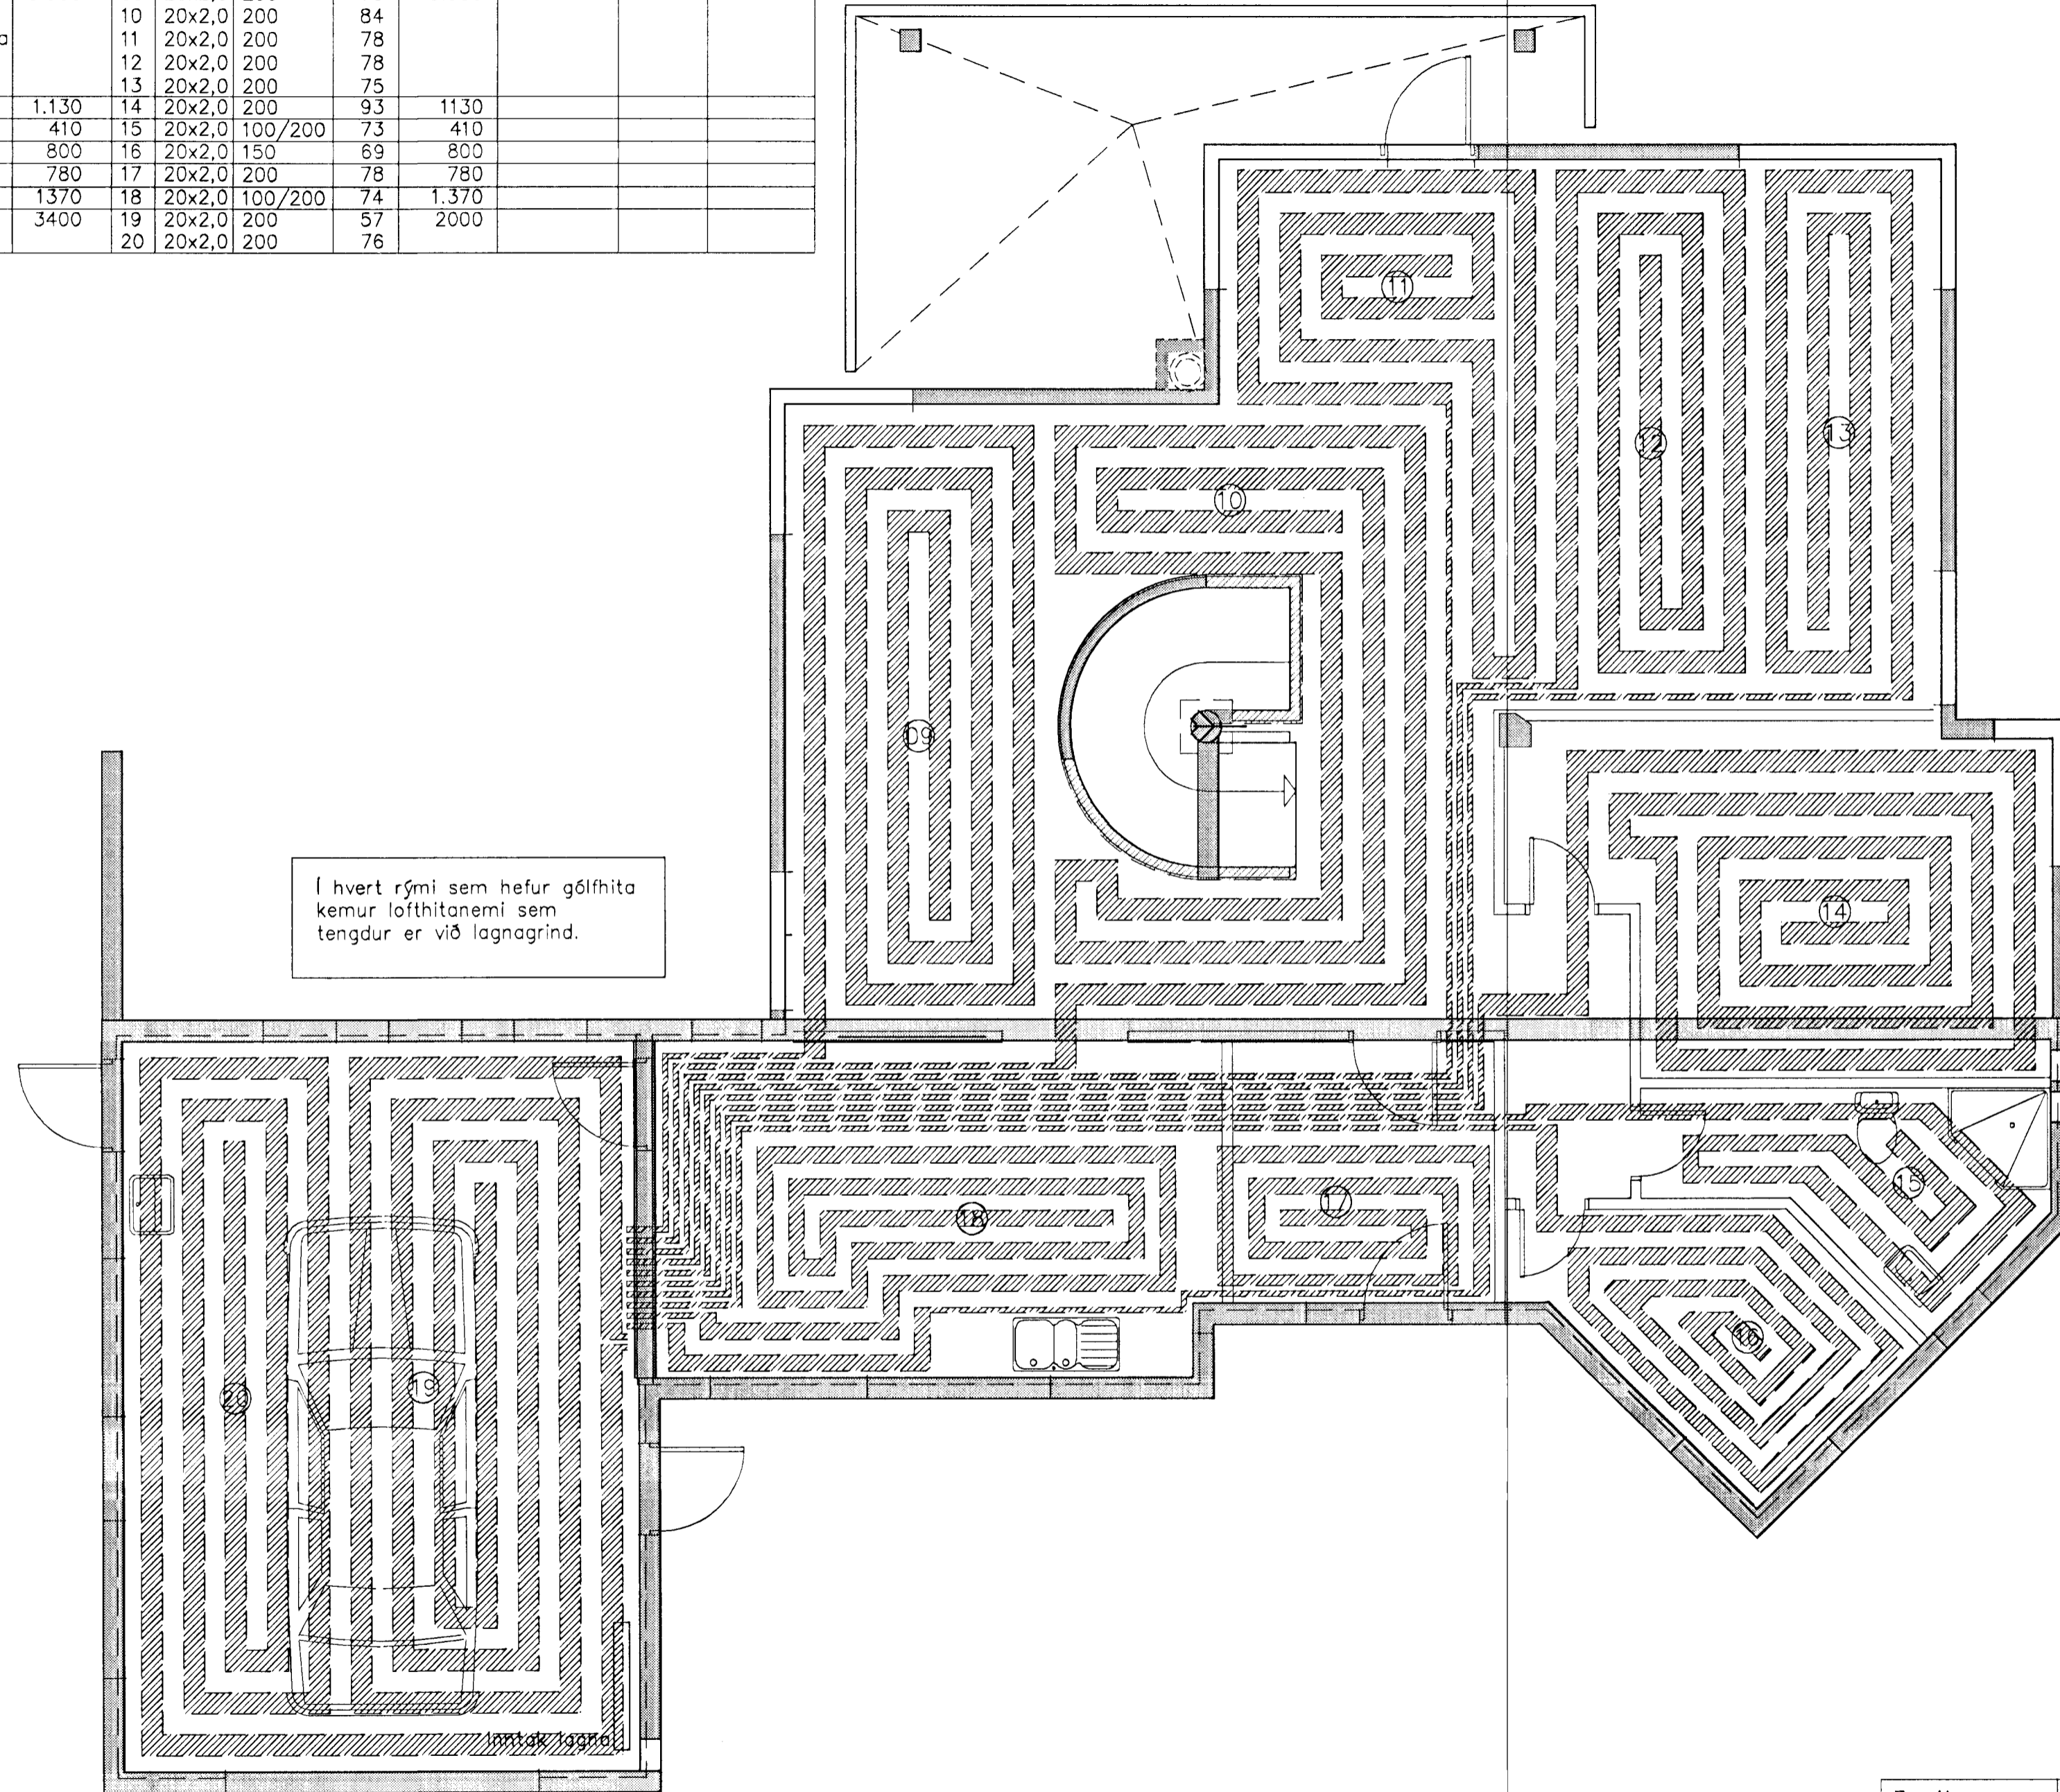


Í hvert rými sem hefur gólfhita kemur lofthanemi sem tengdur er við lagnagrind.


Snið í gólfhitalögn á jarðhæð og í bílskúr Mkv. 1:10

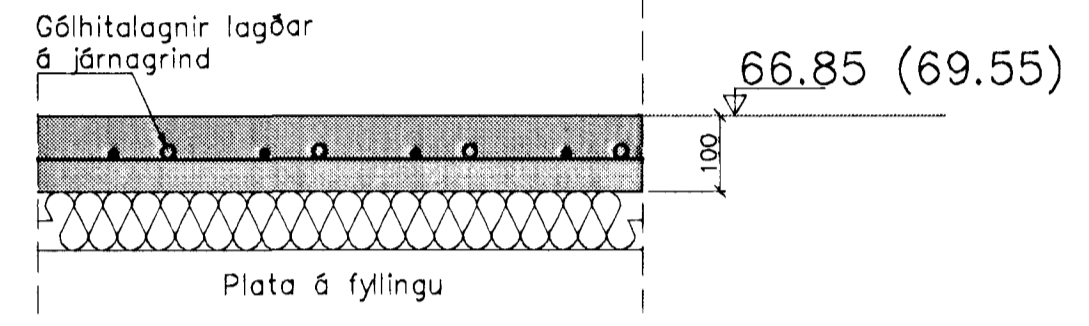

Snið í gólfhitalögn á efrihæð Mkv. 1:10

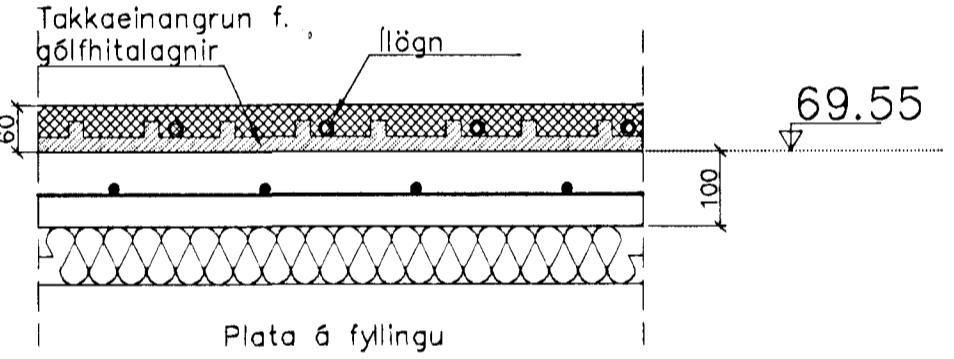

Snið í gólfhitalögn á efrihæð Mkv. 1:10

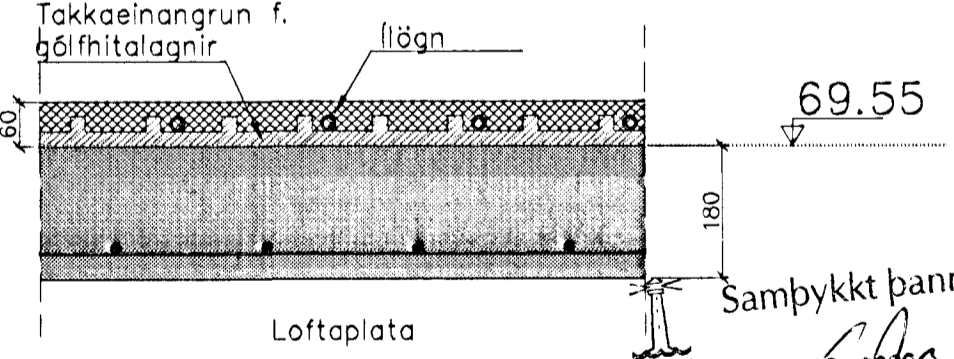

Samþykkt þann 14. DES. 2000
Byggingafrúlrúmi í Hafnarfirði
F.h. Sigurbjartur Halldórsson



Breytingar:	E:
B:	D:
A:	C:

Gauksás 53, Hafnarfirði
Hreinlætislagir og hitalagnir
Gólfhitalagnir f. 1. hæð