


OFNASKRÁ $\Delta t = 40^\circ\text{C}$						
OFN NR.	AFL W	Stöður	HBD mm	LENGD mm	Gerð	Hlutfjórðingar
1	1560	Bílag.	600	1000	Panel	
2	1160	Geymsla	600	1000	Panel	
3	1360	Herb.	600	1200	Panel	
4	890	Herb.	600	1000	Panel	
5	960	Herbergi	600	1000	Panel	
6	790	Bað	600	700	Panel	
7	920	Þvottur	600	800	Panel	
8	1590	Hjón	600	400	Panel	
9	1590	Stofa	300	1800	Panel	
10	1590	Stofa	300	1800	Panel	
11	1590	Stofa	300	1800	Panel	
12	1770	Stofa	300	2000	Panel	
13	1770	Stofa	300	2000	Panel	
14	680	Anddyri	600	600	Panel	
15	240	Salerni	600	400	Panel	
16	1770	Alrými	300	2000	Panel	
17	1560	Bílag.	600	1000	Panel	

Áður en ofnæpintun er staðfest skal yfirfara ofnæsterörir á byggingastað.

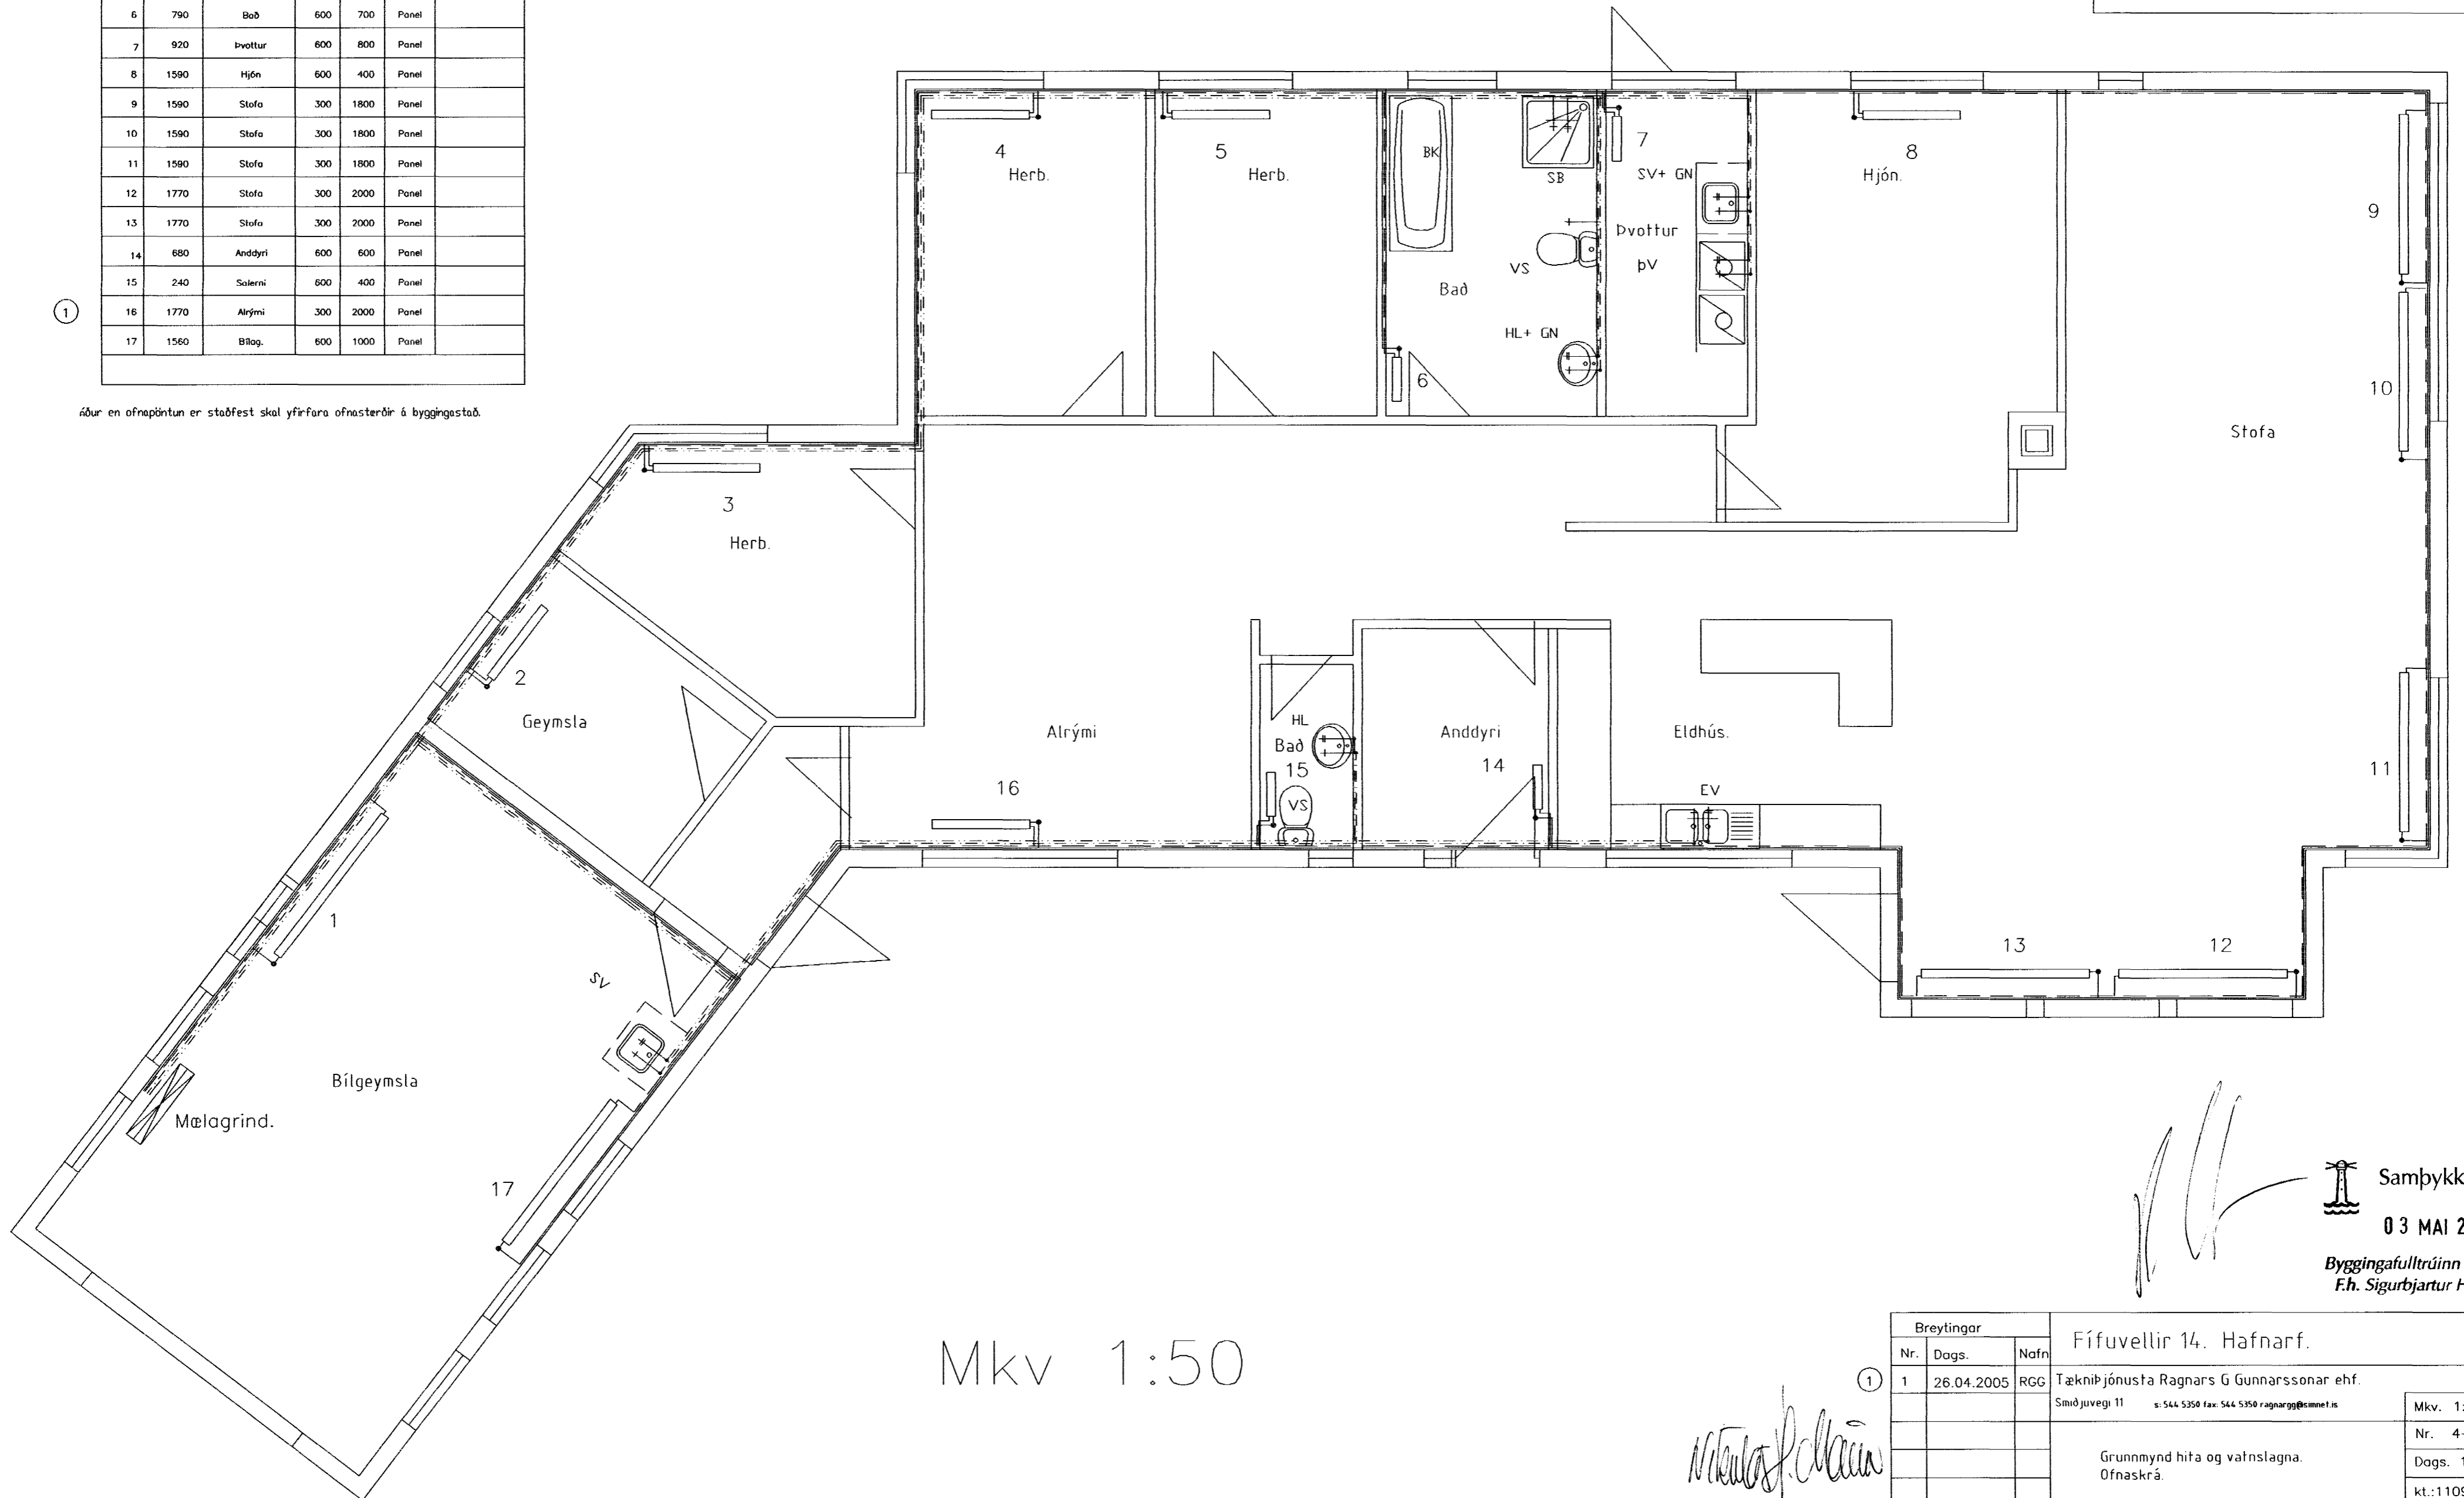

Mkv 1:50

[Handwritten signature]

Samþykkt þann
03 MAI 2005

Byggingafulltrúinn í Hafnarfirði
F.h. Sigurbjartur Halldórsson

Breytingar			Fífuvellir 14. Hafnarf.	
Nr.	Dags.	Nafn		
1	26.04.2005	RGG	Tæknipjónusta Ragnars G. Gunnarssonar ehf. Smíðjuvegi 11 s: 544 5350 fax: 544 5350 ragnargg@simnet.is	
				Mkv. 1:50
				Nr. 4-1
				Dags. 12.4.2005
				kt.:110947-2839

[Handwritten signature]

Grunnmynd hita og vatnslagna.
Ofnaskrá.