


Blásarasamslæða: York CS113 FCLP 8800 cfm, ca. 1 1/2" S.P.
 m/ 2 stk. mölloka spjaldlokum 62"x19 1/2"
 m/ 6 stk. 2"- síum, 20"x25", hreinsanl.
 m/ rafmótor, 5,5 hö og breytanl. reimskifum,
 m/ gúmmipúðum f. gölffestingu.

- 1 Frostöryggi, Honeywell T675A (3°C)
- 2 Blöndunarhitastillir, Honeywell T991A (10°C)

Blásari: York CS113 FCLP 8600 cfm, ca. 3/4" S.P.
 m/ rafmótor, 4 hö og breytanl. reimskifum
 m/ gúmmipúðum f. gölffestingu.

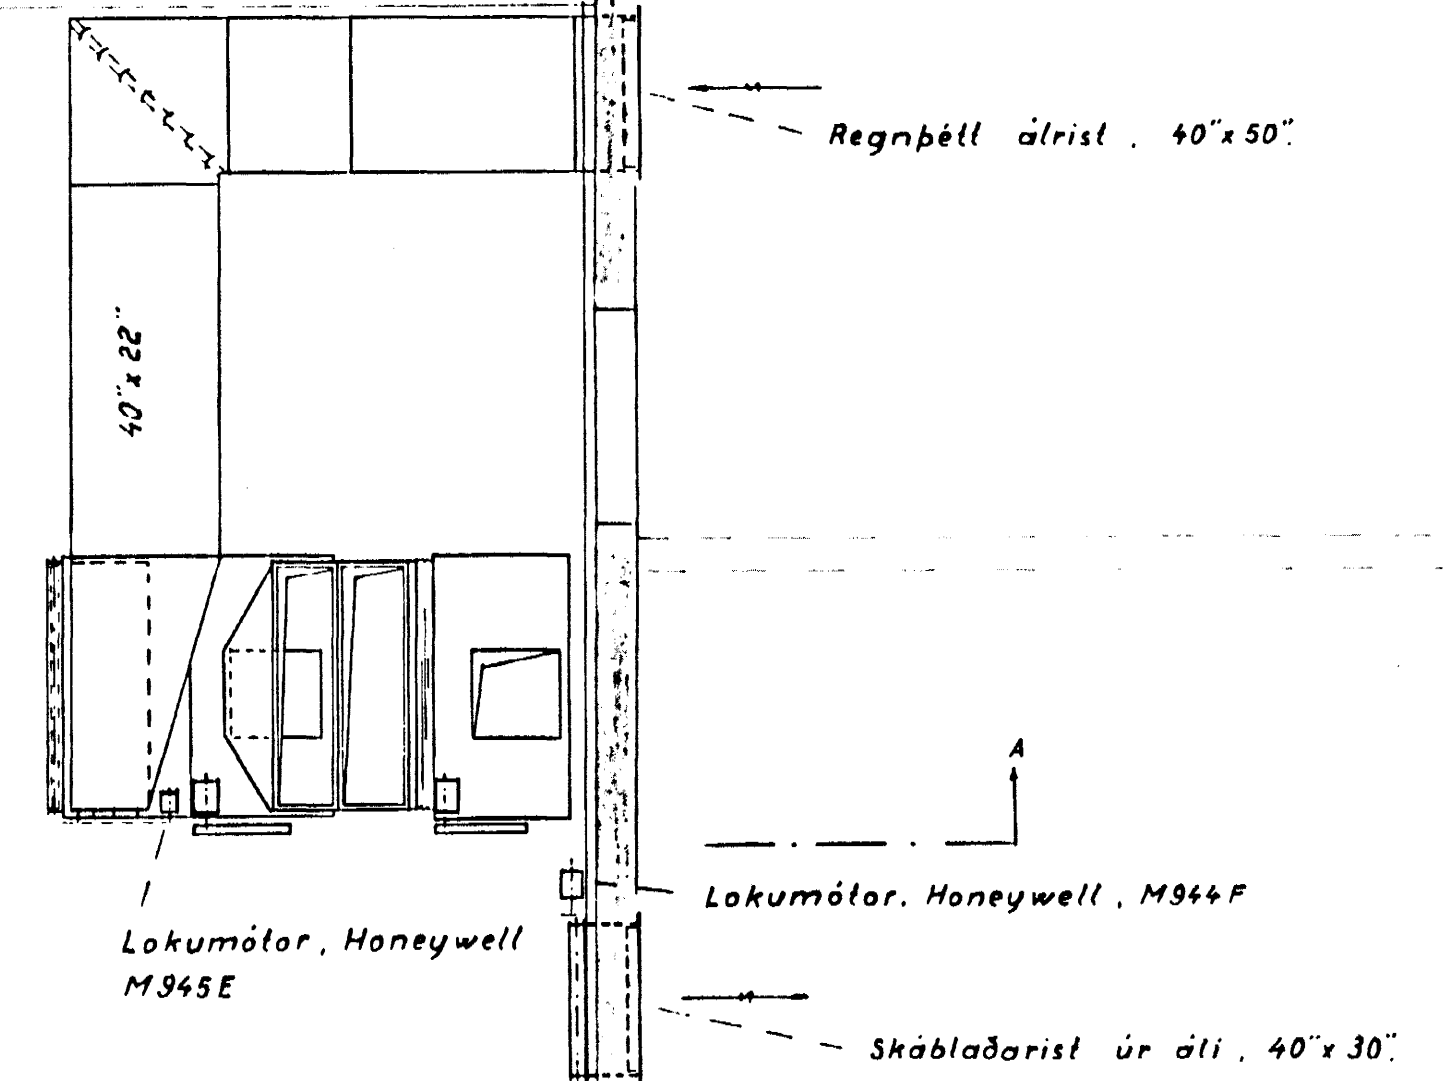

VINNUTEIKNING

04 JUN 2003

Byggingaálitun mannvirjar
 Algrunn þann
 21 JUNI 2004
 HÖ

[Signature]
 Kt. 110457-27/89

VERKFRÆDISTOFA GUDMUNDAR & KRISTJANS Laufmavégl 19	Mér. 11.74.24 1:50 Skr. 14.025
VÍÐISTADASKÖLI, HAFNARFIRDI GRUNNMYND KJALLARA Loftræsting	Deðba nr. TEIKNING NR. 3A-84