


- 1 Inntakslöki hitaveitu
- 2 Sía
- 4 Rennsismælir
- 5 Höfuðlöki hitakerfis
- 6 Þrýstimælir inntaksþrýstingur
- 7 Einstreymislöki
- 8 Þrýstijafnari
- 9 Hitamælir
- 10 Þrýstimælir hitakerfi
- 11 Höfuðlöki heitt neysluvatn
- 12 Hjónustulöki
- 13 Öryggislöki
- 14 Aftæming
- 20 Mótstöðulöki
- 21 Frárennsli
- 22 Inntakslöki vatnsveita
- 23 Tvístíllöki

NR.	NR.	Varma	Varma	Tenging	tákn	lengd	hæð	Ofnlöki	Stilling
Ofn	Rými	þörf í(Kcal)	afköst(Kcal)						
1	1.01	760	771	BC	V2(H2)	1000	630	RA2000	2.5
2	1.02	516	599	BC	VKL+V	800	560	RA2000	2,5
3	1.03	516	599	BC	VKL+V	800	560	RA2000	2,5
4	1.04	760	771	BC	V2(H2)	1000	630	RA2000	2,5
5	1.05	516	599	BC	VKL+V	800	560	RA2000	2,5
6	1.06	516	599	BC	V2(H2)	1000	560	RA2000	2,5
7	HB	1800							
8	HB	1800							
9	HB	1800							

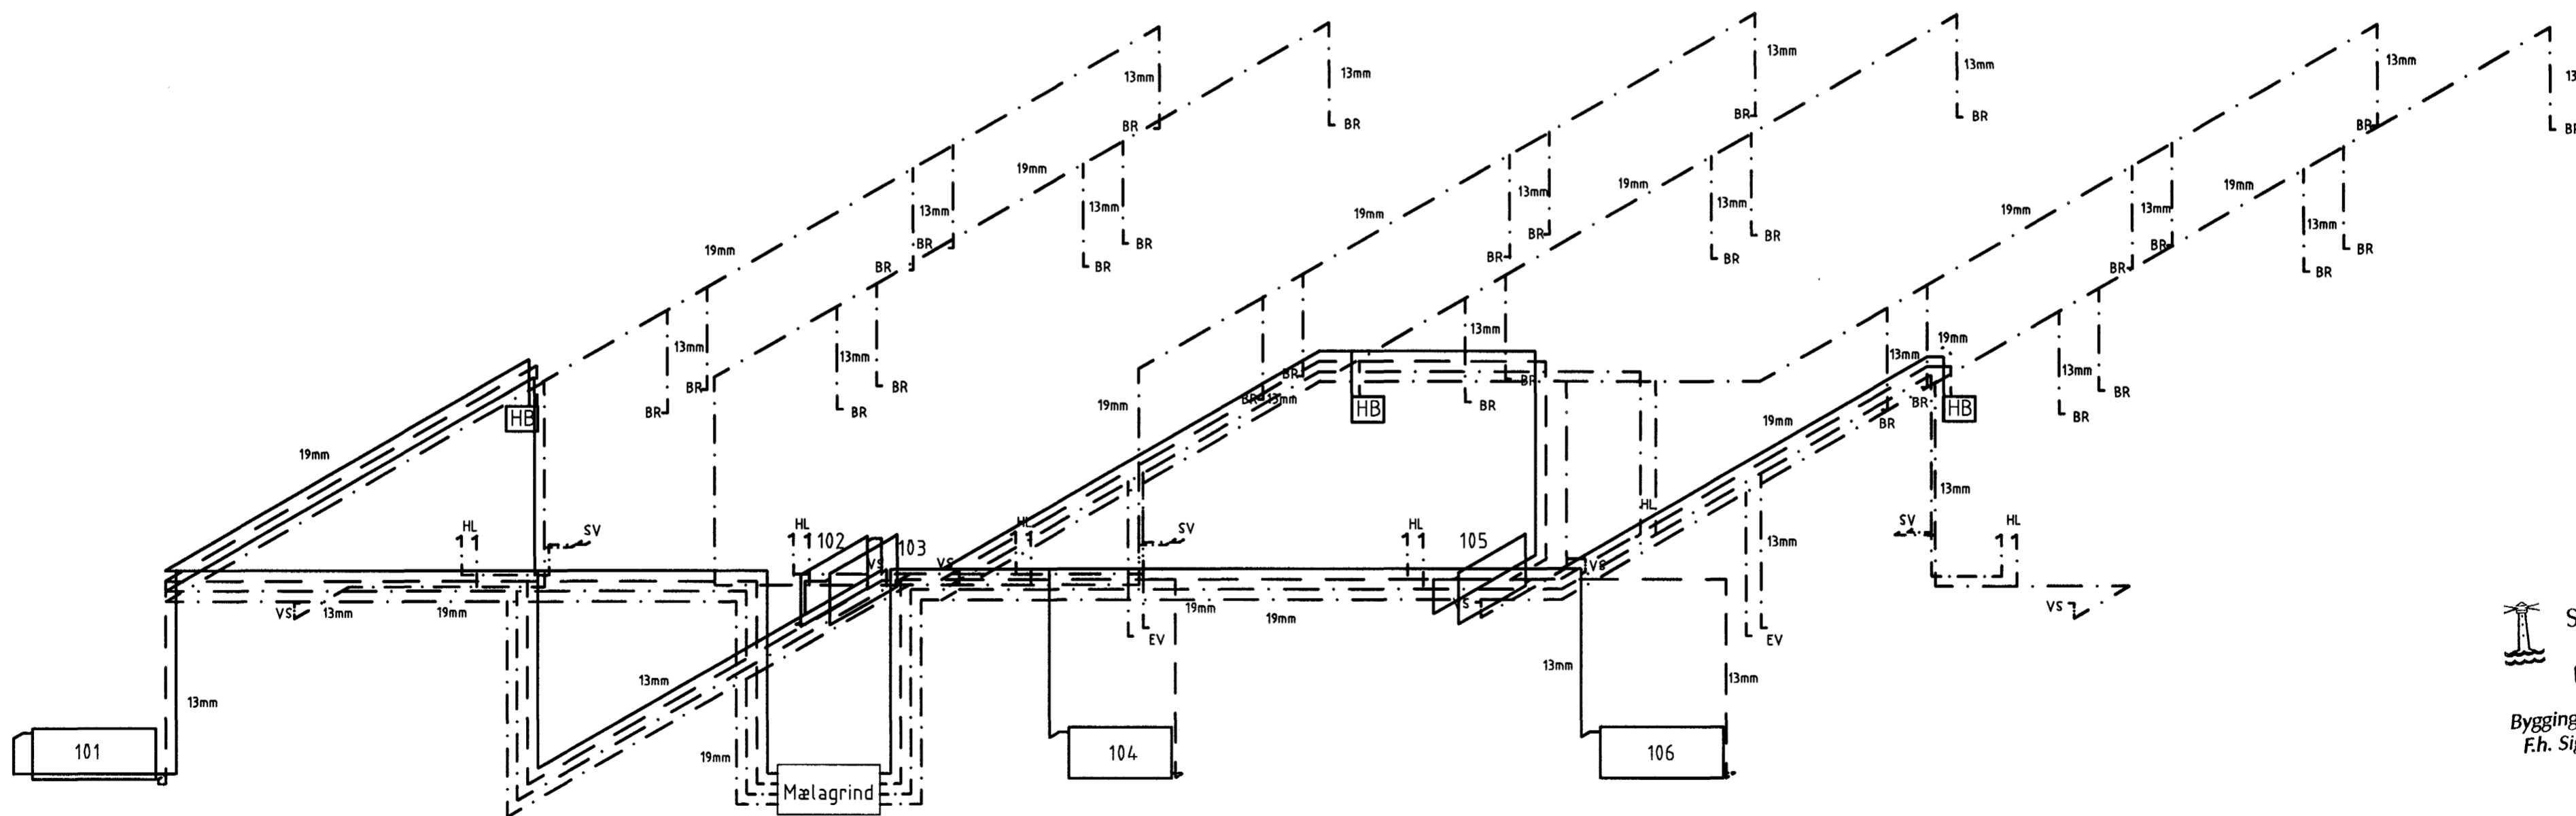

Samþykkt þann
09 NOV. 2001
Byggingafultrúinn í Laugavegi
F.h. Sigurbjartur Halldórsson

VERKVANGUR EHF VERKFRÆÐISTOFA Jóhann K. Hjálmarsson FTÍ kt. 220265-4639	Netlyf 2 110 Reykjavík Sími: 675-5800 Fax: 675-5801
	SÖRLASKEIÐ 19 HAFNARFIRÐI RÚMÝND HITA-OG NEYSLUVATNSLAGNA
M.kv. 1:50 TEIKN. J.K.H.	VERK NR. 1014 DAGS. 06.10.01