

GÖLFHITI


Slauða Nr.	Nafn á herbergi	Varmatap W	Gölfhlötur m ²	Hitaflötur m ²	Þörf W/m ²	Rörabil mm	Hámarks afl á m ² W/m ²	Lengd slauðu m	Flæði l/sek.	Hámarks gölfhiti °C	Þrýstitalp kPa
1	Listaskáli	1005	17	14.5	69	200	77	87	0.024	27.0	1.9
2	Listaskáli	1005	17	14.5	69	200/300	77	89	0.024	27.0	2.0
3	Fjölnotasalur	1670	19	17.5	95	150	87	131	0.040	27.8	6.3
4	Fjölnotasalur	1670	19	17.5	95	150	87	142	0.040	27.8	6.8
5	Deild/Leikur minna	743	9	8.0	93	100	98	94	0.018	28.8	1.4
6	Deild/Leikur	1486	27	24.0	62	200/300	77	109	0.036	27.0	4.0
7	Deild/Leikur	1689	31	28.0	60	200/300	77	109	0.040	27.0	5.2
8	Deild/Leikur minna	740	9	8.0	93	100	98	82	0.018	28.8	1.2
9	Gangur	892	9	8.7	102	100	98	95	0.021	28.8	1.5
10	Fataklefar	565	9	7.3	77	200	77	52	0.014	27.0	0.4
11	Fataklefar / Vindgätt	1129	19	14.7	77	100/200	77	103	0.027	27.0	2.8
	Vindgätt	653	3	2.5	260	100	98			28.8	
	Samtals	13246						1093	0.302		

TILVÍSANIR:

ALMENNAR SKÝRINGAR . . . SJÁ BL. NR. B1-L1-VA-001

d.e. 13.11.01

BR. DAGS. BREYTING REIKN. TEIKN.

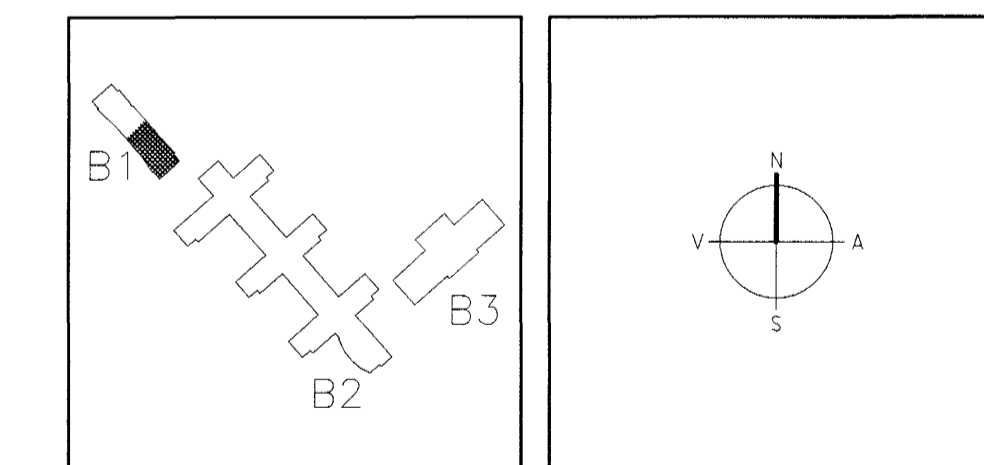

ARKITEKTAR FINNUR BJÖRGVINSSON
BERGSTADASTRÆTI 10, RVK. HILMAR ÞÓR BJÖRNSSON
sími: 551-1460, netfang: arkitekt@isholf.is SIGRÍÐUR ÓLAFSDÓTTIR

LANDMÖTUN. EIMAR E. SÆVINDSSON
INGIBJÖRG KRISTJÁNSDÓTTIR
MARGRÉT SIGURDARDÓTTIR
BYGGINGAFULLTRÚDINN / HALLDÓRSSON
RÚS. SÍGURBJARNAR

VSÓ VSD RÁÐGJAF
BORGARTÚNI 20, 105 REYKJAVÍK, SÍMI 585-9000, SAMRÆF 585-9010, NETFANG vsod@vso.is

TJARNARBRAUT 30
LEIKSKÓLINN HÖRÐUEVILLIR

GÖLFHITI GRUNNMYND
HANNAÐ/TEIKN. RÚS
ATH. *RÚS*
SAMÞYKKT *Sigmundur*
KT. *27047-3719*

KVARÐI 1:50
VERKFR. REIKN. NR. 07.11.2001
00258 B1-L4-VG1-002