


Oftaskrá (neðri hæð)

Oftu mesta mesta tenging aftöst

nr.	hæð	lengd	stíta	cost/w
1	600	1200	φ10 AB	700
2	600	1000	φ10 AB	150
3	300	1600	φ10 CD	600
4	300	1400	φ10 CD	650
5	300	2000	φ10 CD	930
6	600	500	φ10 AB	390
7	600	1200	φ10 CD	390
8	600	1600	φ10 AB	860
9	600	1600	φ10 AB	860
10	600	1700	φ10 AB	1250

Á öllum öðrum skal setja, auk loftskriflu og stillis, oftulöta með innbyggðum hitastilli, s.d. af gerðinni Danfoss FJVR.

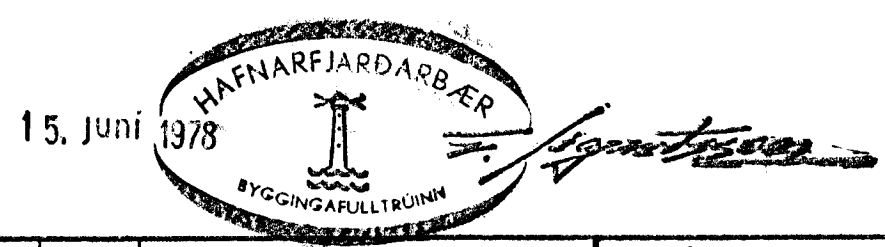

BR. DAGS.		BREYTING		HRAUNBRUN 27 HAFNARFIRÐI. Grunnmynd Kjallara Hítalagrútt.	
TÆKNIPJÓNUSTAN SF. ÁRMÚLA 1 - REYKJAVÍK - Sími 83844		HANNAÐ	###	KVARÐI	1.50
Lárusson		TEIKNAD	###	DAGS.	Okt. 76
YFIRFARIÐ		NR.		BL. AF.	5