


Blásarasamslæða: York CS113 FCLP 8800 cfm, ca. 1 1/2" S.P.
 m/ 2 stk. málloka spjaldlokum 62"x13 1/2"
 m/ 6 stk. 2"-sium, 20"x25", hreinsanl.
 m/ rafmótor, 5,5 hö og breytanl. reimskilum.
 m/ gúmmipúðum f. gölffestingu.

- 1 Frostryggi, Honeywell T675A (3°C)
- 2 Blöndunarhitastillir, Honeywell T391A (10°C)

Blásari: York CS113 FCLP 8600 cfm, ca. 3/4" S.P.
 m/ rafmótor, 4 hö og breytanl. reimskilum
 m/ gúmmipúðum f. gölffestingu.

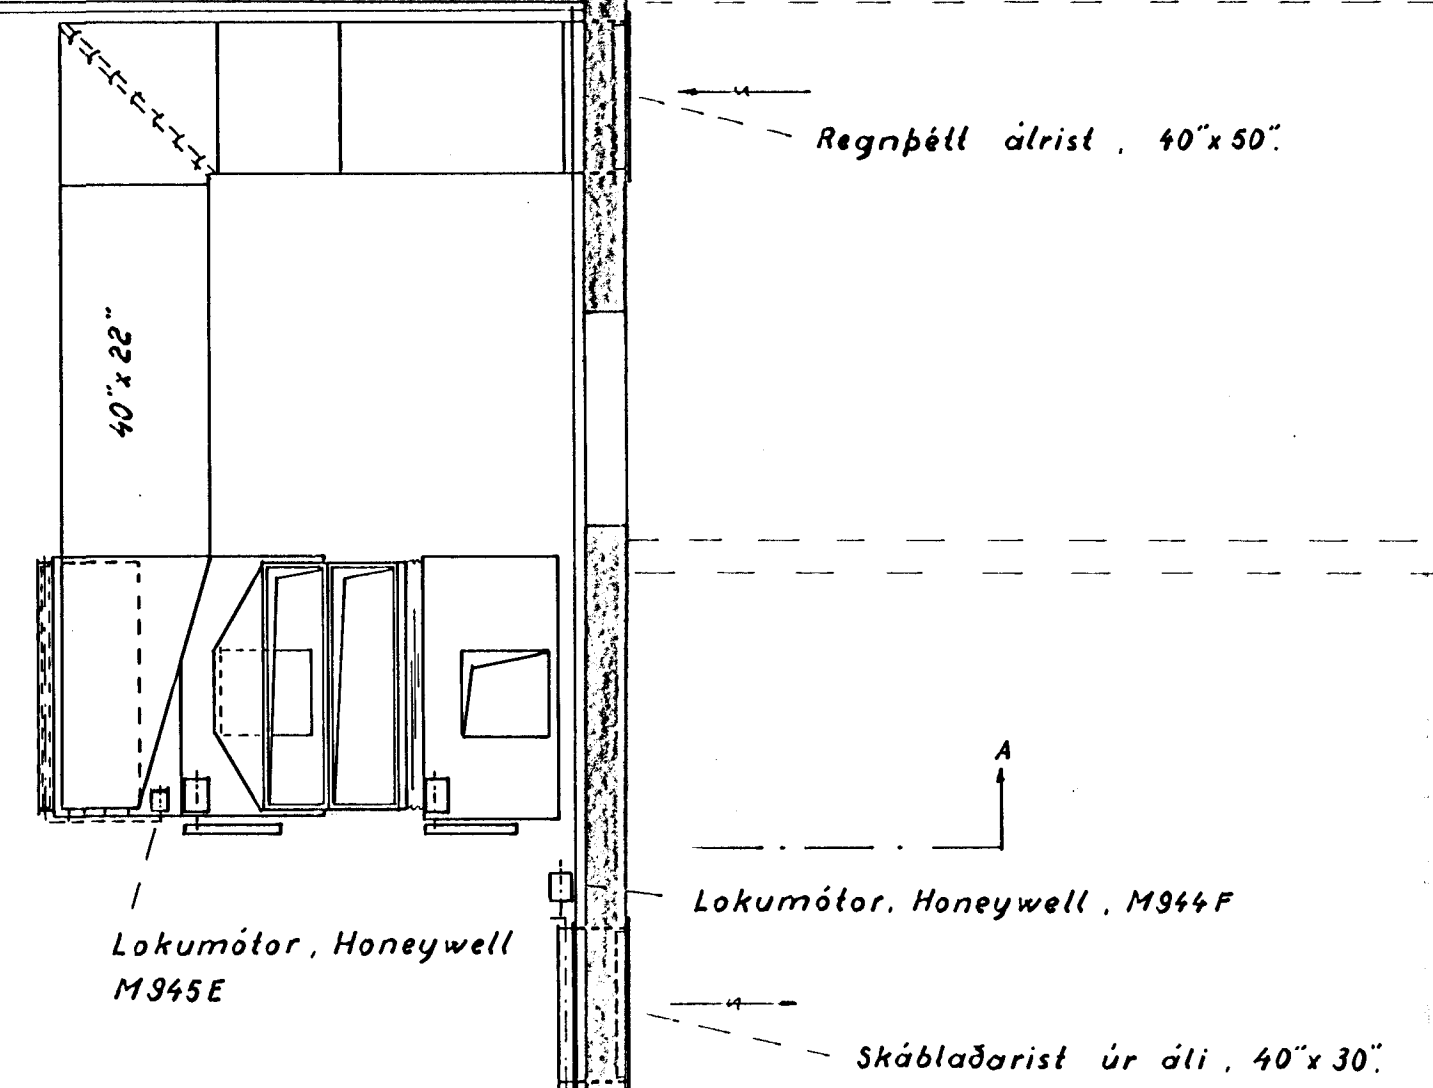

| Fl. | Heiti | Mfr. | Tæka nr. | Efni | Ath. |
|---|------------|------|------------|------|--|
| Daga | Luðvættung | Daga | Luðvættung | | |
| Þvinging | | | | | |
| VERKFRÆDISTOFA GUDMUNDAR & KRISTJÁNS <small>Lúfavegi 19 Sími 14425</small> | | | | | <small>Mfr.</small> 1:50 <small>Yfir.</small> <small>Samb.</small> |
| <small>VÍDISTADASKÖLI, HAFNARFIRDI</small> <small>GRUNNMYND KJALLARA</small> <small>Loftræsting</small> | | | | | <small>Verk nr.</small> 3A-84 <small>bl. 8 af 8</small> |