

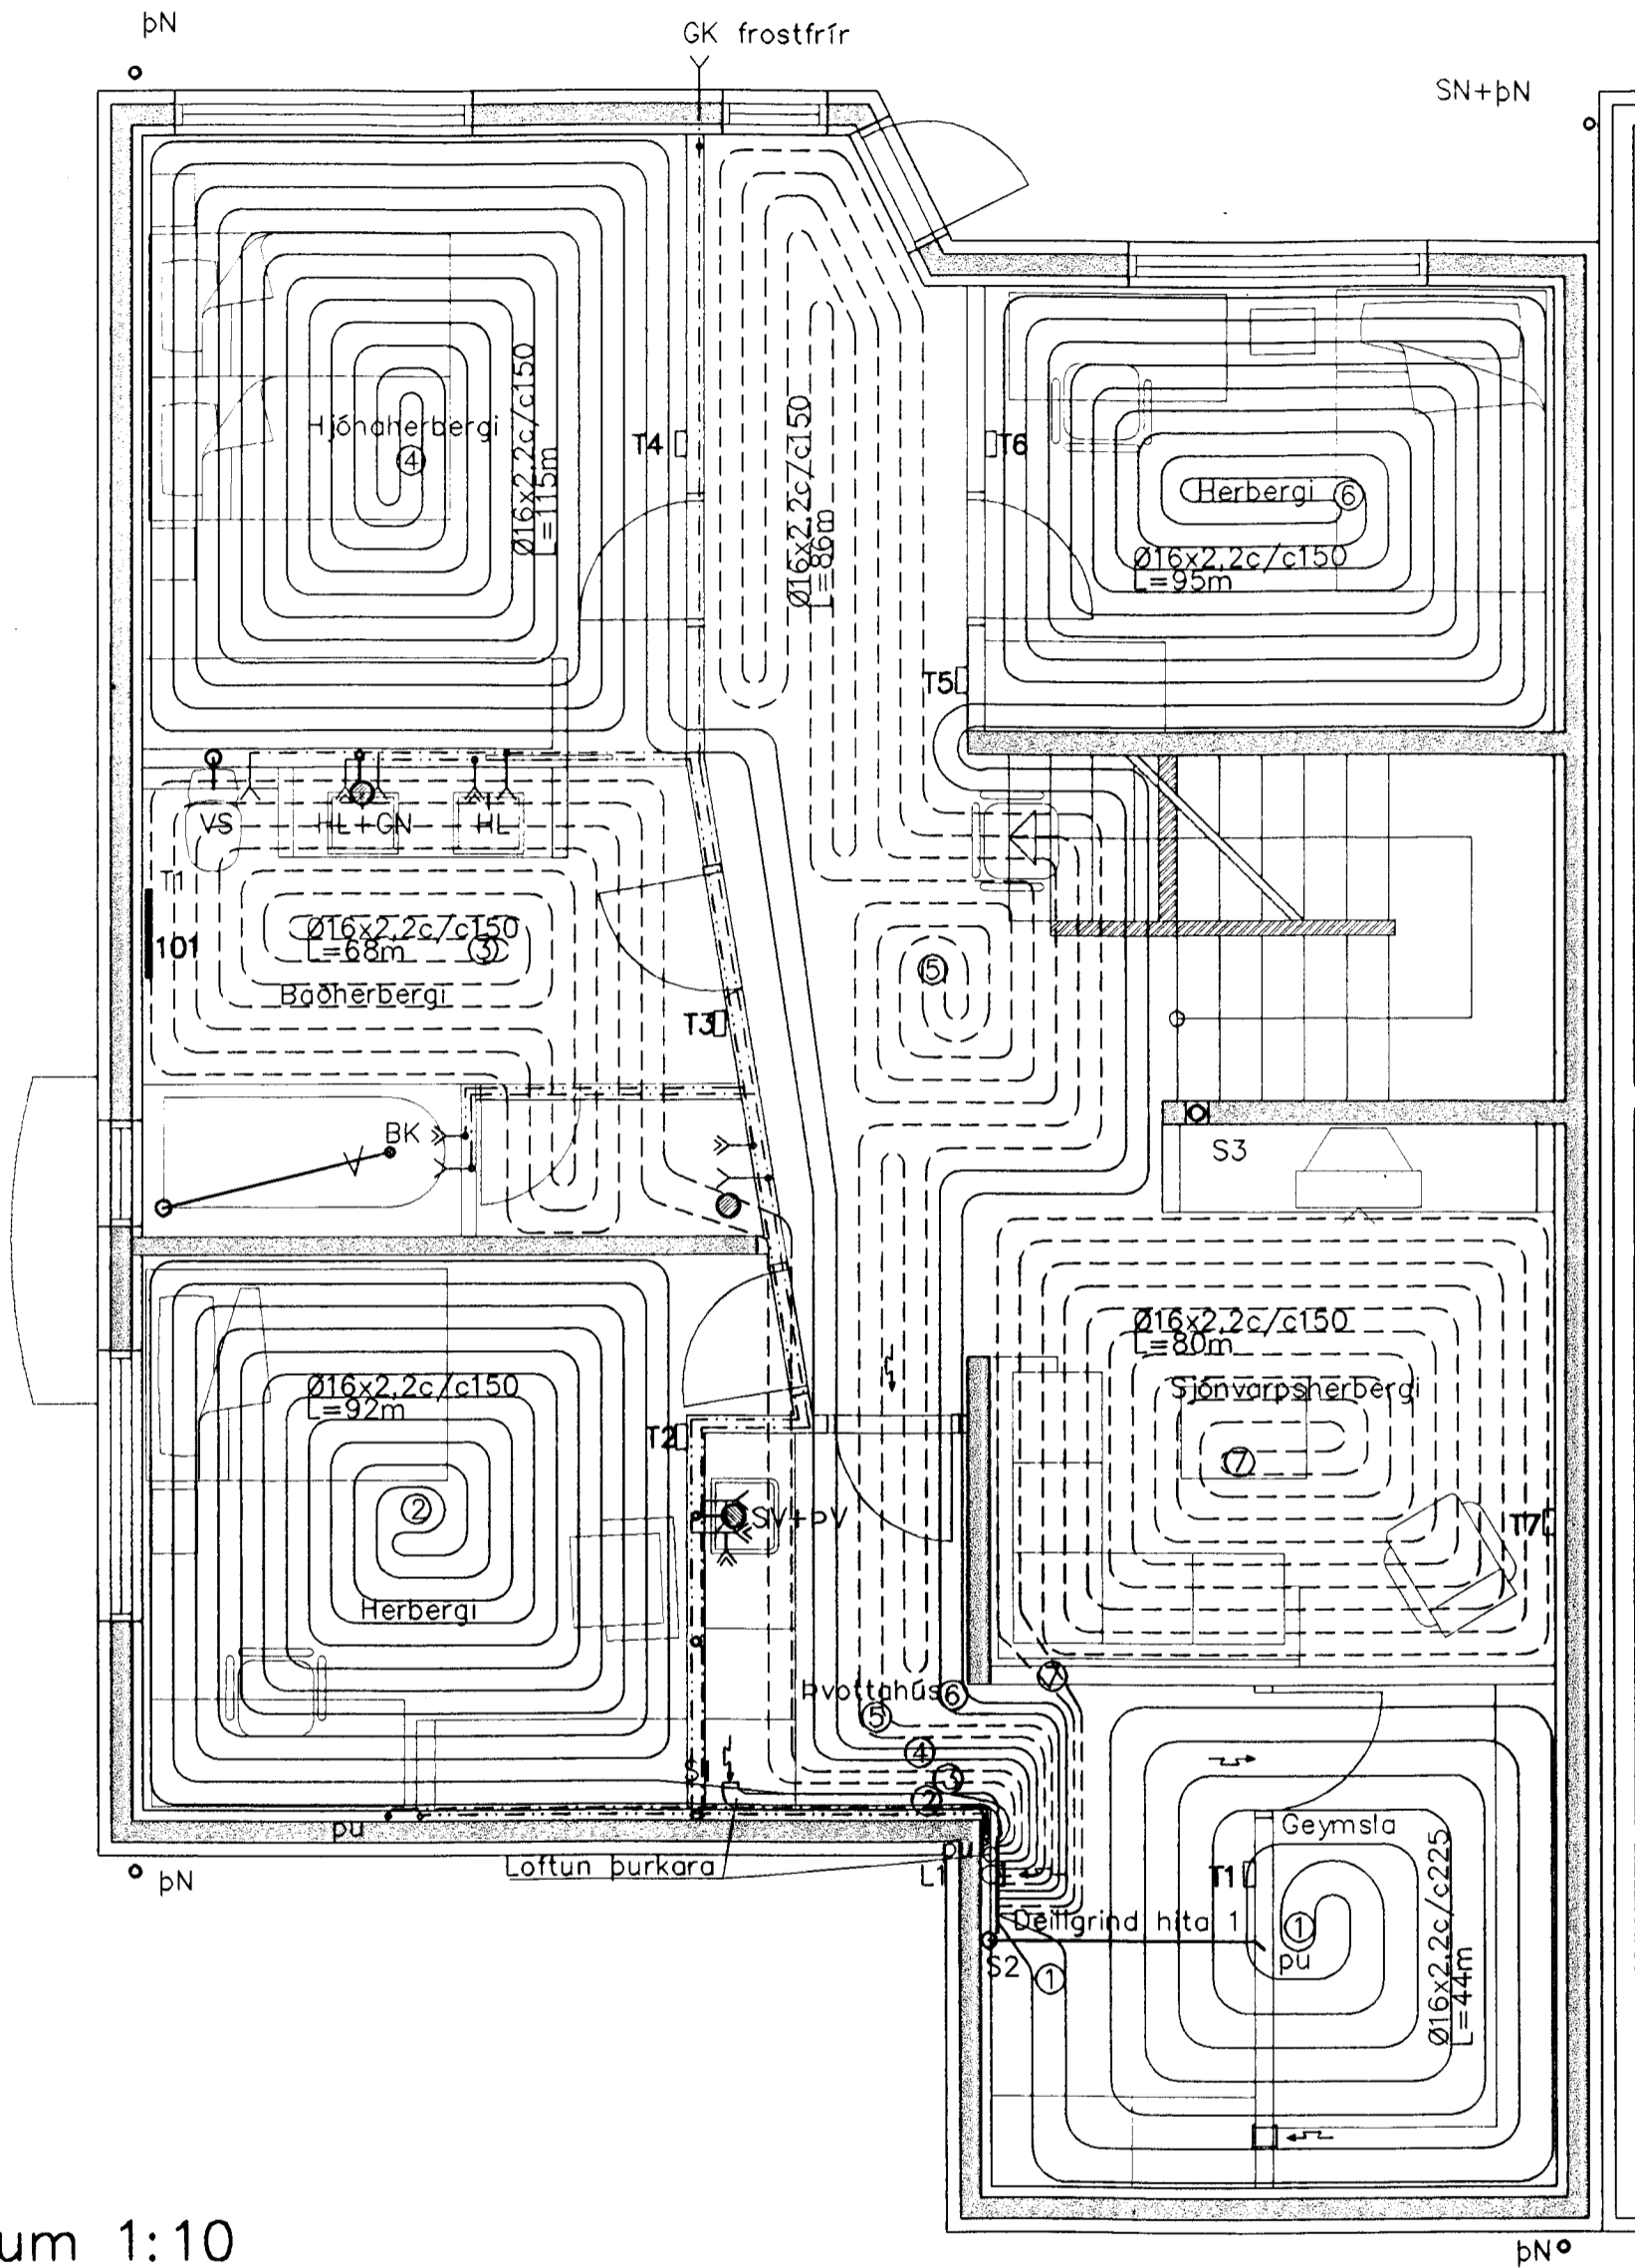


GRUNNMYND NEÐRIHÆÐAR 1:50

TENING A OFNI A BAÐI

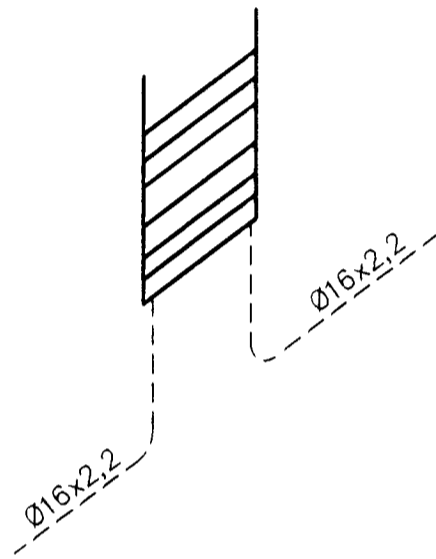

Snið lagna í gólfum 1:10 neðrihæðar

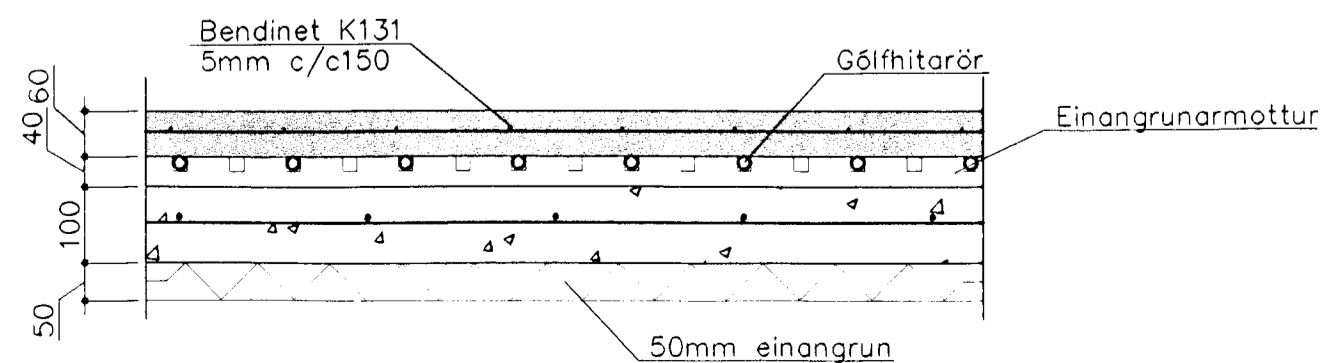

Ofnaskrá

Ofnar skulu vera vottaðir af Rannsóknarstofnun Byggingariðnaðarins samkvæmt ÍST EN-442
Ofnar delta-t=40°C Ofnatengi = 10mm

númer	rými	wött/klst ofnategund	ofnloki
101	Bað		Handkl. 500,H=1160

Skýringar gólfhita:

Slaufa Nr: 1	44m	693 wött/klst
Slaufa Nr: 2	92m	1011 wött/klst
Slaufa Nr: 3	68m	733 wött/klst
Slaufa Nr: 4	115m	1173 wött/klst
Slaufa Nr: 5	86m	879 wött/klst
Slaufa Nr: 6	95m	1063 wött/klst
Slaufa Nr: 7	80m	843 wött/klst
Samtals		580m 6395 wött/klst

31 MAI 2002
VG

Breytingar			KRIUÁS 37, HAFNARFJ.	
Nr.	Dags.	Nafn	H BS	T HS
			M	1:50
			Nr.	P101
			Dags.	feb.'02
				080149-3609

Verkfæðistofa þráinn & Benedikt
Laugavegi 178, 105 Rvk.
Sími: 553 1770, 568 7775, Fax: 568-7701
Netfang: post@islandia.is

Hiti, vatn, frárennsli og loftr.
neðrihæðar

Samp. E. Jón Lúðv. BS