



GRUNNMYND EFRIHÆÐAR 1:50

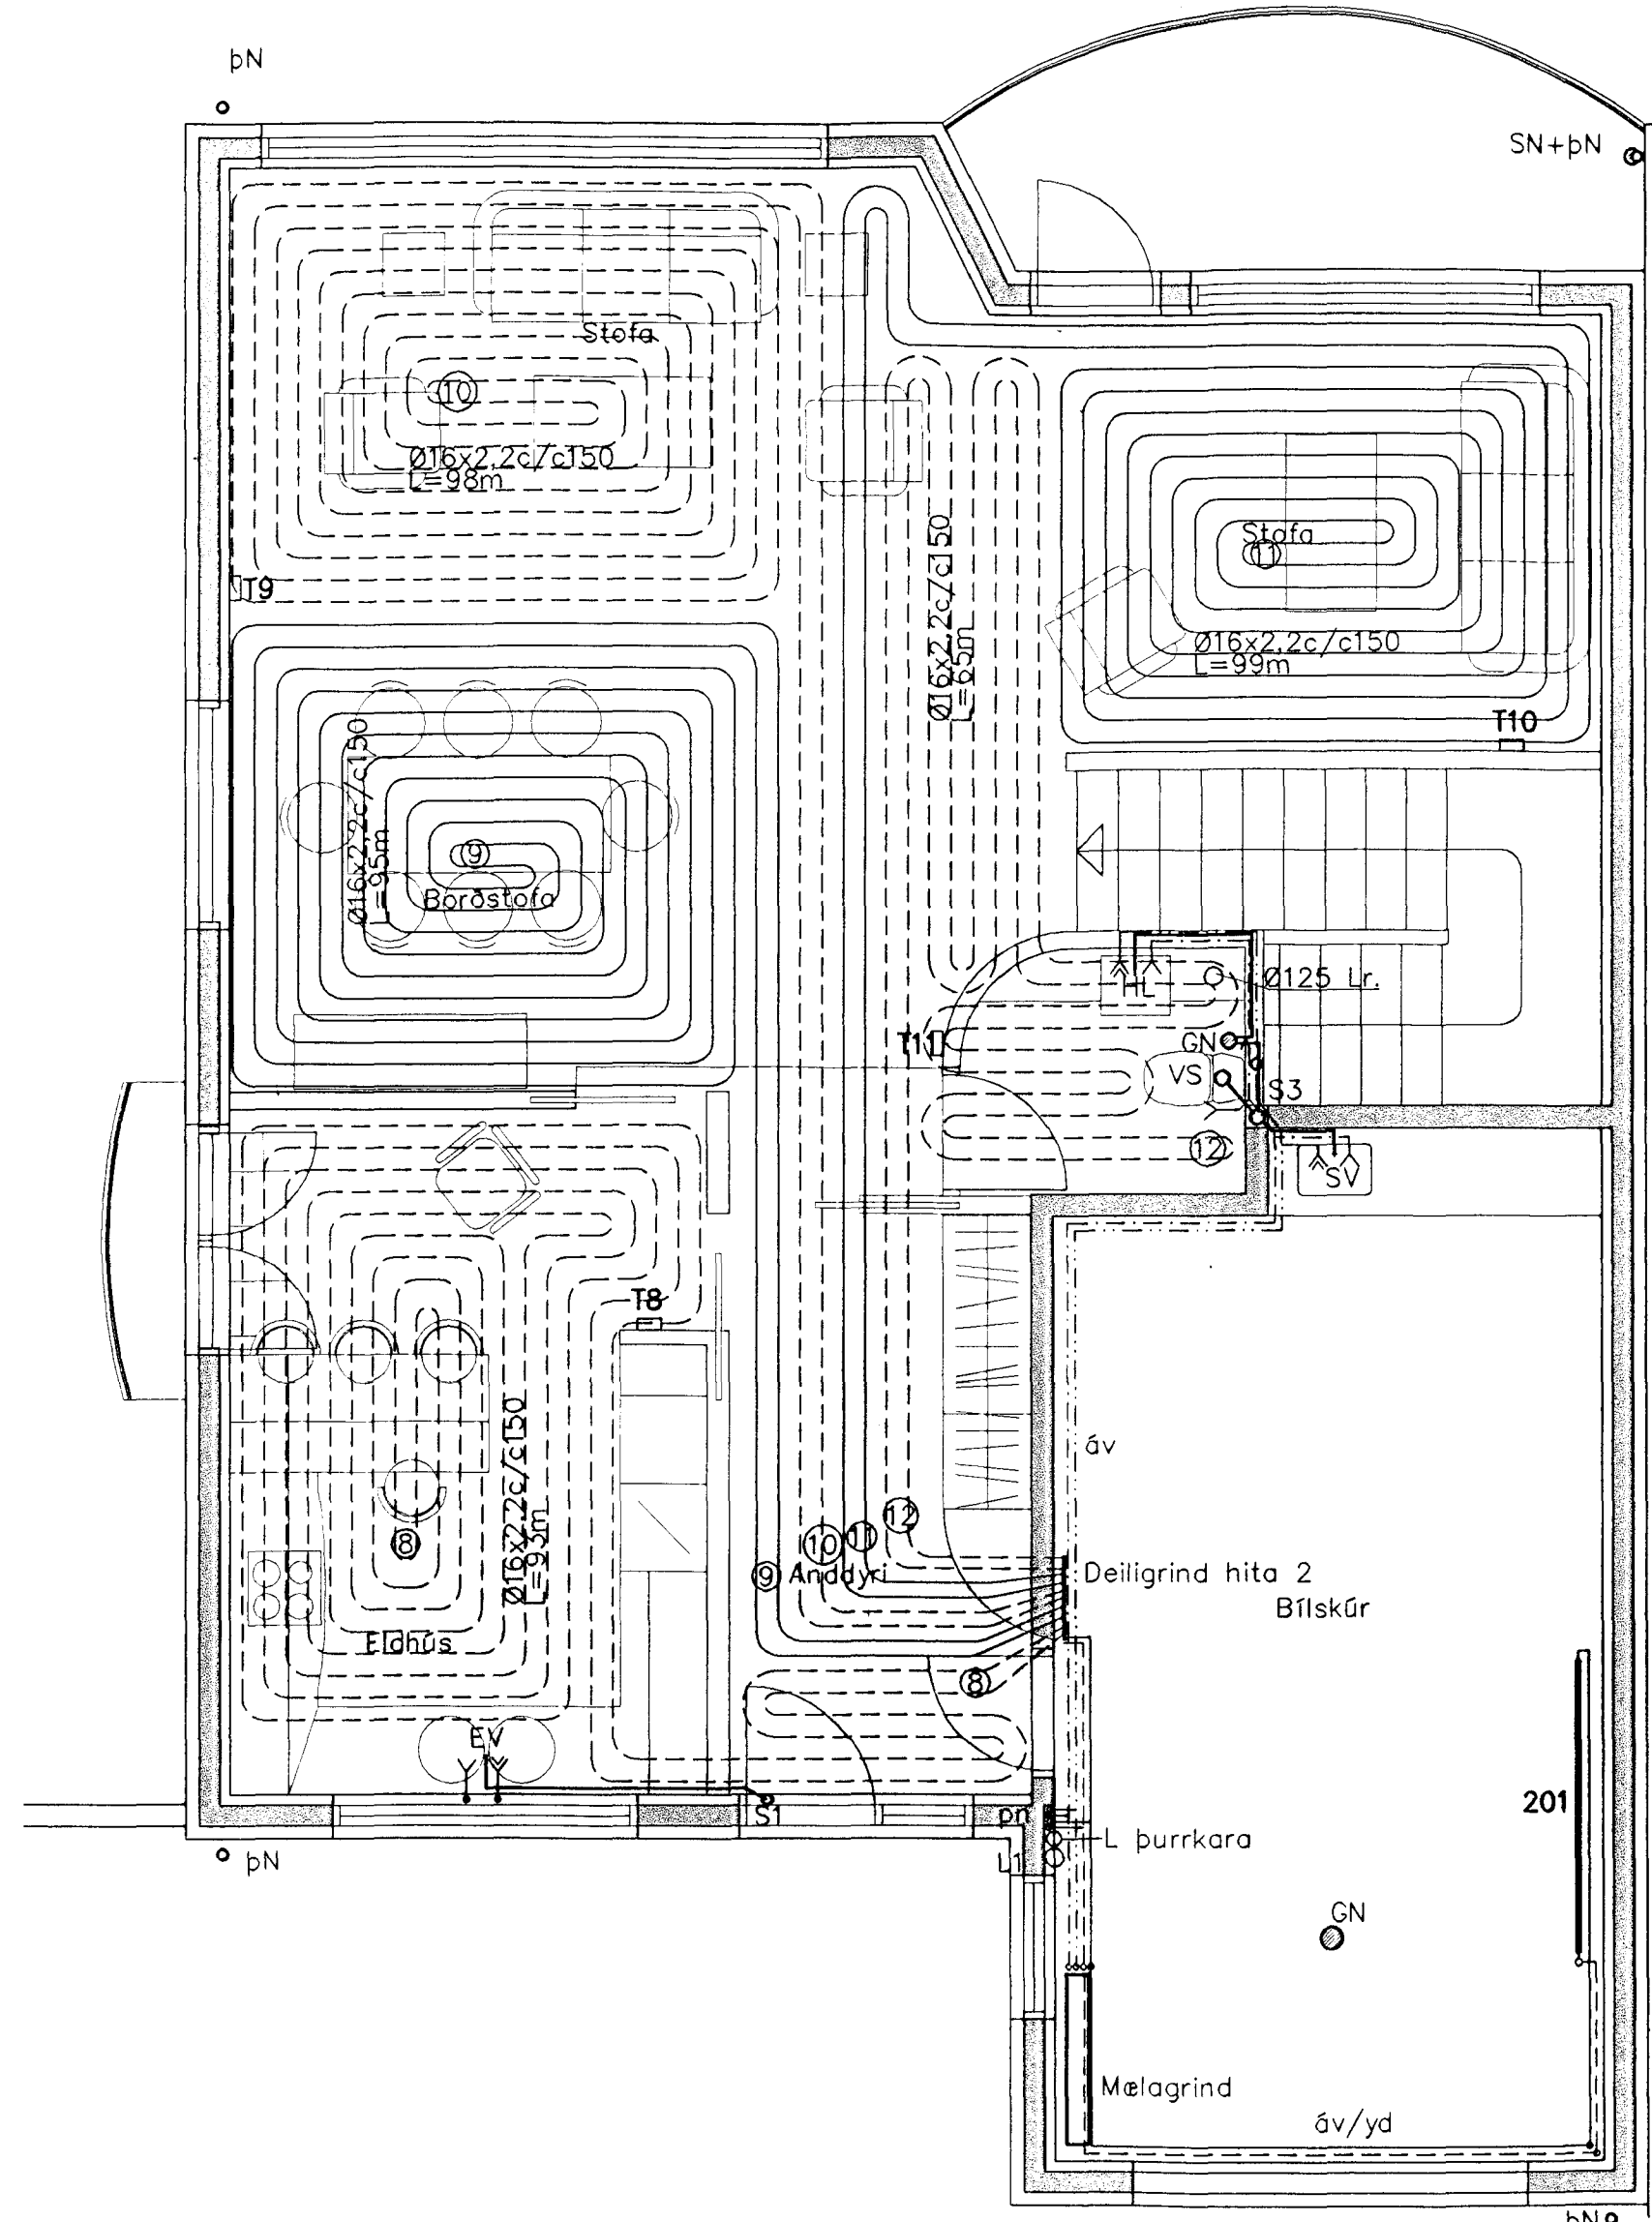

Snið lagna í gólfum 1:10 efrihæðar

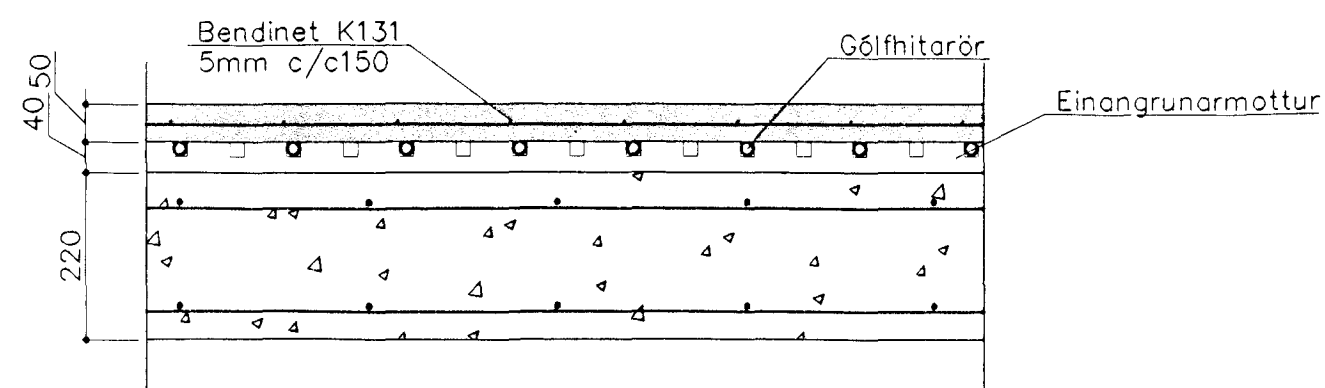

Ofnaskrá

*Ofnar skulu vera vottaðir af Rannsóknarstofnun Byggingariðnaðarins samkvæmt ÍST EN-442*  
*Ofnar delta-t=40°C Ofnatengi = 10mm*

númer	rými	wött/klst	ofnategund	ofnloki
201	Bílskúr	2430	P22-500,L=2000	FJVR-10
<b>Samtals wött/klst</b>		<b>2430</b>		

Afköst gólfhita:  
 Slaufa Nr: 8 93m 1026 wött/klst  
 Slaufa Nr: 9 95m 1085 wött/klst  
 Slaufa Nr: 10 98m 1085 wött/klst  
 Slaufa Nr: 11 99m 1085 wött/klst  
 Slaufa Nr: 12 65m 733 wött/klst  
 Samtals 450m 5028 wött/klst

31 MAI 2002  
 VG

Breytingar			KRIUÁS 37, HAFNARFJ.	H BS   T HS   S
Nr.	Dags.	Nafrn		
			<b>Verkfræðistofa Þráinn &amp; Benedikt</b> Laugavegi 178, 105 Rvk. Sími: 553 1770, 568 7775, Fax: 568-7701 Netfang: post@islandia.is	M 1:50 Nr. P201
			Hiti, vatn, frærennsli og loftn. efrihæðar	Dags. feb.'02 080149-3609

*Samp. Jon Linn. Þorsteinsson*