
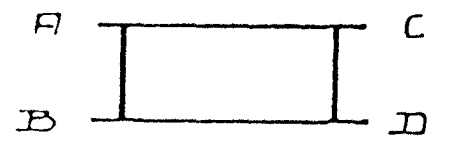


HITALÖGN SKYRNGAR:

FITTINGS: SVARTUR RANDEFITTINGS
 EINANGRUN: 20mm.GLERULLARHOLKAR VAFDIR SISALPAPPA.
 OFNLOKAR: A FRAMRENNSLI T.D. DANFOSS RAVL-3/8" SEM STYRAST AF HERBERGISHITA
 A BAKRENNSLI T.D. DANFOSS FJVR-3/8" SEM STYRAST AF HITASTIGI BAKRENNSLIS.
 OFNAR: STALOFNAR PROFADIR VID 8 kg/cm. loftaskrúfur á öllum ofnum
 prófun: lögnina skal prófa við 6 kg/cm . SEM STANDA SKAL I 12 KLST. AN ÞESS AD FALLA.
 ATH: OFNASTÆRDIR SKAL ENDURSKODA A STADNUM ADUR EN OFNAPONTUN ER GERD.

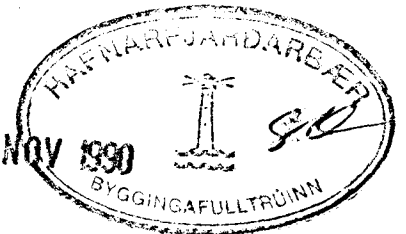

$\Delta t = 40^\circ C$

OFN NR.	GERD	LENGD	HIED	AFK.	TENGING	VALDIR OFNAR
		CM	CM	Kcal h	FRAM BAK	GERD AFK.
1		250	70	3100	C D	
2		100	60	550	C D	
3		130	60	1250	C D	
4		120	60	930	A B	
5		100	60	520	A B	
6		130	60	1030	A B	
7		120	20	800	C D	
8		120	20	800	A B	
9		150	60	1600	A B	
10		70	60	200	A B	
11		60	60	600	A B	
12		120	60	750	C D	
13		110	60	1650	A B	
14		130	60	1230	C D	
15		100	20	680	C D	
16		100	20	680	A B	
17		130	60	1150	C D	
18		60	60	720	A B	
19		120	60	1050	A B	
20		130	60	1580	A B	
21		120	20	950	C D	
22		120	20	950	A B	
23		130	60	1290	A B	

ATH! OFNASTÆRDIR SKULU ATHUGAST A STADNUM ADUR EN OFNAPONTUN ER GERD

LÆKJARBERG 21, HAFNARFIRÐI.
 ÁGÚST 1990
 HITALOÖGN GRUNNMYND 2. H.
 JOHANNES PÉTURSSON MTFÍ 46221 67510
 SIGURDUR SIGURSSON 666613
Johannes Petursson