



Ofnaskrá

ofn nr	mesta h	mesta l	varmaþörf	tenging valin
1	700		2103	A D
2	700	1200	1615	A B
3		600	921	A 3
4		500	292	C D
5		600	725	A 3
6	650	600	1373	C D
7	700	1500	2416	C D
8	700	1500	1737	A 3
9	700	1500	1737	A 3
10	600	1400	786	A D
11	600	1400	786	A D
12	600	1400	1902	A D
13		900	1386	
			16992	

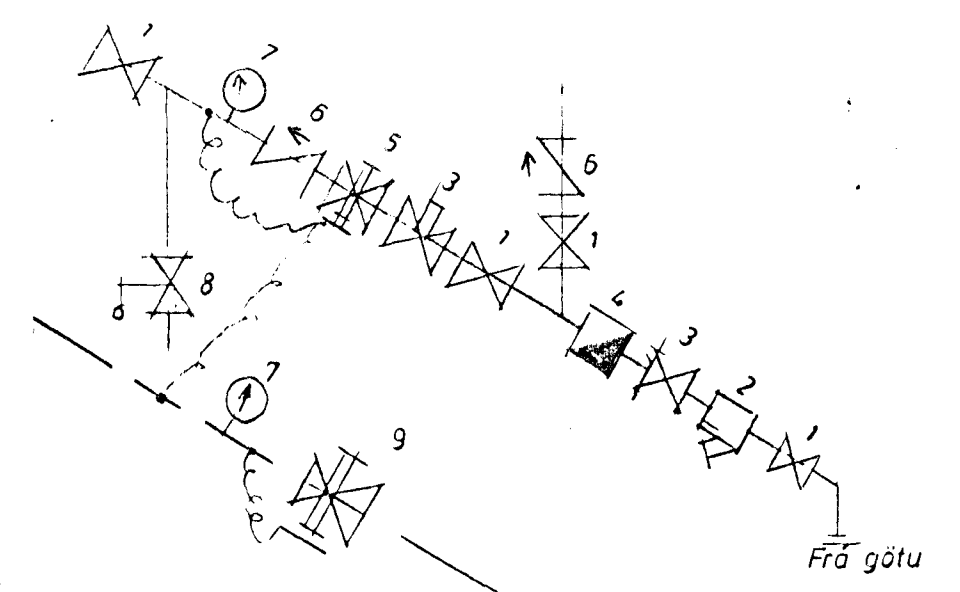

- 1. Renniloki
- 2. Sía
- 3. Hemill
- 4. Vatnsmælir
- 5. Sjálfvirkur loki t.d. Danfoss AVD-DA
- 6. Einstreymislöki
- 7. Hita og þrýstingsmælir
- 8. Öryggislöki
- 9. Sjálv. loki t.d. Danfoss AVD RA

Frágangur í gólf $m = 1:5$

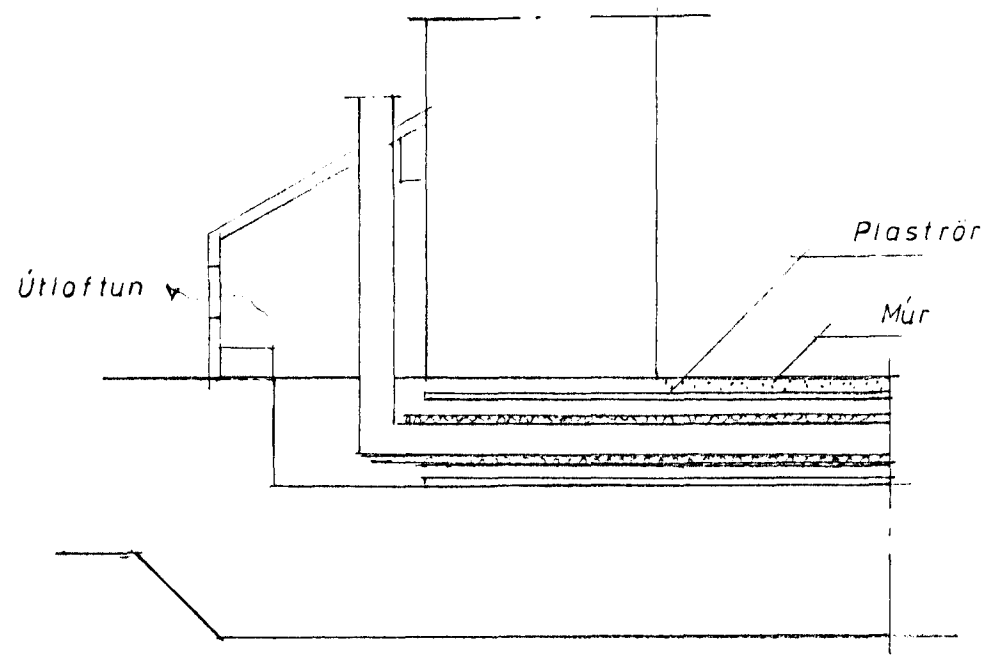

17 JUL 1991

— Frammrennsli
 - - - Bakrennsli
 O Sjálfvirkir lokar komi á bakrennsli ofna

PORVALDUR ASGEIRSSON BYGGINGAÆKNIFRÆÐINGUR
 - HAFNARFJÓRÐ - Sími 53582

Verkefni: Lækjarberg 50	Teikning nr. 6
Hitalagnir rummynd	Reikn.
	Teikn. <i>ed</i>
	Yfir. <i>9/</i>
	Breyl.
Skýrsla: 150	Undir: <i>Þorvaldur Asgeirsson</i>