


Nr.	Kool/h	L/Hu.gl			
201	780	15 85	2x		
202	545	15 85	2x		
203	300	10 85	2x		
204	830	15 85	2x		
205	100	10 85	2x		
206	285	9 85	2x		
207	1175	15 85	2x		
208	2400	33 070	2x		
209	100	85			

RTH

ofnar verði 460

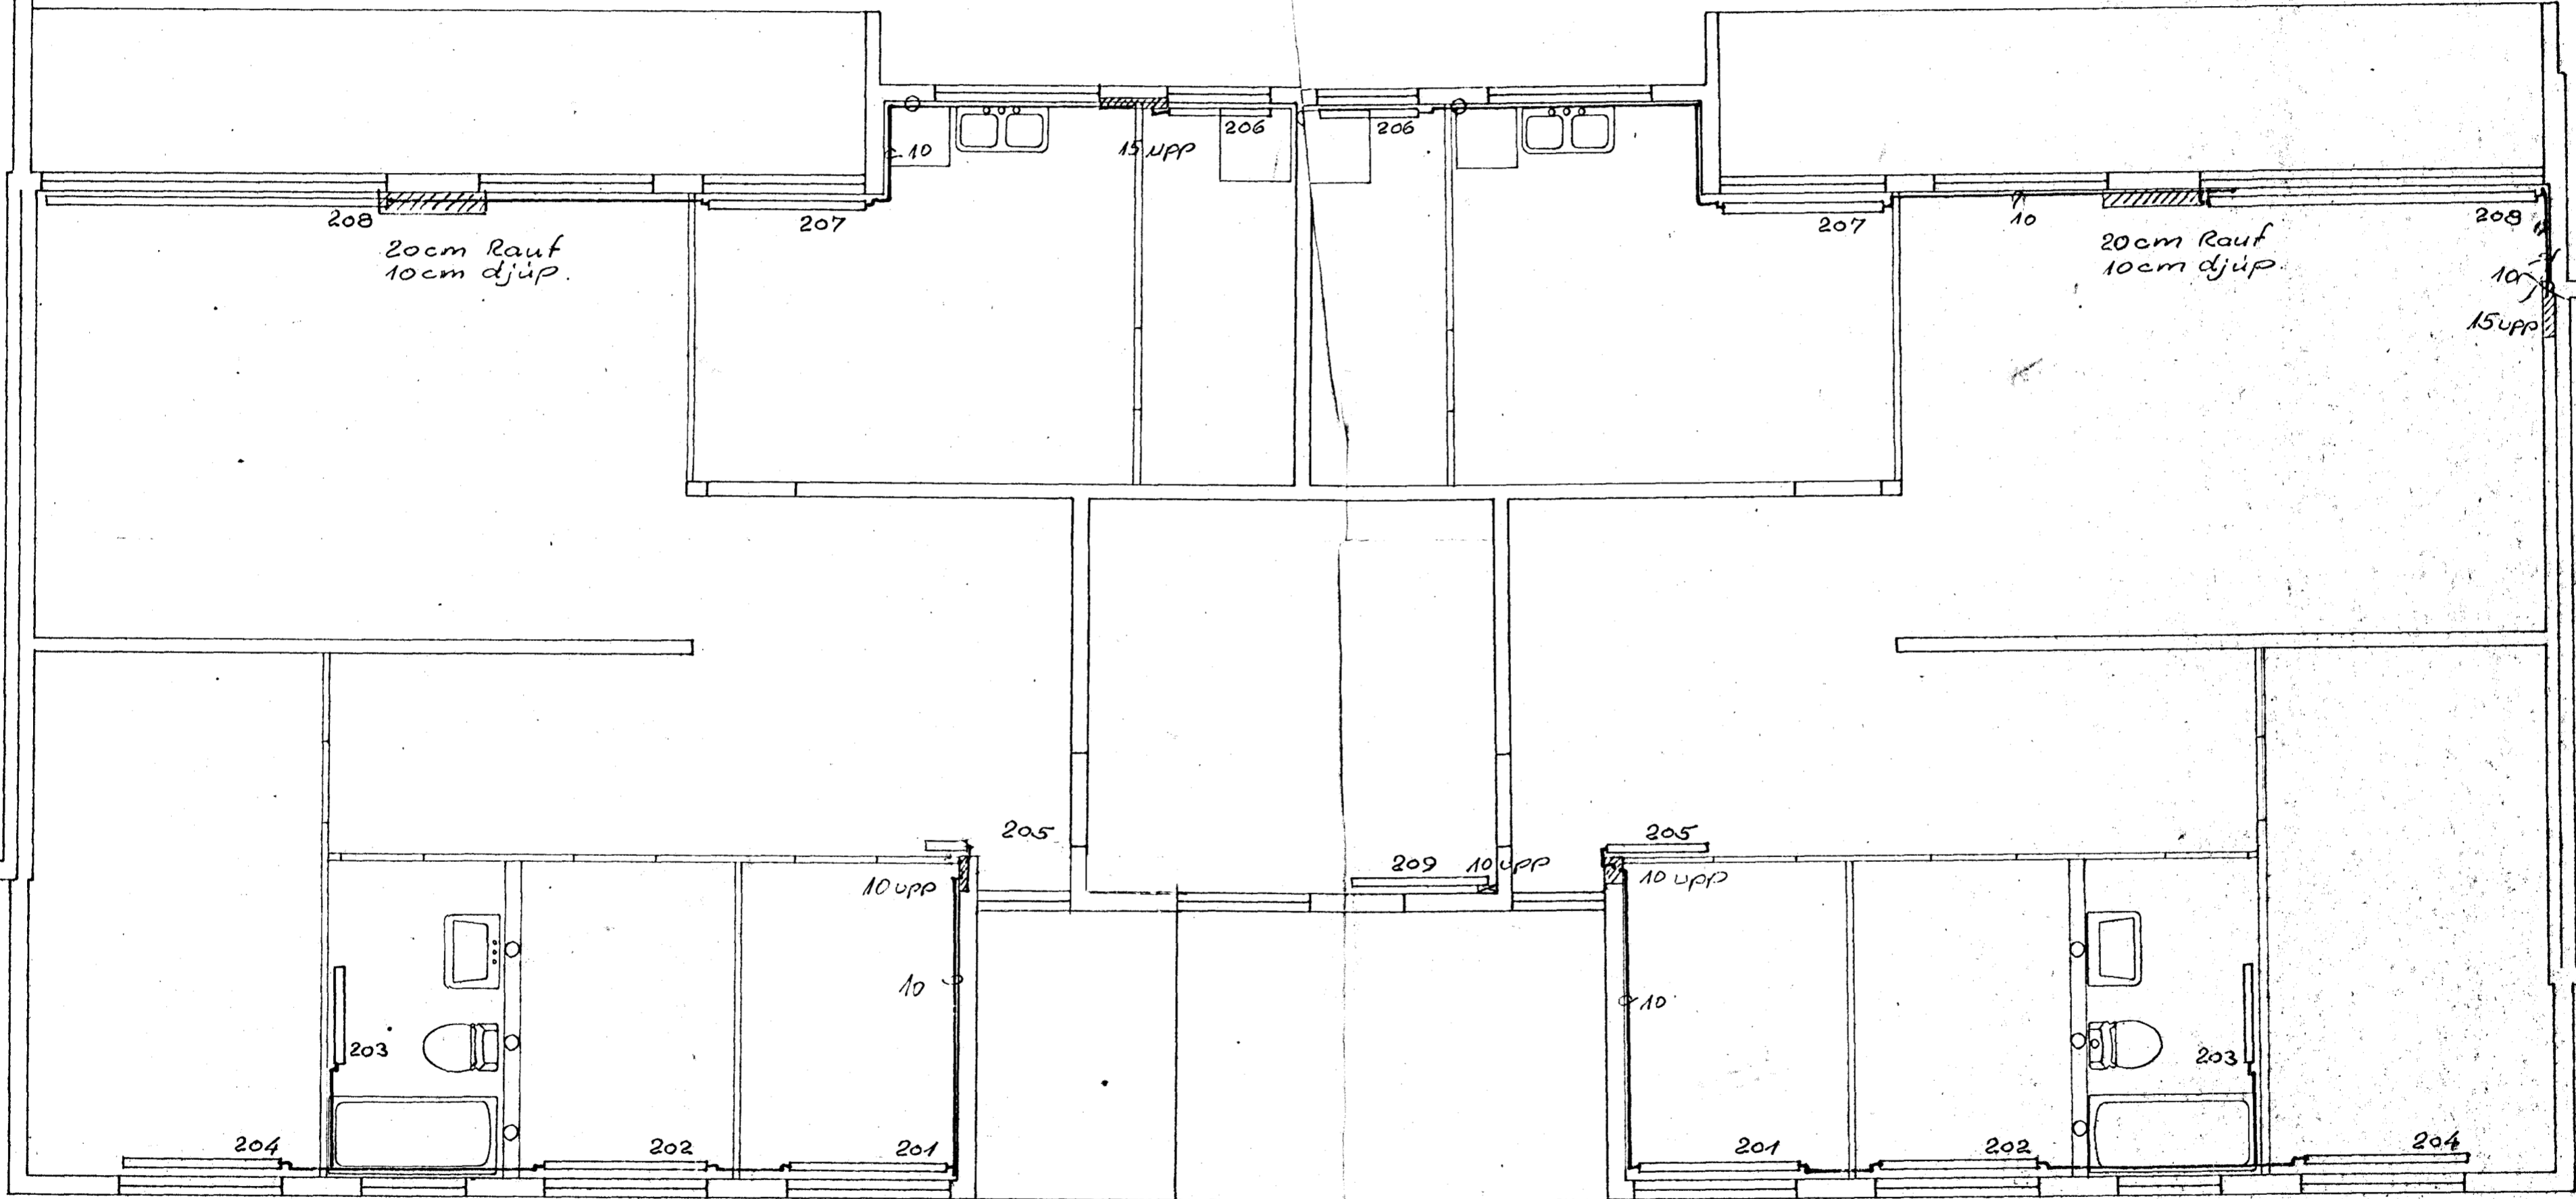

Öll lögnin í samr. við reglug.

DAGS.	BREYTING	GJORT
HANNAÐ JB	JÓN BERGSSON DIPL. ING.	VERKFR. M.V.F.I. 7
TEIKNAD '08.	Laufvangur 3	VERK.
YFIRFARIÐ JB	2. hæð hitalögn, grunnmynd	
SAMÞYKKT	M=1:50	DAGS. Sept '69