



GRUNNMYND 1:50

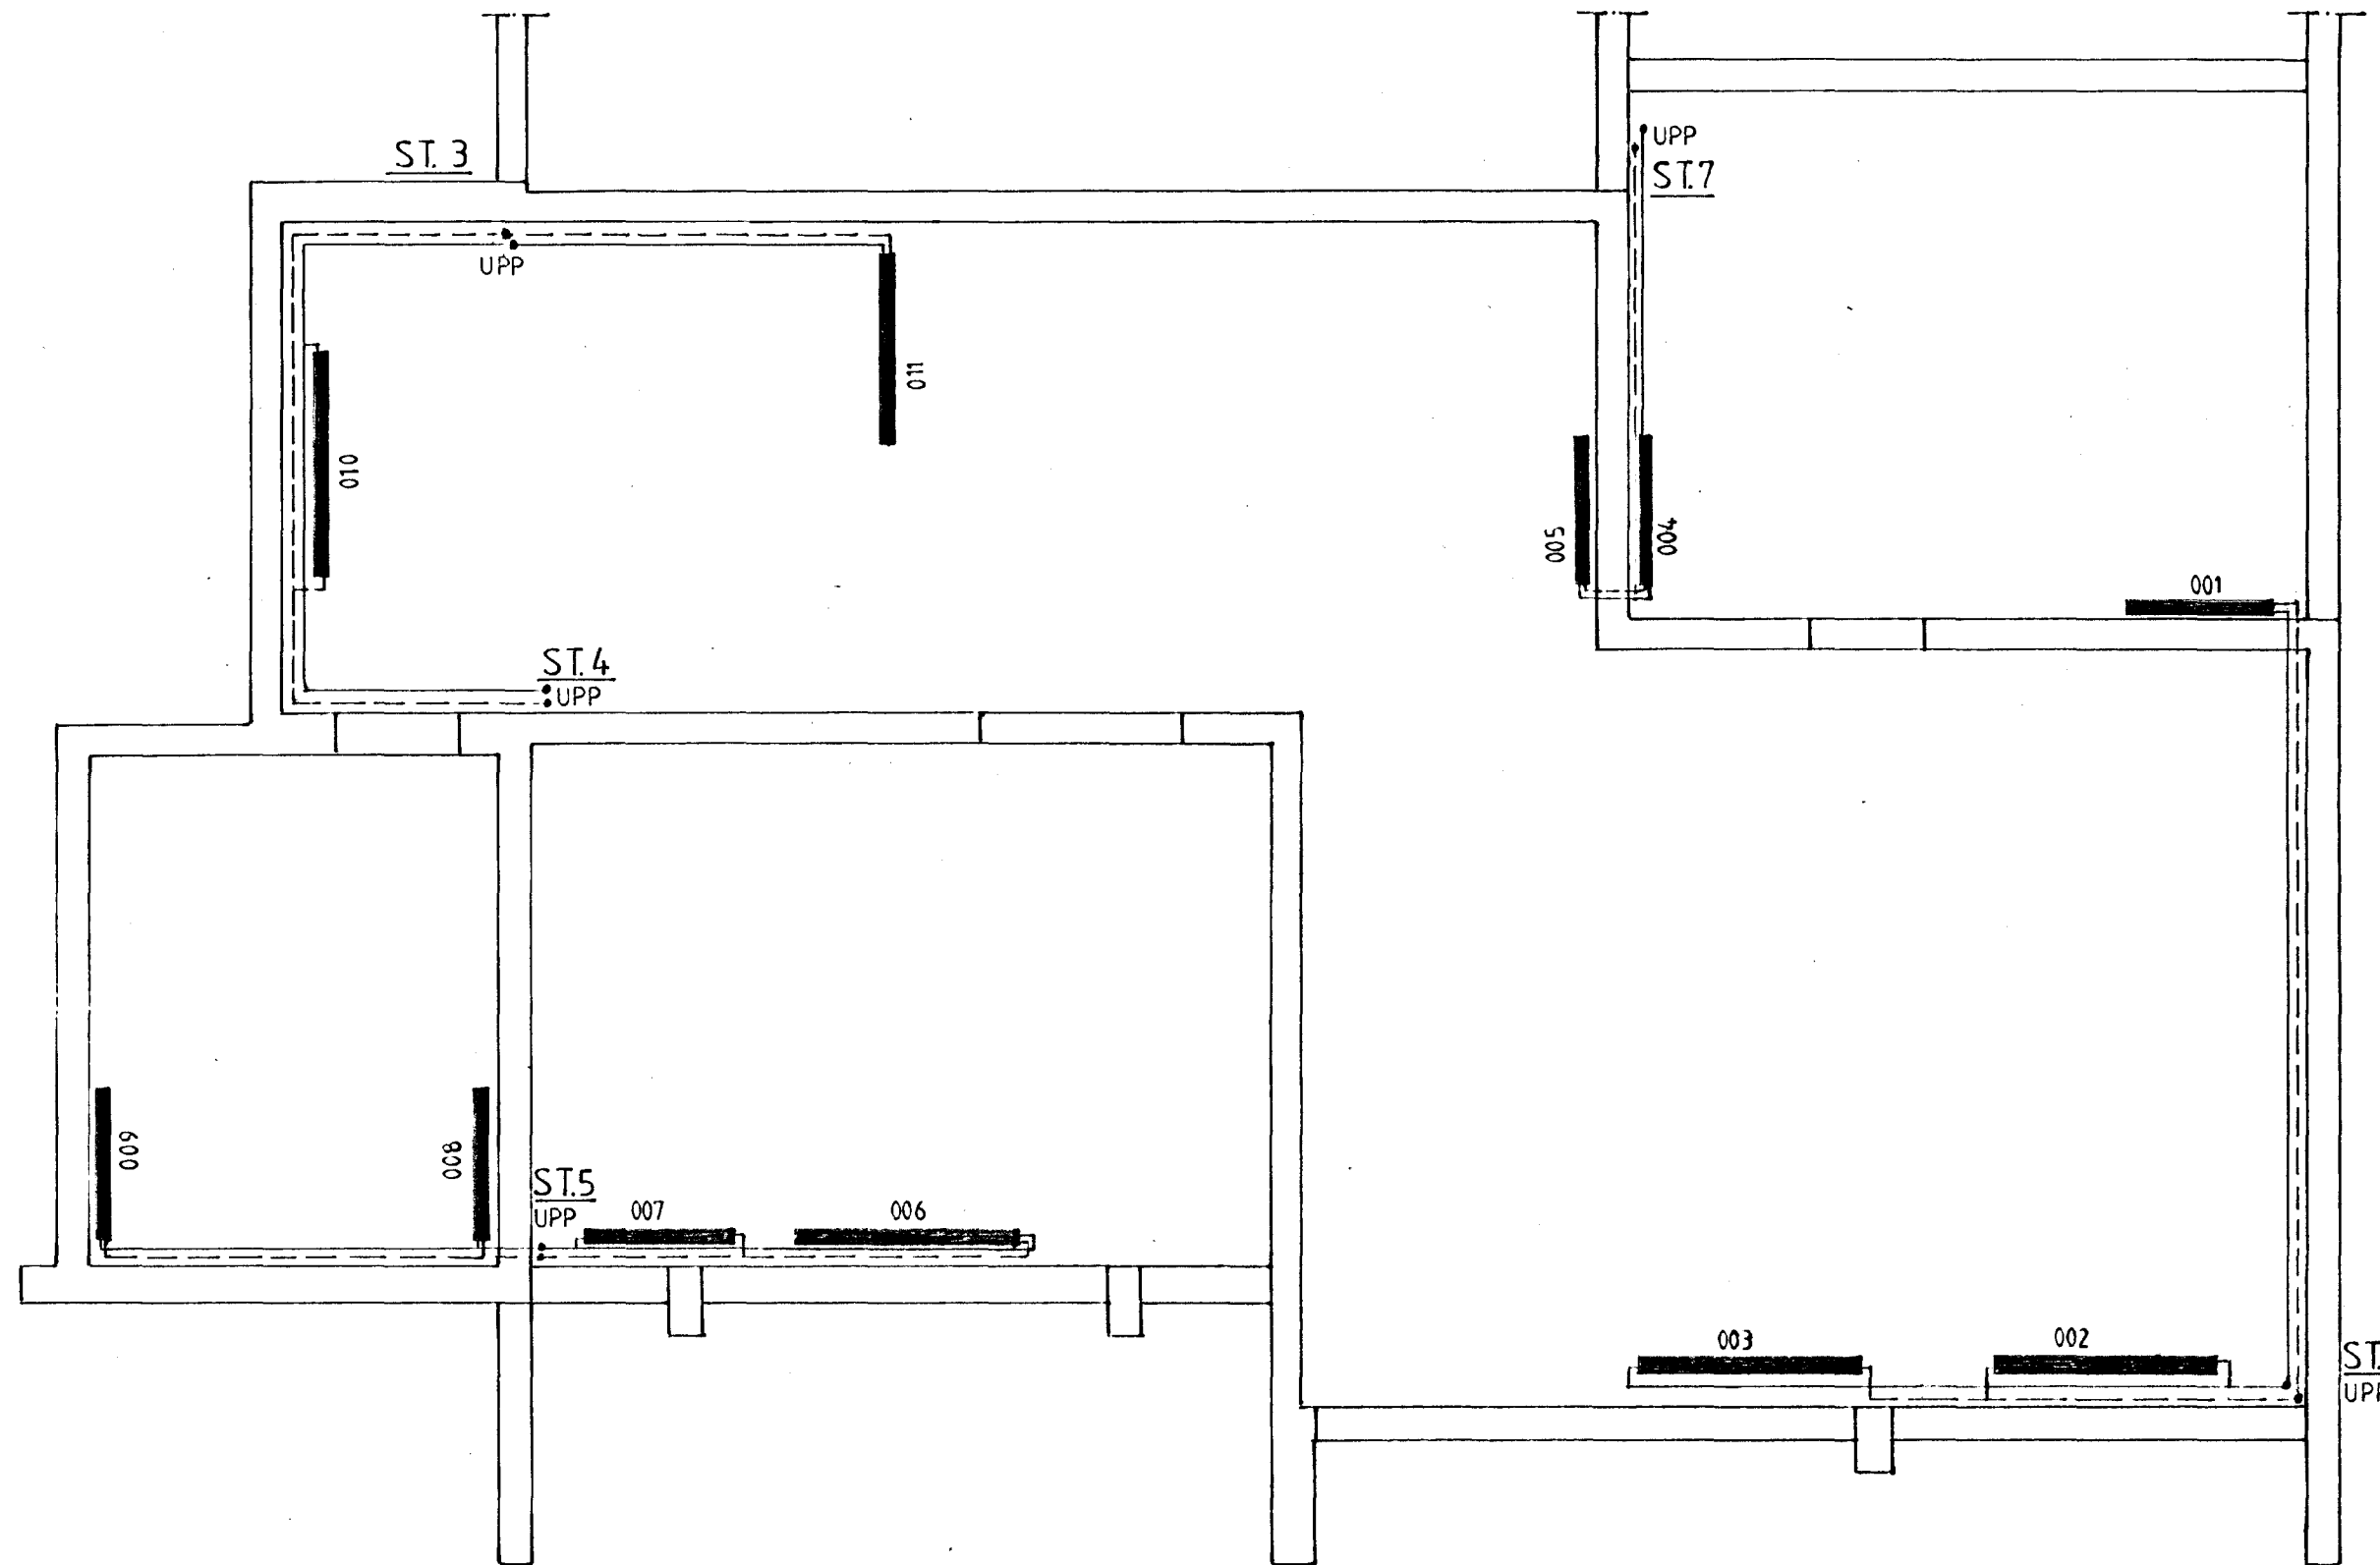

NR.	VARMA- ÞÖRF KCAL/KLST	OFNSKOT.		TENG- ING.	VALDIR OFNAR.	HITA GJÖF KCAL/KLST
		HÆD.	LENGD.			
001	500	50	70	A - B		
002	1500	50	200	A - D		
003	1500	50	200	C - B		
004	1000	50	130	A - B		
005	800	50	100	C - D		
006	1400	28	150	C - D		
007	600	50	80	A - D		
008	800	50	100	C - D		
009	500	50	70	A - B		
010	1200	50	160	C - B		
011	800	50	100	C - D		

$\Delta T = 40^\circ C$

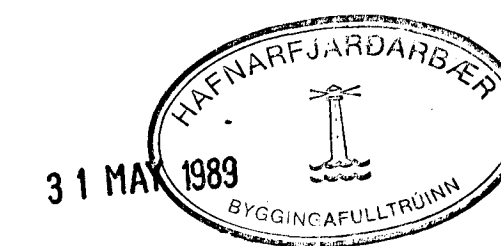

Br.	Dags.	Breyting varðar.
Verkfræðipjónusta Guðmundar Óskarssonar Ráðgefandi verkfræðingar Laugavegur 18, Reykjavík. Sími 15945		
LJÓSABERG 2, HAFNAFIROI		
HITI GRUNNMYND		
Reykjavík:		MAI 1989
Teikn:	Á.G.	Kvarði: 1:50
Reikn:	G.Ó.	Verk nr.:
Yfirt:		Bl. nr.:
Samþ:	G/O	234