


MARK	ROD BRACING LENGTH	DIAM
6R001	8114	10
6R002	9523	16
6R003	9515	16
7R004	8642	16
7R005	8842	13
7R006	8636	16

All Dimensions are millimeters [mm.] -Unless Noted

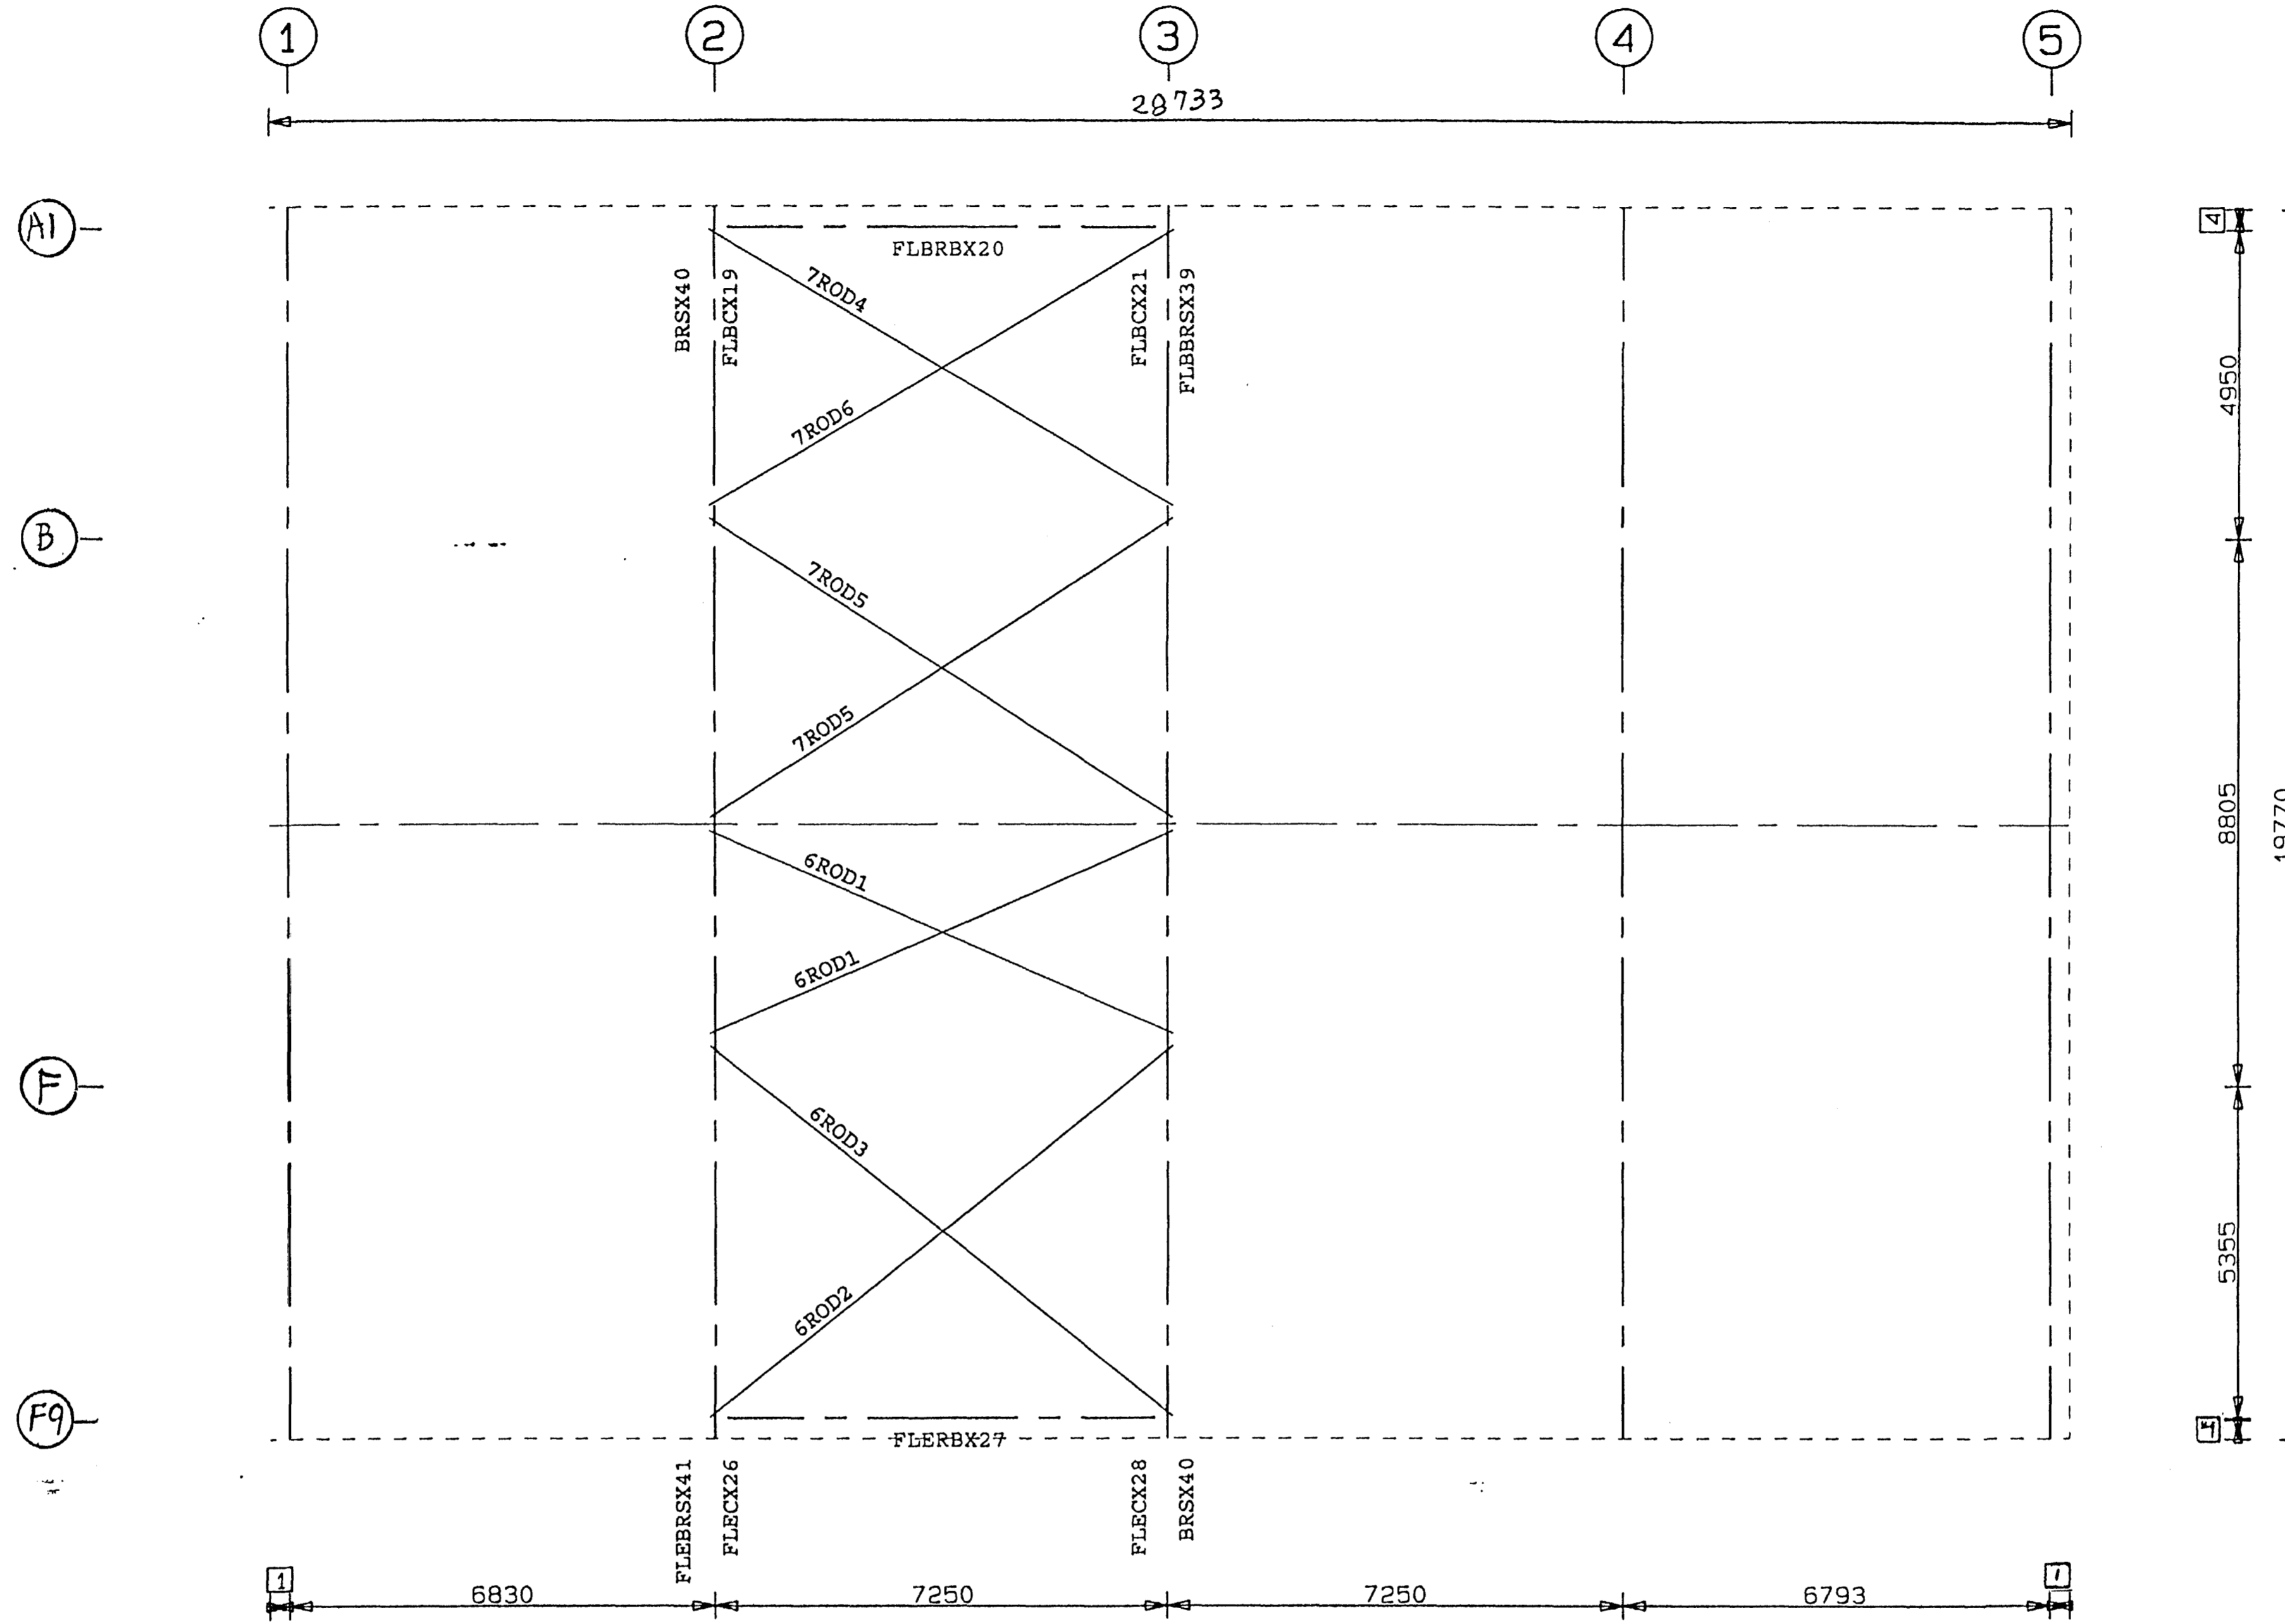

4 330

1 305

On: filesrv Projky: 38890 Bldg: 1 Plane: 6,7

Verkfæðistofa Norðurlands ehf.
Hofsbót 4 600 Akureyri. kt. 560175-0869
Eiríkur Jónsson byggingaverkfr.
kt. 051045-4679

VERKFAEÐISTOFA NORÐURLANDS ehf.

Byggingaútlitir Hafnarfjarðar
Atgætt bann
20 MARS 2001
Sigurbjartur Halldórsson

This Drawing is Sealed only as to the Components furnished by VP Buildings

Building Code:	86MBMA	This Drawing, including the information hereon, remains the property of VP Buildings. It is provided for Erecting the Building described in the applicable Purchase Order and shall not be modified, reproduced or used for any other purpose without prior written Approval of VP Buildings. The General Contractor and/or Erector is solely responsible for accurate, good Quality Workmanship in erecting this Building in conformance with this Drawing. Details referenced in this Drawing all apply, including VP Buildings Erection Details and all Industry Standards pertaining to proper erection, including the correct use of temporary bracing.
Live Ld (W/Trib Red)	102.5 kgsm	
Coll. Ld (gravity):	24.4 kgsm	
Coll. Ld (uplift):	0.0 kgsm	
Wind Speed:	170.6 kmph	
Wind Exp. Cat.:	C	
Ground Snow:	146.5 kgsm	
Roof Snow:	102.5 kgsm	
Snow Exp. Cat.:	3	
Seismic Zone:	3	
Building Use Cat.:	1	
Auxiliary Loads	NONE	

REV	DATE	BY	DESC.	BUILDER
				Varco-Pruden Exports
				CUSTOMER Sindri
				LOCATION Iceland,
				PROJECT Sindri Workshop
				BUILDING workshop 1
SCALE				NTS

QUOTE #	ME99012531-001	ME9970314-01-OE
JOB #		
DATE	07/26/99	
TIME	07:45	
DRAW/CHECK	DHG	
PAGE	11-	

