
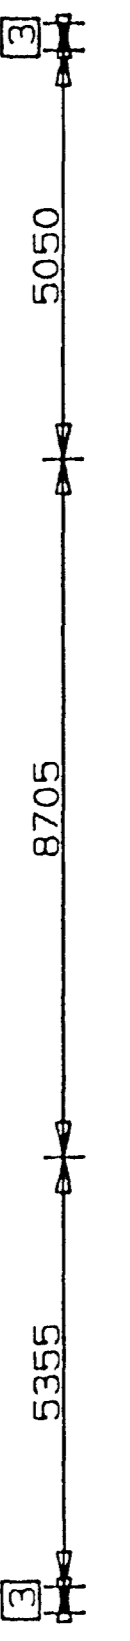


MARK	ROD BRACING LENGTH	DIAM
6ROD1	8114	10
6ROD2	9510	10
6ROD5	9574	10
6ROD8	9605	10
7ROD3	8630	10
7ROD4	8842	10
7ROD6	8630	13
7ROD7	8669	13

All Dimensions are millimeters [mm.] -Unless Noted

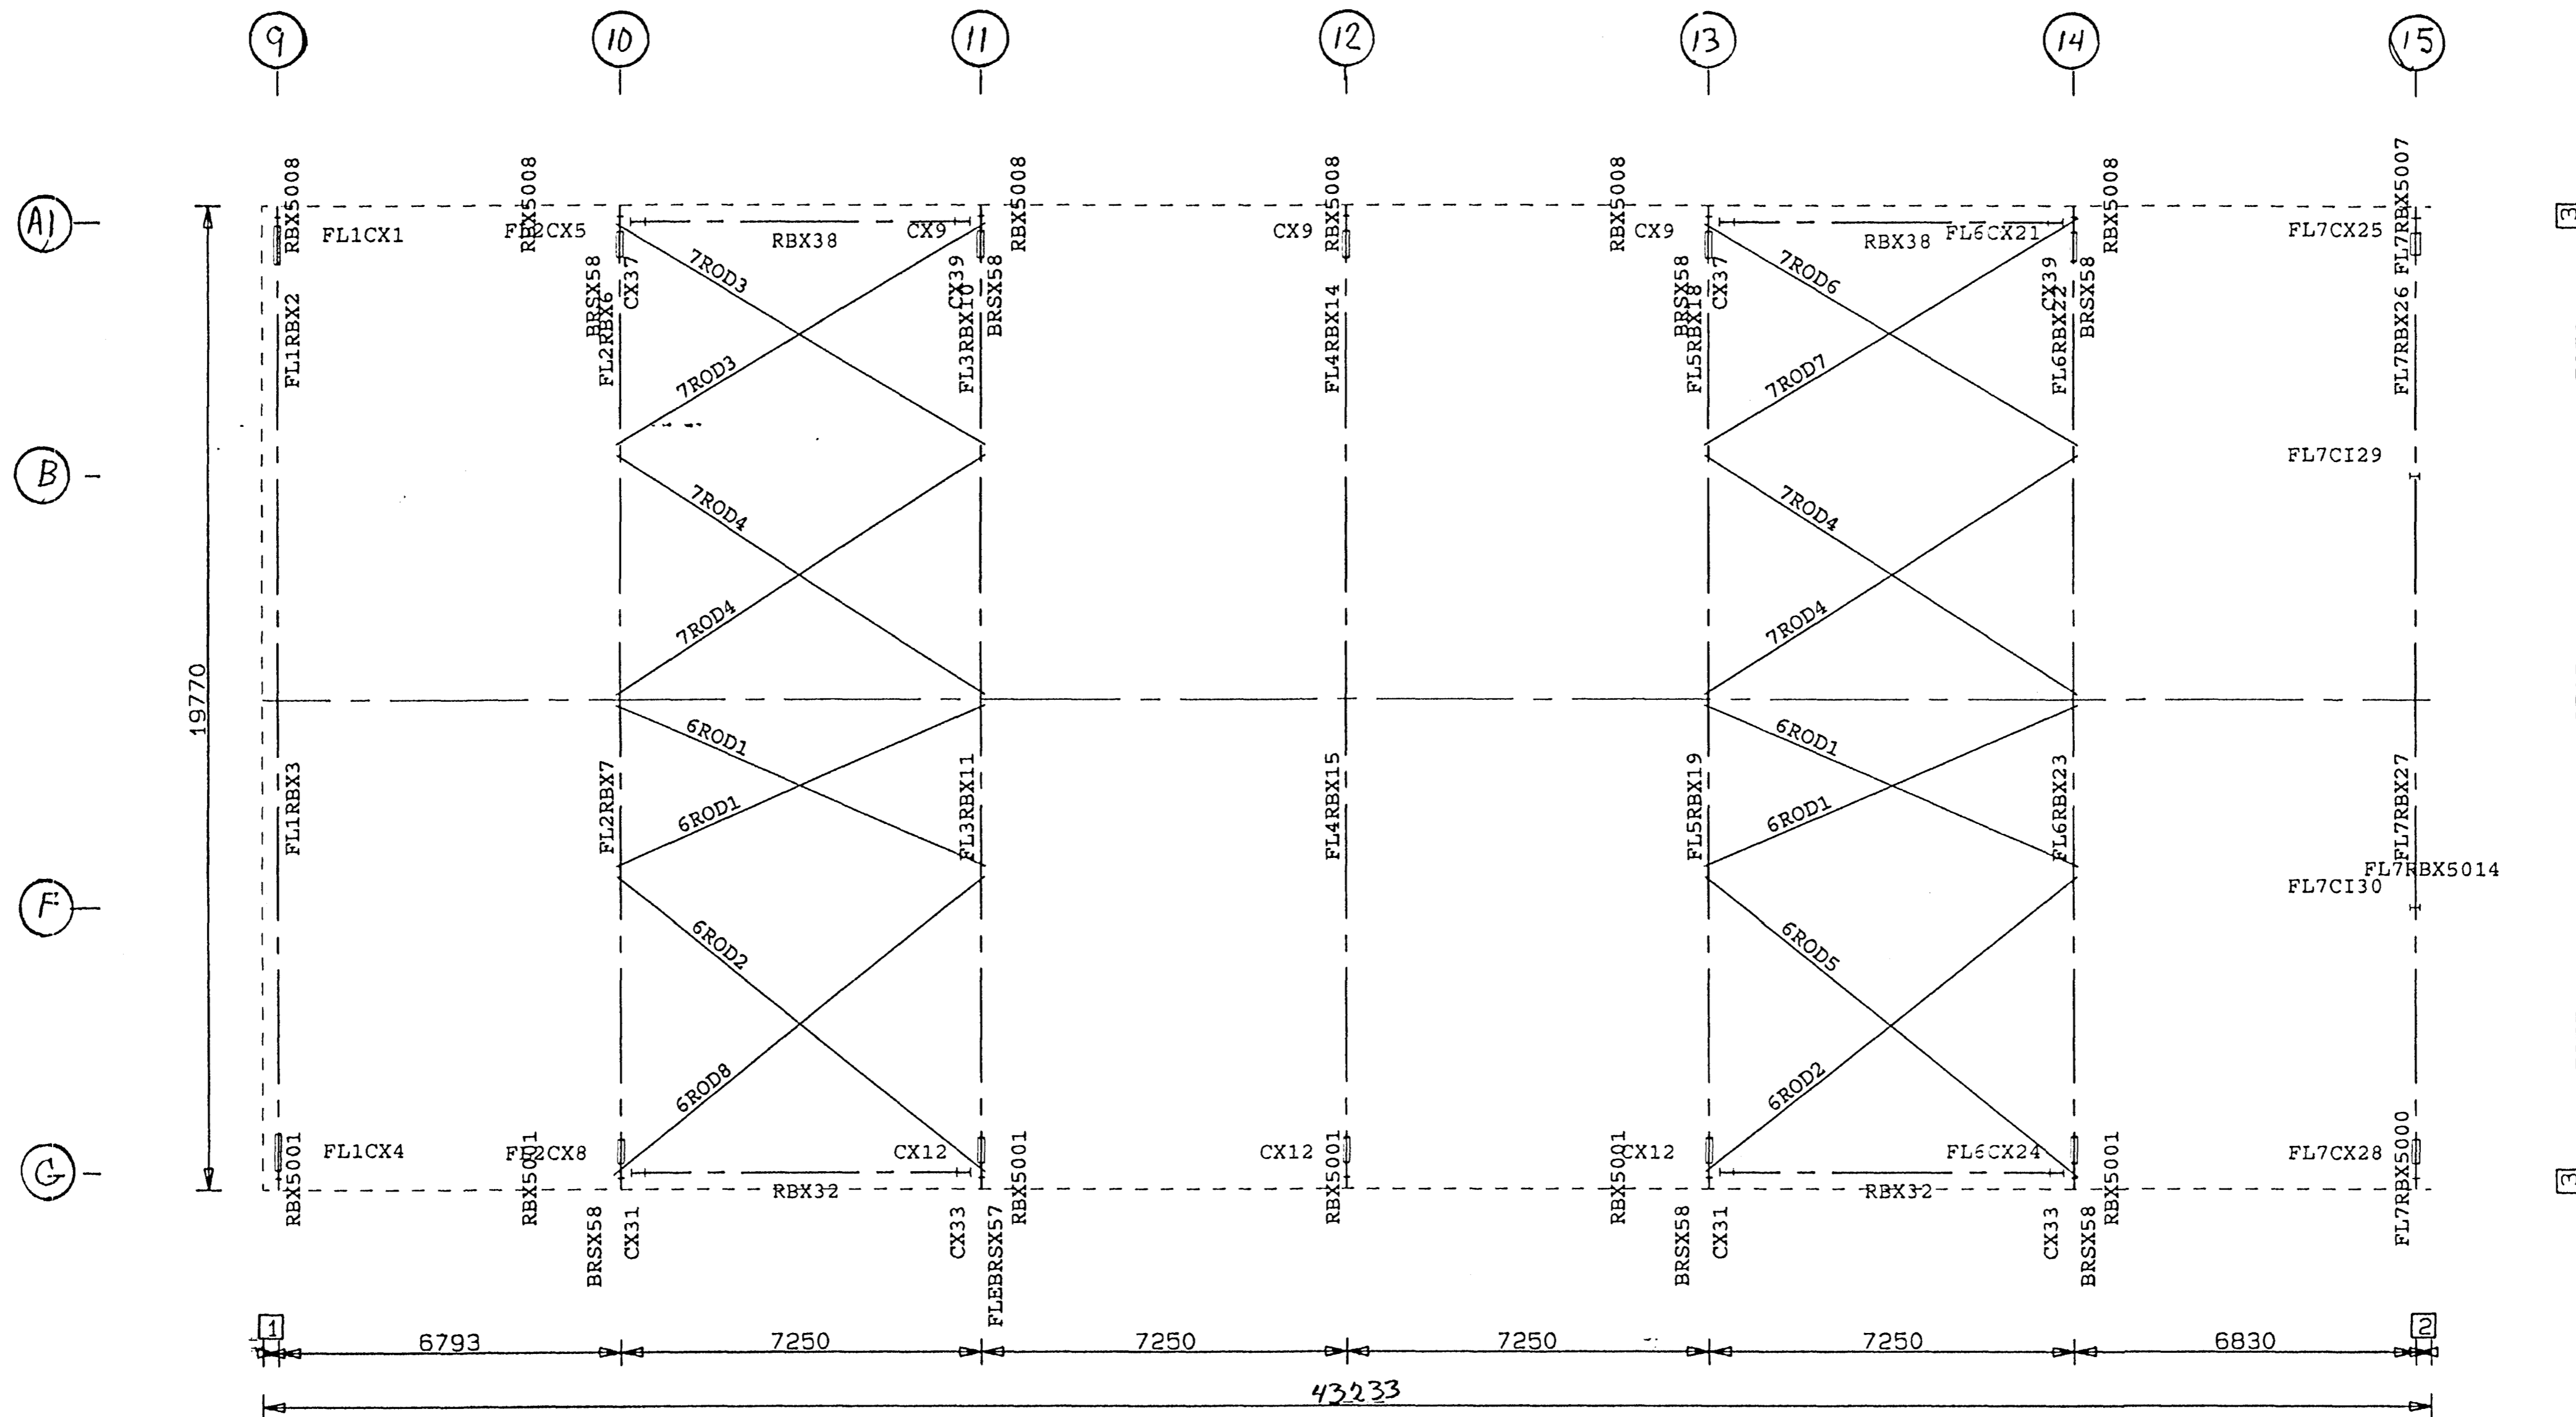

- 3 330
- 2 305
- 1 305

On: filesrv Projky: 38890 Bldg: 2 Plane: 6,7

This Drawing is Sealed only as to the Components furnished by VP Buildings


- A325 HIGH STRENGTH BOLTS SHALL BE TIGHTENED IN ACCORDANCE WITH THE NOVEMBER 13, 1985, ALLOWABLE STRESS DESIGN "SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS" SECTION B. (d) (1) "TURN-OF-NUT TIGHTENING".
- USE 1/2" DIA. A307 BOLTS FOR PURLIN TO FRAME, GIRT TO FRAME, AND GIRT TO CLIP CONNECTIONS UNLESS NOTED OTHERWISE. SEE JOB DETAILS FOR BOLT LENGTHS.
- INSTALLATION OF ADEQUATE TEMPORARY BRACING FOR USE UNTIL CONSTRUCTION IS COMPLETE, IS THE RESPONSIBILITY OF THE ERECTOR.

Building Code:	86MBMA
Live Ld (W/Trib Red)	102.5 kgsm
Coll. Ld (gravity):	24.4 kgsm
Coll. Ld (uplift):	0.0 kgsm
Wind Speed:	170.6 Xmph
Wind Exp. Cat.:	C
Ground Snow:	146.5 kgsm
Roof Snow:	102.5 kgsm
Snow Exp. Cat.:	3
Seismic Zone:	3
Building Use Cat.:	1
Auxiliary Loads	NONE

This Drawing, including the information hereon, remains the property of VP Buildings. It is provided for Erecting the Building described in the applicable Purchase Order and shall not be modified, reproduced or used for any other purpose without prior Written Approval of VP Buildings. The General Contractor and/or Erector is solely responsible for accurate, good quality workmanship in erecting this Building in conformance with the Drawing. Details referenced in this Drawing, all applicable VP Buildings Erection Details and all industry standards pertaining to proper erection, including the correct use of temporary bracing.

REV	DATE	BY	DESC.	BUILDER
				Varco-Pruden Exports
				CUSTOMER: Sindri
				LOCATION: Iceland,
				PROJECT: Sindri Workshop
				BUILDING: workshop 2

QUOTE #	ME99012531-001	JOB #	ME 9970314-02-021
DATE	07/26/99	TIME	08:38
DRAW/CHECK	DAG	PAGE	1/2

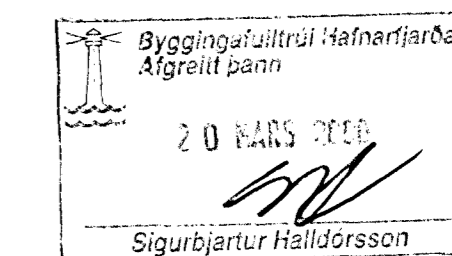

Verkfræðistofa Norðurlands ehf.
Höfðabót 4 600 Akureyri. kt. 560175-0869
Eiríkur Jónsson byggingaverkf. kt. 051045-4679

VERKFRÆÐISTOFA NORÐURLANDS ehf.