


SECONDARY				SECONDARY				SECONDARY				FRAMED OPENINGS					
MARK	LENGTH	THK	DEPTH	MARK	LENGTH	THK	DEPTH	MARK	LENGTH	THK	DEPTH	FO#	-LOC-	MARK	LENGTH	THK	DEPTH
3ZG20000	332	1.5 mm	216 mm	3ZG20005	7096	1.5 mm	216 mm	ZG12	581	1.5 mm	216 mm	1	JAMBL	CW187	4910	2.7 mm	216 mm
3FBW92	6741	1.9 mm	216 mm	3ZG20008	6655	1.5 mm	216 mm	ZG14	7085	1.5 mm	216 mm	1	JAMBR	FBW189	4910	1.5 mm	216 mm
3FBW97	6704	1.9 mm	216 mm	3ZG37	6655	1.5 mm	216 mm	ZG2	1555	1.5 mm	216 mm	2	JAMBL	(2) 22CW103	4910	2.7 mm	
3PGHW18	7095	1.5 mm	216 mm	3ZG9	6655	1.5 mm	216 mm	ZG20007	6664	1.5 mm	216 mm	2	JAMBR	(2) 22FBW102	4910	1.5 mm	
3PGHW35	7112	1.5 mm	216 mm	FBW93	7085	1.9 mm	216 mm	ZG3	7085	1.5 mm	216 mm	3	JAMBL	CW191	2100	1.5 mm	216 mm
3ZG1	6637	1.5 mm	216 mm	FBW94	7085	1.7 mm	216 mm	ZG40	3021	1.5 mm	216 mm	3	JAMBR	CW191	2100	1.5 mm	216 mm
3ZG11	6637	1.5 mm	216 mm	PGHW20	7237	1.5 mm	216 mm	ZG45	2046	1.5 mm	216 mm	4	JAMBL	CW193	2248	1.5 mm	216 mm
3ZG20002	6637	1.5 mm	216 mm	ZG0	656	1.5 mm	216 mm	ZG71	7085	1.5 mm	216 mm	4	JAMBR	CW193	2248	1.5 mm	216 mm
3ZG20003	7085	1.5 mm	216 mm	ZG116	958	1.5 mm	216 mm										

INSULATION

MARK	LENGTH	WIDTH	THLK	TRP	FACING
BLK1	6400	914	102	BLK	WU
BLK5	1524	914	102	BLK	WV

NOTE: FIELD LOCATE ALL OPENINGS THAT IS NOT DIM (TRP ALL OPENINGS)

All Dimensions are millimeters [mm.] -Unless Noted

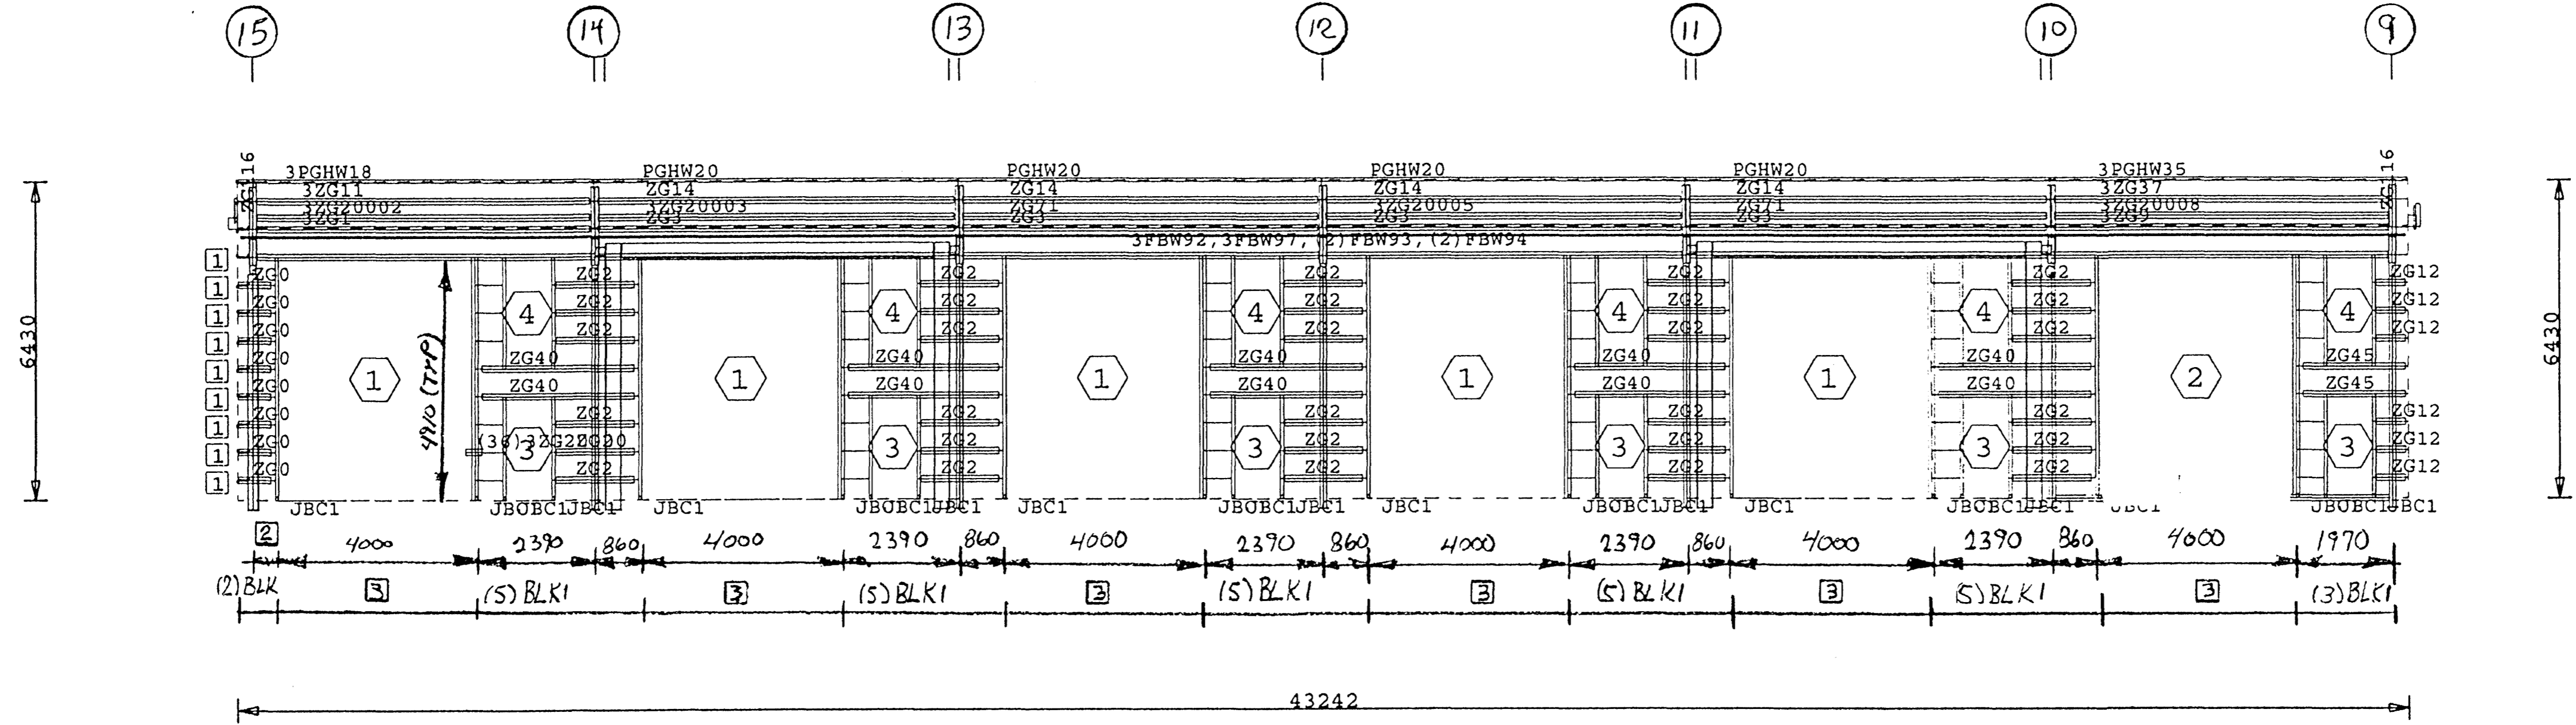

WALL ELEVATION AT WB

3) BLK5
2) 403
1) GCC072084

Byggingulitillit Halmfarðar
Algrætt þann
20 MARS 2000
Sigurbjartur Halldórsson

VERKFRÆÐISTOFNA NDORULANDS ehf.

On: filesrv Projky: 38890 Bldg: 2 Plane: 3

This Drawing is Sealed only as to the Components furnished by VP Buildings

1. UNLESS NOTED, USE 1/2" DIAMETER A-307 BOLTS FOR GIRT LAP, GIRT TO FRAME, FLANGE BRACE TO FRAME, FLANGE BRACE TO GIRT, JAMB AND HEADER CONNECTIONS. SEE JOB DETAILS FOR BOLT LENGTHS.
2. WIND AND FLANGE BRACING ARE AN INTEGRAL PART OF THE WALL STRUCTURAL SYSTEM AND SHOULD BE PROPERLY INSTALLED PRIOR TO ERECTION OF WALL AND ROOF SHEETS. REMOVAL OR ALTERATION OF WALL BRACING WITHOUT PRIOR AUTHORIZATION IS PROHIBITED.

Building Code:	86MBMA	This Drawing, including the information hereon, remains the property of VP Buildings. It is provided for Erecting the Building described in the applicable Purchase Order and shall not be modified, reproduced or used for any other purpose without prior written approval of VP Buildings. The General Contractor and/or Erector is solely responsible for accurate, good quality workmanship in erecting this building in accordance with this Drawing. Details referenced in this Drawing, all applicable VP Buildings Erection Details and all industry standards pertaining to proper erection, including the correct use of temporary bracing.
Live Ld (W/Trib Red)	102.5 kgsm	
Coll. Ld (gravity):	24.4 kgsm	
Coll. Ld (uplift):	0.0 kgsm	
Wind Speed:	170.6 kmph	
Wind Exp. Cat.:	C	
Ground Snow:	146.5 kgsm	
Roof Snow:	102.5 kgsm	
Snow Exp. Cat.:	3	
Seismic Zone:	3	
Building Use Cat.:	1	
Auxiliary Loads	NONE	

REV	DATE	BY	DESC.	BUILCER
				Varco-Pruden Exports
				Sindri
				Iceland,
				Sindri Workshop
				workshop 2

QUOTE #	ME99012531-001	JOB #	--1
		DATE	08/16/99
		TIME	03:19
		DRAW/CHECK	
		PAGE	19

