


All Dimensions are millimeters [mm.] - Unless Noted

FO#	-LOC-	MARK	LENGTH	THK	DEPTH
1	HEADR	CW122	1050	1.5 mm	216 mm
1	JAMBL	CW118	2094	1.5 mm	216 mm
1	JAMBR	CW118	2094	1.5 mm	216 mm

MARK	LENGTH	THK	DEPTH
3CG18	2320	1.5 mm	216 mm
3CG19	3857	1.5 mm	216 mm
3CG20	3937	1.5 mm	216 mm
3CG21	2240	1.5 mm	216 mm
3ZG14	2320	1.5 mm	216 mm
3ZG15	4346	1.5 mm	216 mm
3ZG16	4426	1.5 mm	216 mm
3ZG17	2240	1.5 mm	216 mm
CG22	7393	3.0 mm	216 mm
CG28	7393	1.9 mm	216 mm
PGHW42	7393	1.5 mm	216 mm
ZG24	7882	1.5 mm	216 mm
ZG34	7876	1.5 mm	216 mm
ZG36	7869	1.5 mm	216 mm
ZG38	7882	1.5 mm	216 mm
ZG40	7882	1.9 mm	216 mm
ZG44	1504	1.7 mm	216 mm
ZG45	1504	1.5 mm	216 mm

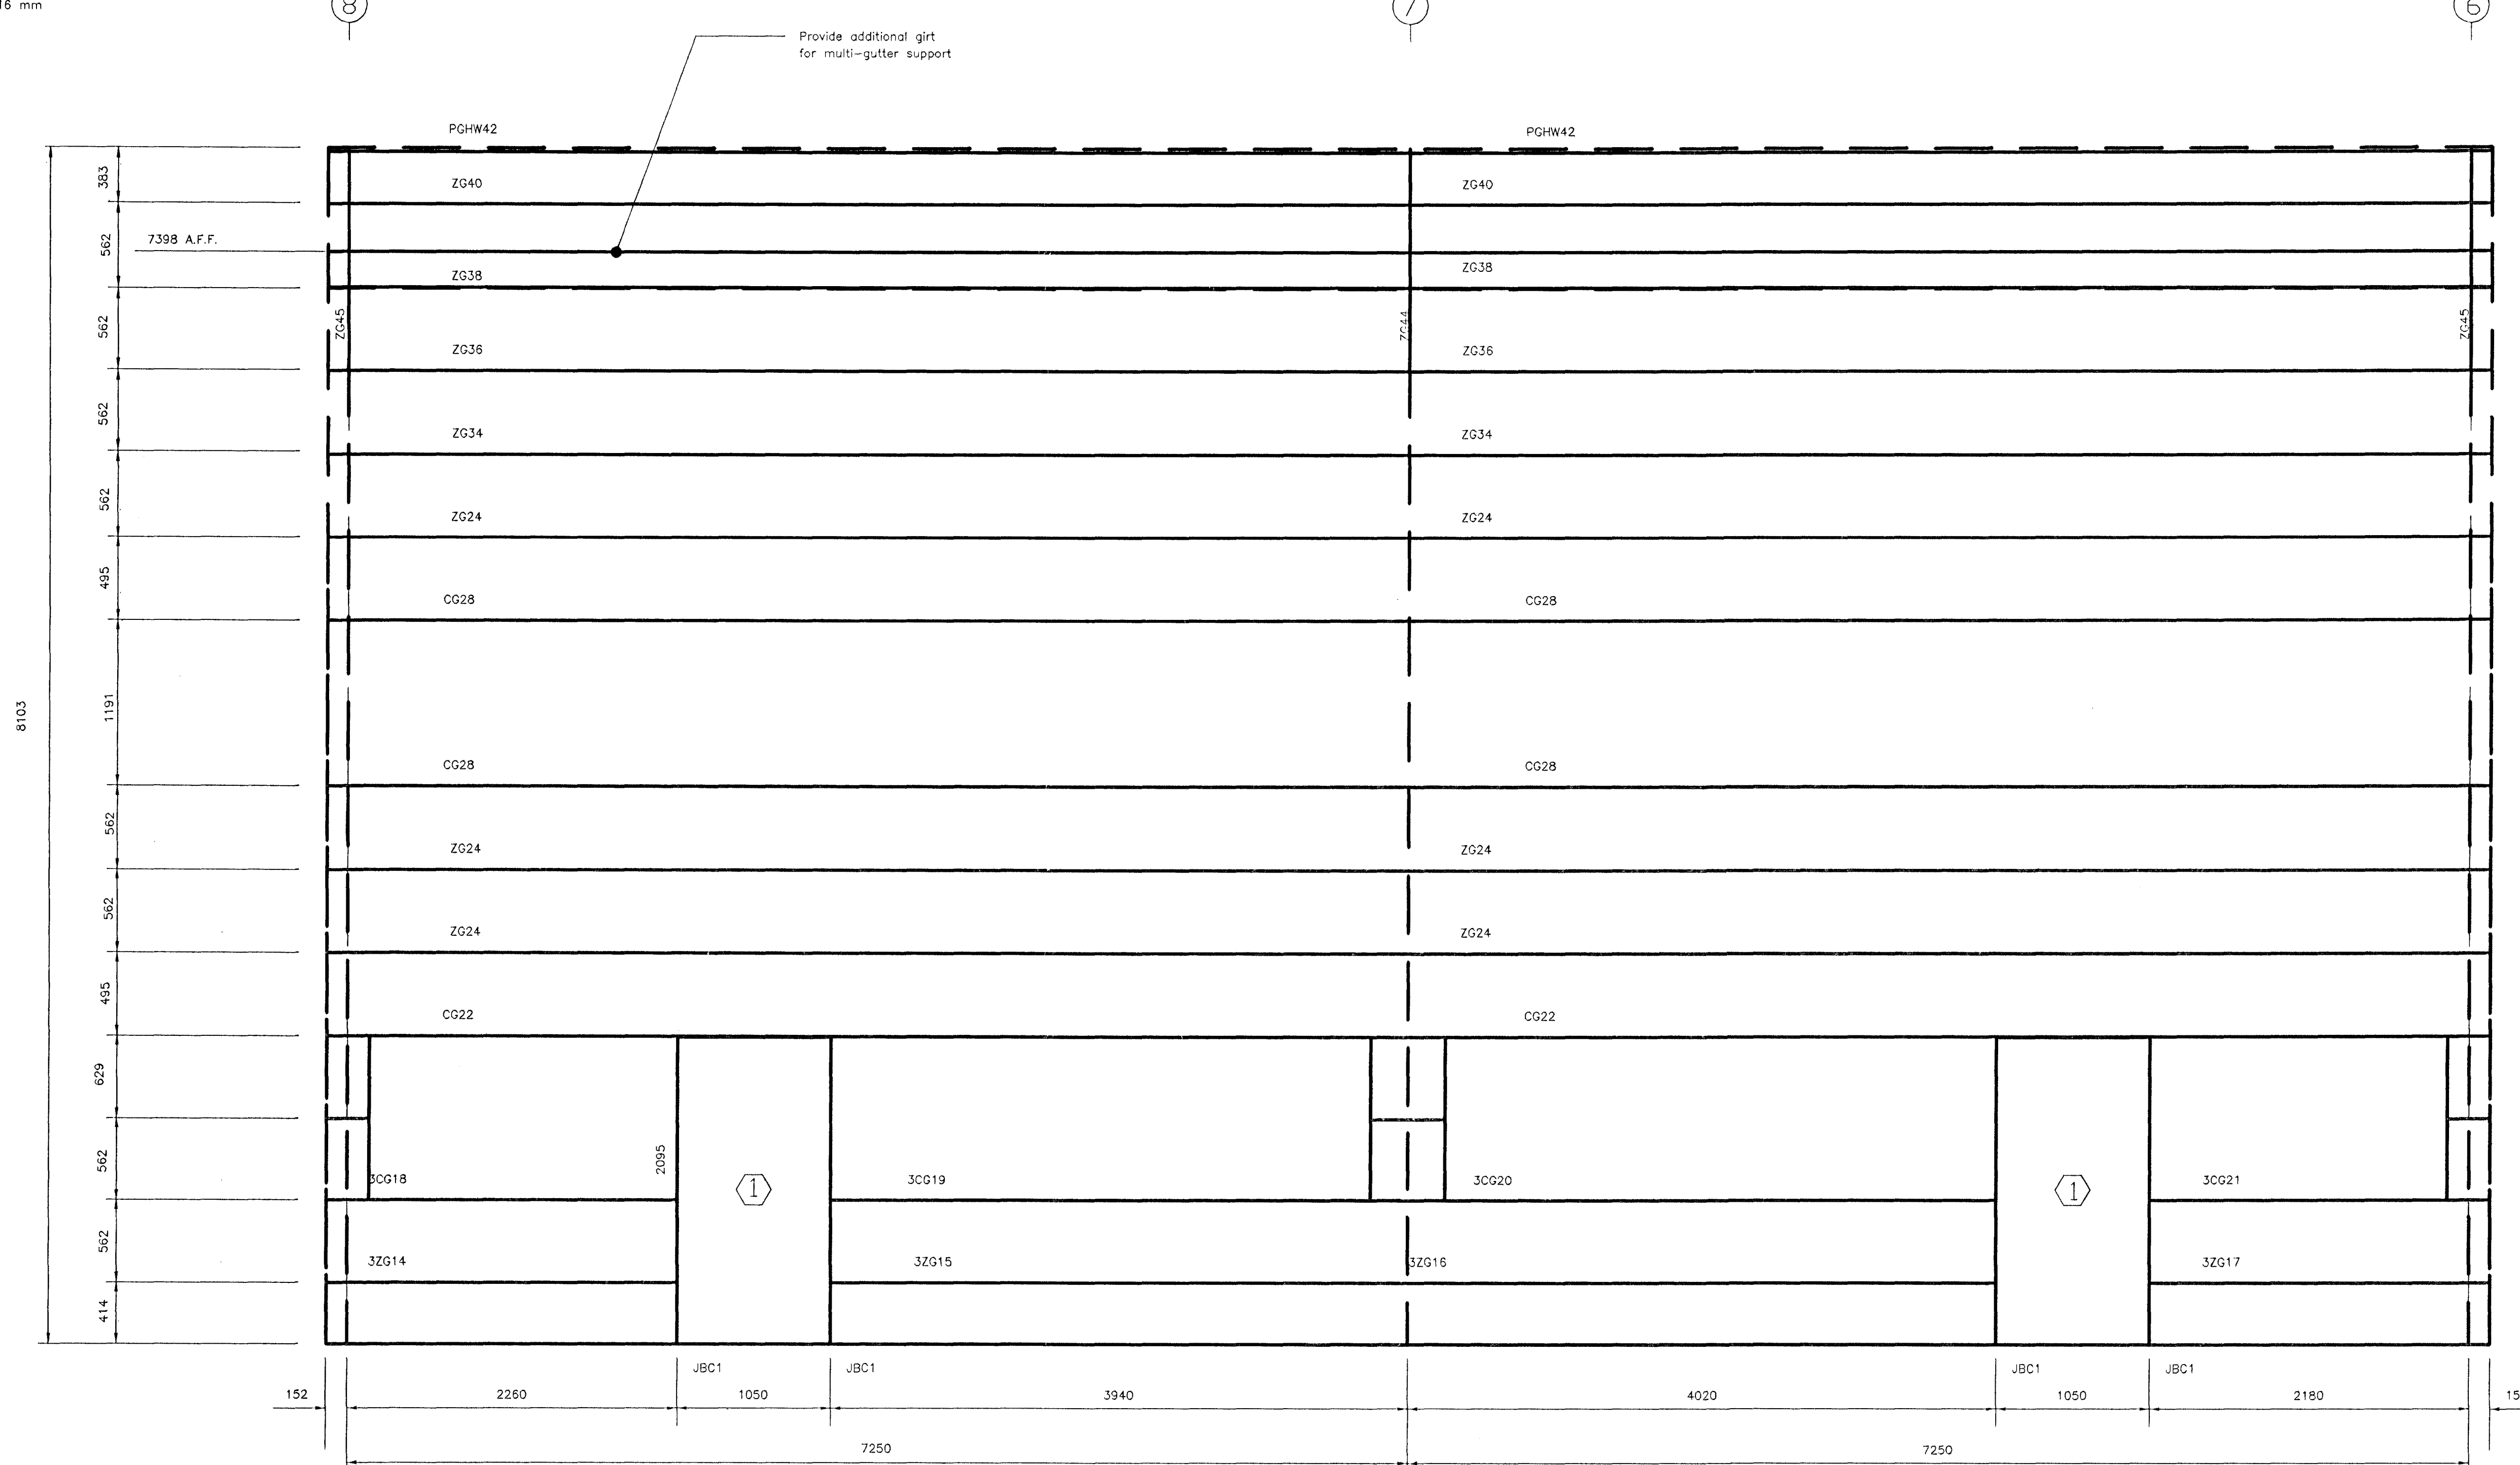

NORTH WALL ELEVATION

This Drawing is Sealed only as to the Components furnished by VP Buildings

SEE DETAIL S2 FOR GIRTS TO COLUMN CONNECTIONS
 SEE DETAIL S4 FOR GIRTS CONNECTIONS AT CORNERS
 SEE DETAIL S9 FOR PARAPET DETAIL ON NORTH AND SOUTH WALLS

Byggingaulltrúi Hámarfjarðar
 Algrætt þann
 20 MARS 2009
 Sæmþykkt sor skýrsla til Kús dags 2/11/09
 Verkfæðistofa Norðurlands ehf
 Hofsbót 4, Akureyri. Kt. 560175-0849
 Eiríkur Jónsson byggingaverkfr. 6.7.
 Kt 051045-4679

On: nasrv Projky: 4687 Bldg: 6 Plane: 3

- UNLESS NOTED, USE 1/2" DIAMETER A-307 BOLTS FOR GIRTS LAP, GIRTS TO FRAME, FLANGE BRACE TO FRAME, FLANGE BRACE TO GIRTS, JAMB AND HEADER CONNECTIONS. SEE JOB DETAILS FOR BOLT LENGTHS.
- WIND AND FLANGE BRACING ARE AN INTEGRAL PART OF THE WALL STRUCTURAL SYSTEM AND SHOULD BE PROPERLY INSTALLED PRIOR TO ERECTION OF WALL AND ROOF SHEETS. REMOVAL OR ALTERATION OF WALL BRACING WITHOUT PRIOR AUTHORIZATION IS PROHIBITED.

Building Code:	06MBMA
Live Ld(W/Trib Red)	205 kgsm
Coll. Ld (gravity):	24.4 kgsm
Coll. Ld (uplift):	0.0 kgsm
Wind Speed:	193 kmph
Wind Exp. Cat.:	C
Ground Snow:	178.6 kgsm
Roof Snow:	102.5 kgsm
Snow Exp. Cat.:	3
Seismic Zone:	3
Building Use Cat.:	4
Auxiliary Loads	NDNE

This Drawing, including the information hereon, remains the property of VP Buildings.
 It is provided for Erecting the Building described in the applicable Purchase Order and shall not be modified, reproduced or used for any other purpose without prior Written Approval of VP Buildings.
 The General Contractor and/or Erector is solely responsible for accurate, good quality workmanship in erecting this Building in conformance with this Drawing, details referenced in this Drawing, all applicable VP Buildings Erection Details and all Industry Standards pertaining to proper erection, including the correct use of temporary bracing.

REV	DATE	BY	DESC.	BUILDER
				CUSTOMER Sindri
				LOCATION Iceland, NC
				PROJECT Sindri Workshop
				BUILDING Office 1

SCALE: NTS

QUOTE #	JOB #
	P9924127
DATE	07/13/99
TIME	16:24
DRAW/CHECK	CW/ME
PAGE	S6.2