



GÓLFHITI

Grunnmynd 1:20


BAD 1

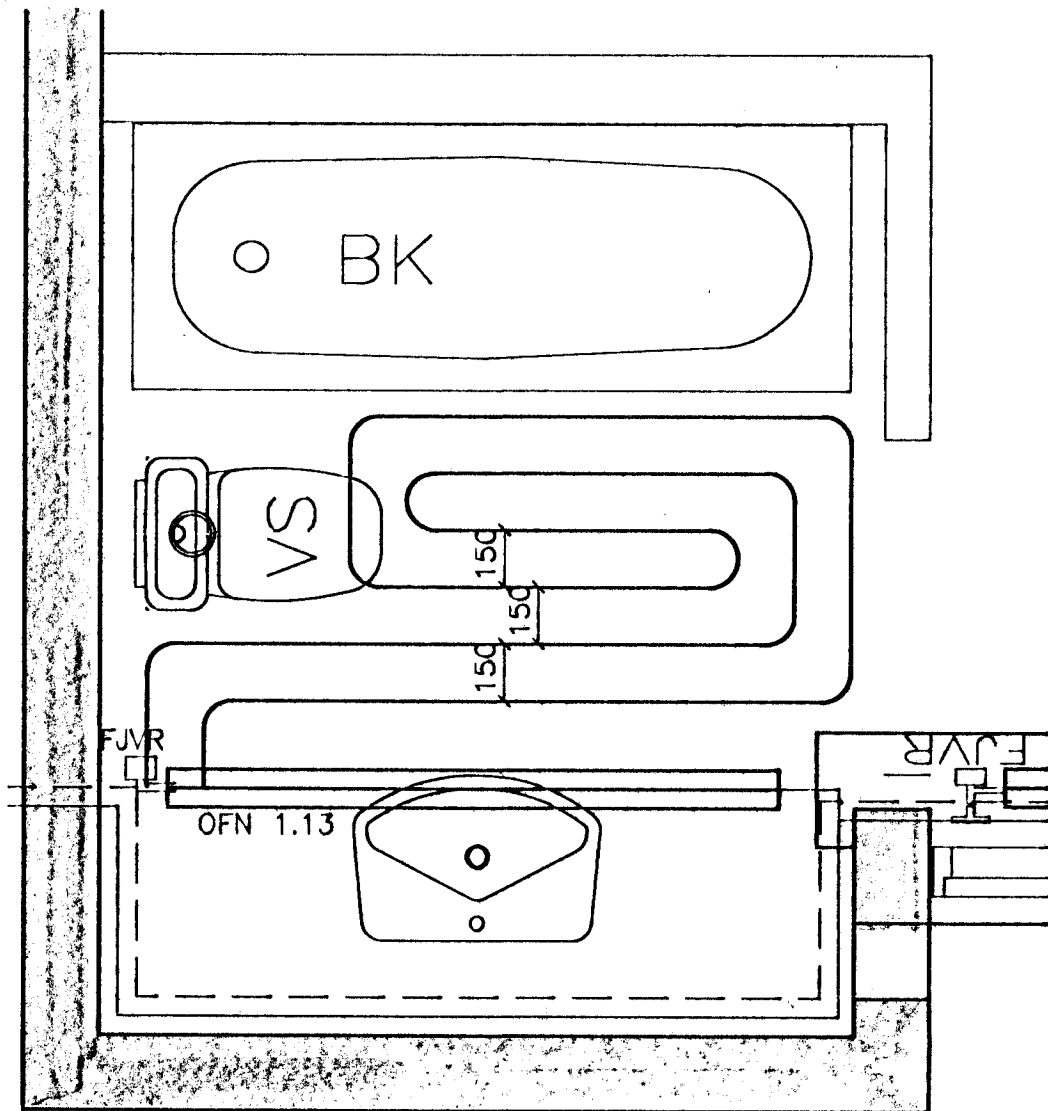


BAD 2

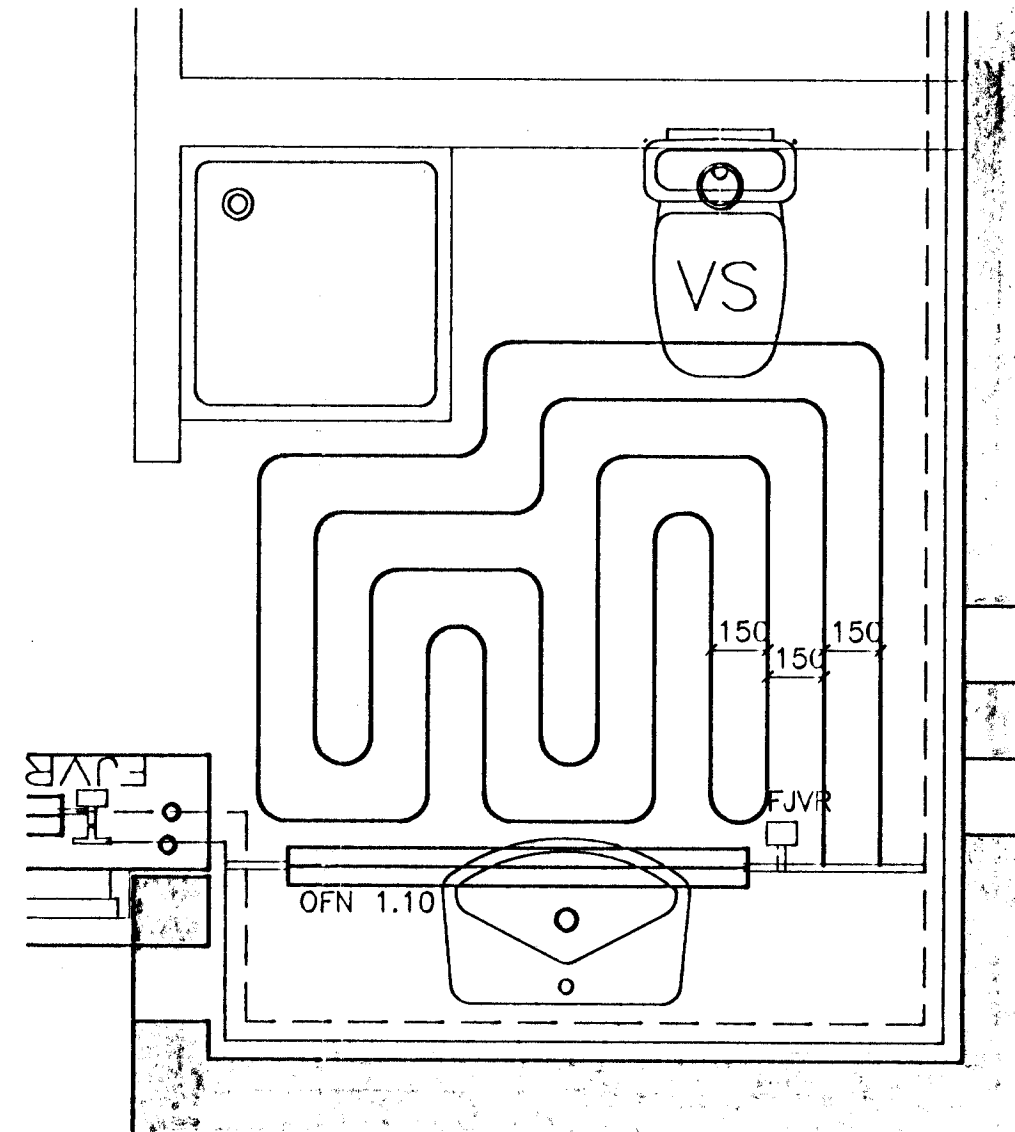

ANDDYRI

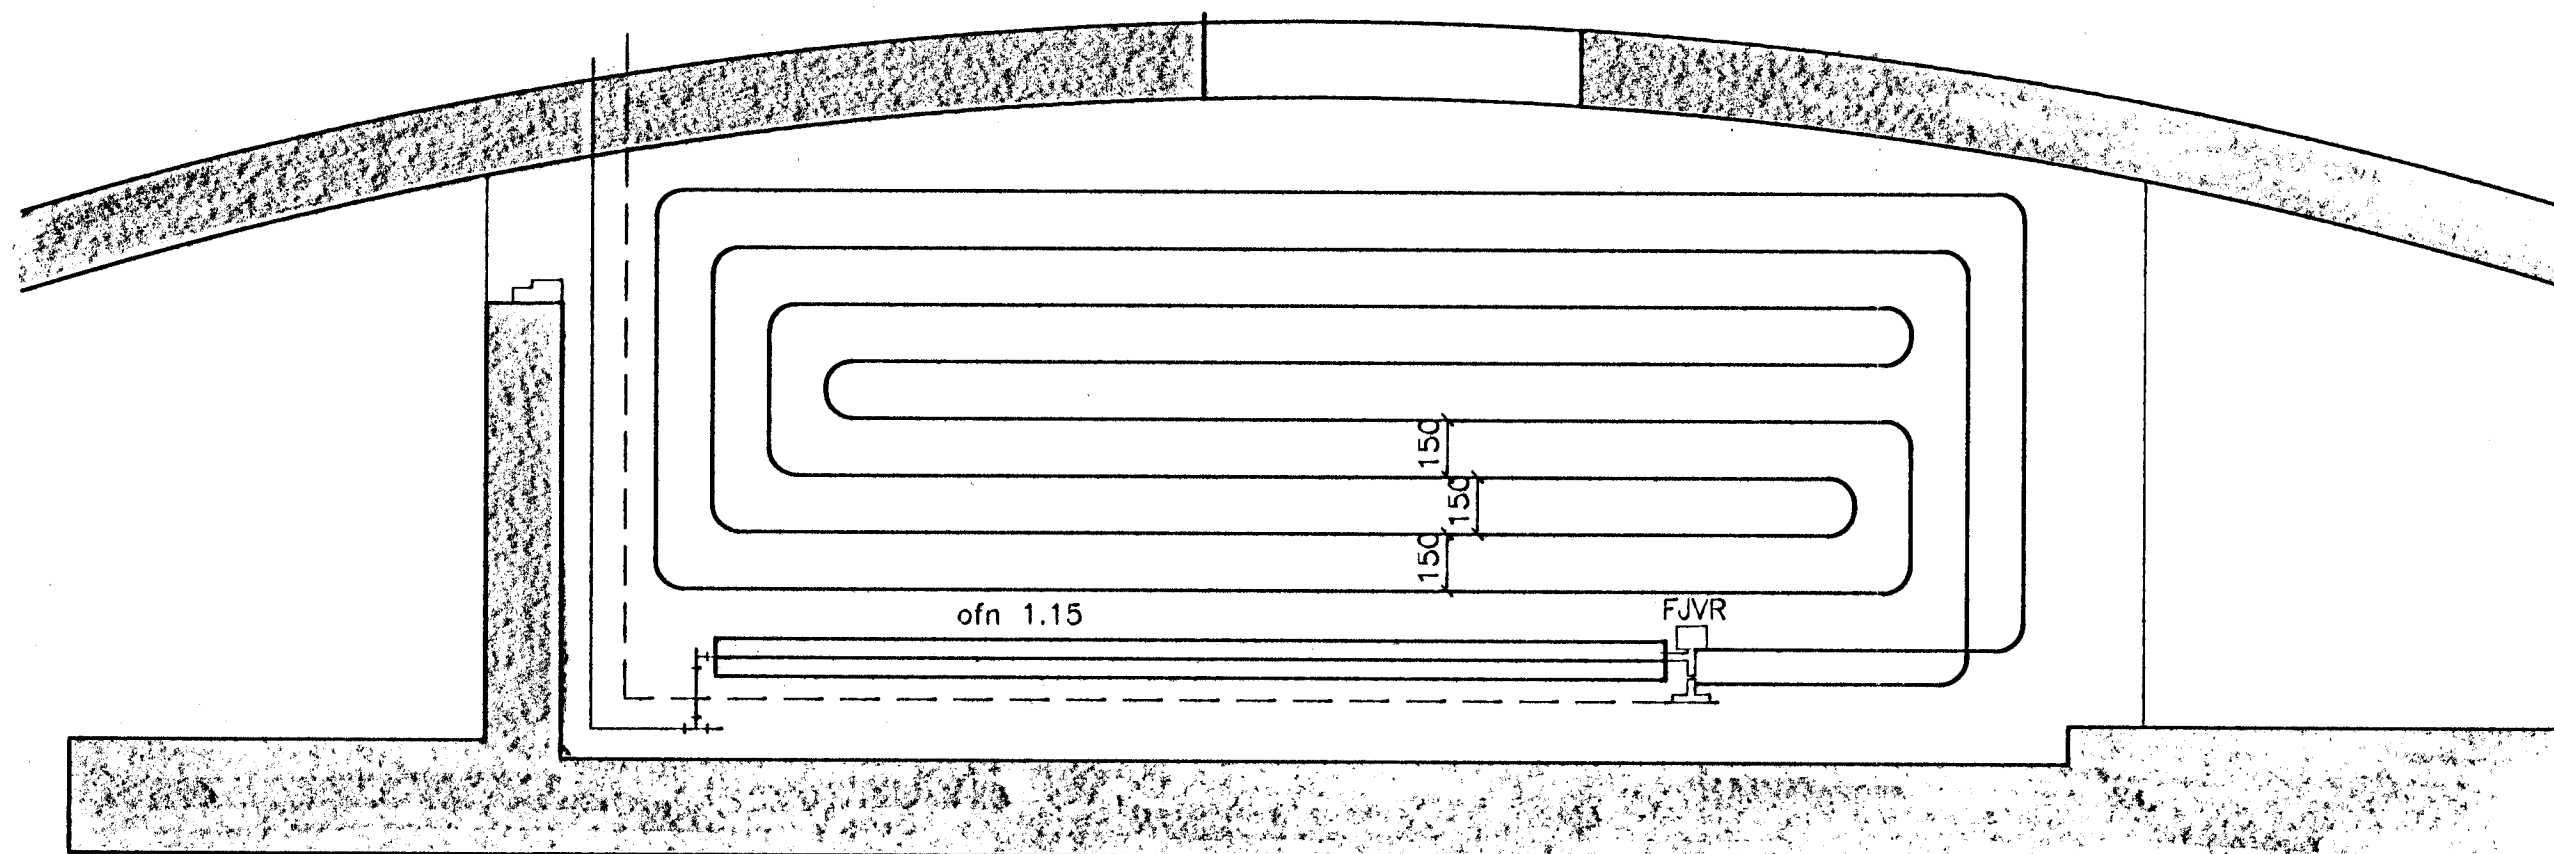

Gólfhitalögn skal vera úr $\varnothing 20$ mm
PEX-rörum c/c 150 mm, og
lögð í gólfilögn.
Lágmarks steypuþykkt ofan á rör
30 mm.
Lögnin skal tengd inn á afrennsli ofns.

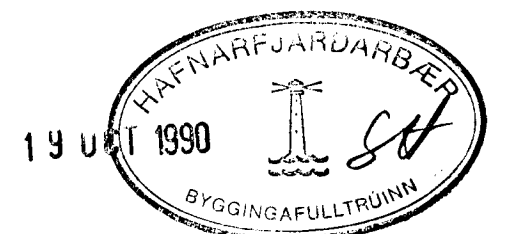

TEKNIÞÓFAN NÝBYLI SIGURÐUR INGI ÓLAFSSON F.T.F.I.
NÝBYLAVEGUR 22 - 200 KÓPAVOGUR SÍMI 91-40098

VERKEFNI MÁVAHRAUN 7, HAFNARFIRÐI

HEITI Hita- og neysluvatnslögn: Gólfhitun

T. UÓ R. Y. KV 1:20

DAGS. September 1990

NR. 162.3.8