


SKÝRINGAR:

AFKOST LOFTRÆSTIKERFIS: 1600 m³/klst
 HRABI 1 LOFTSTOKKUM ≤ 5 m/sek.
 LOFTHTI INNBLASTURS: 5 °C.

1. ENNTAKRIST 400x400 mm.
 SKAL YERA DR. GALV. DJUKKI. VAINSHELD.
 NET YFIR INNTAKI MEÐ MÆKKVASTIÆRD 4 12 mm.
2. HOEJNEING.
 PM-LUFT LACA-1-5-00-0-5 EBA SAMBERIL.
3. SRJALDLOKA.
 PM-LUFT LASA-1-005 EBA SAMBERIL.
4. STA.
 PM-LUFT LAPA-1-005-4 EBA SAMBERIL.
 FILTER G85.
5. HOLF EYRIK MÖSULEIKA A HITARA.
 (PM-LUFT LALD-1-005-1 (RAFDRIFINN) EBA SAHSV.)
6. SUGARI.
 PM-LUFT LARF-1-005-0-1-1 EBA SAMBERIL.
7. INNKASTRIST 200x200 mm.

SKÝRINGAR

ALMENNAR SKÝRINGAR 57A BL 3-01

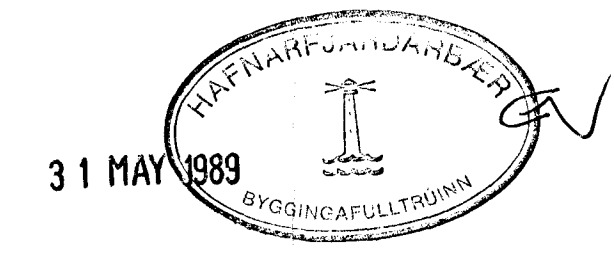

AR. NR.	DAGS	EDLI BREVINGAR	SIGN.
OLDUGATA 39, HAFNARFJÖRÐUR. LOFTRÆSTING, EFTRI HÆÐ.			DAGS: FEBR. 89 HANNAÐ: SP/UD TEIKNAD: UD VERK NR.: 8903
MÆLIKV. 1:50 SIGURÐUR ÞORLEIFSSON TEKNIFRÆÐINGUR F.T.T.EI.			BLADNR.: 3-03
STRANDGÖTU 11 HAFNARFJÖRÐUR SÍMI 54751			