



MÓTTAKIÐ  
13. MAÍ 2022  
Byggingarfulltrúinn í Hafnarfelli





Tillaga að lampavali

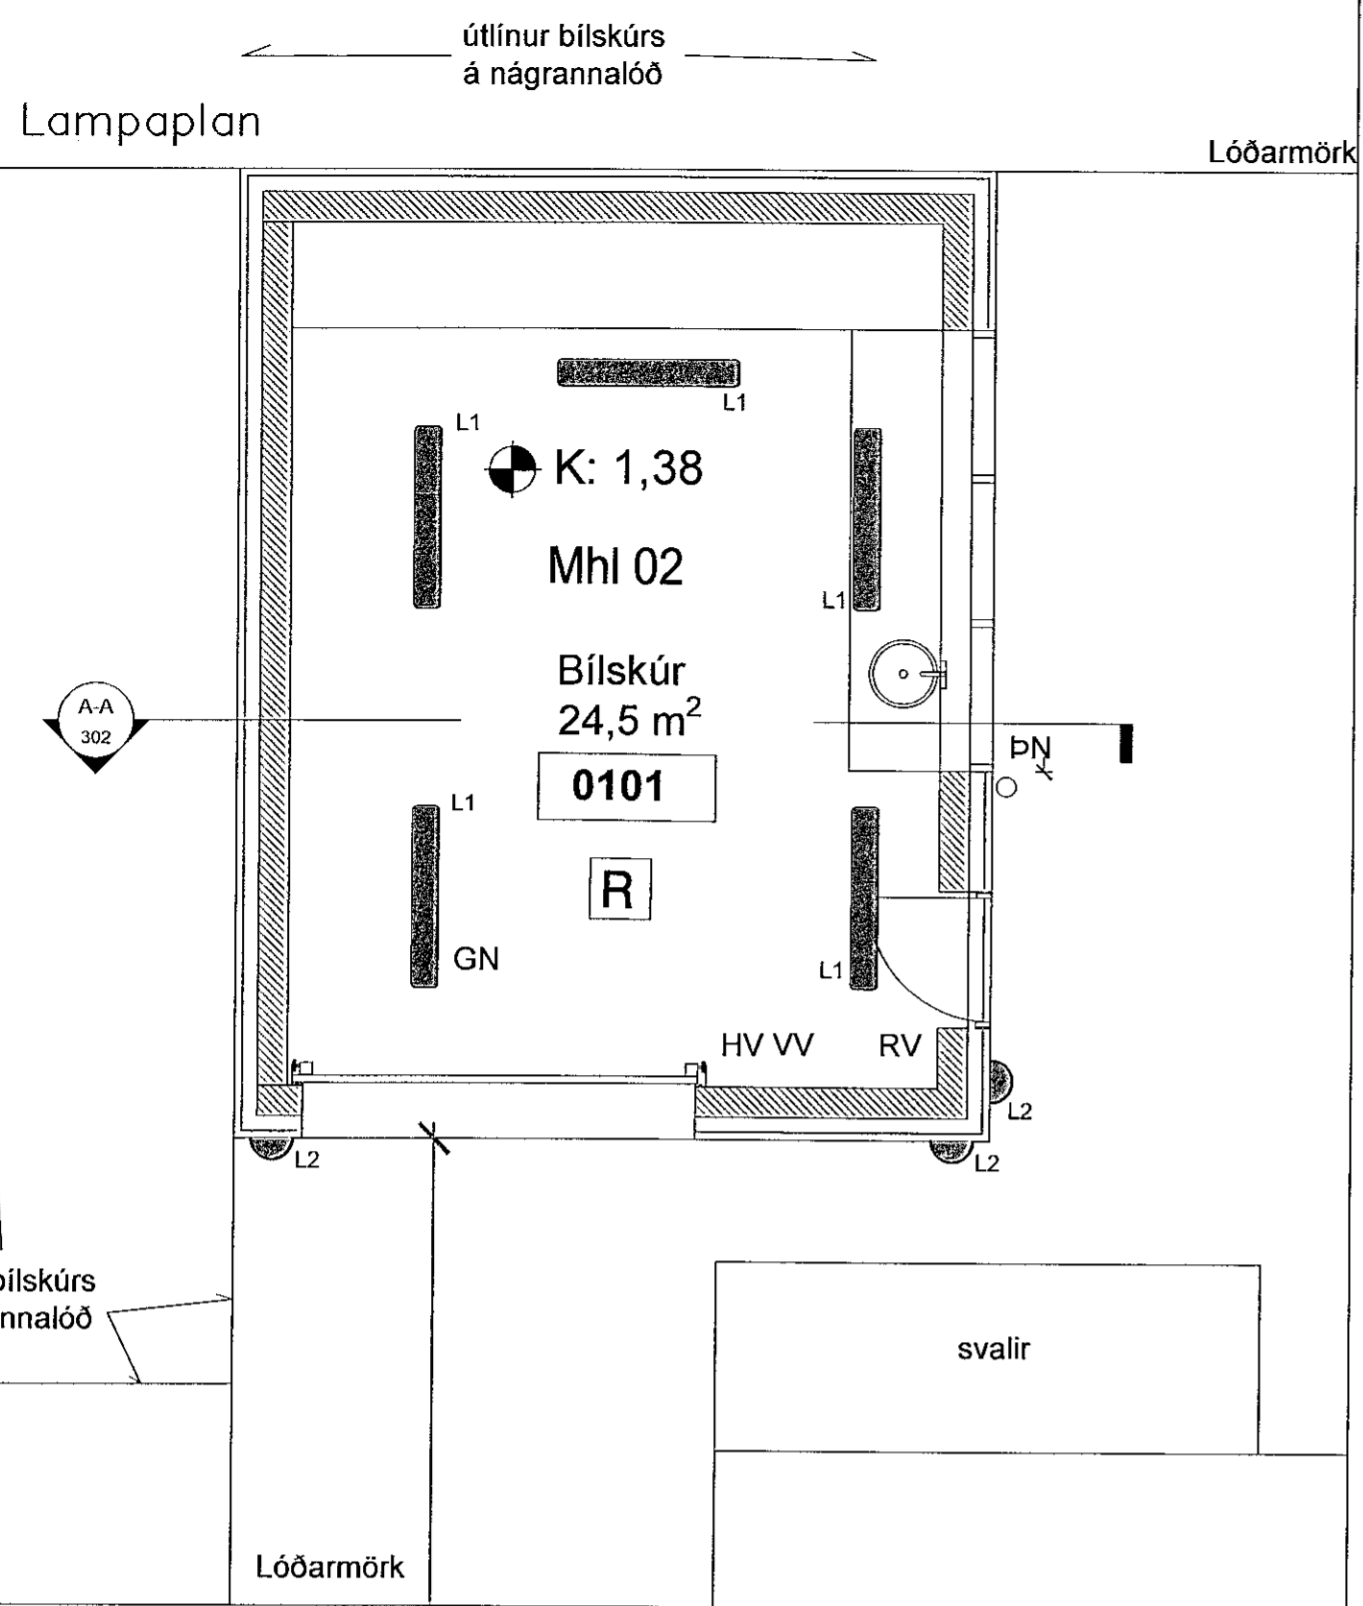

Lampi á loft  
td. Modus KX LED  
25W 3800lm IP54



Veggilampi  
td. Case 1x12W IP55  
345lm 2700K L215 H105 D92

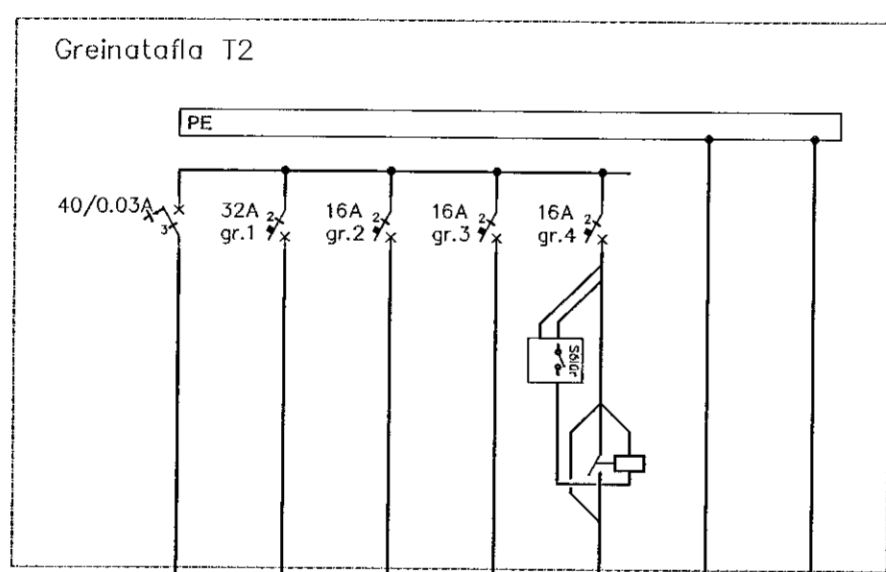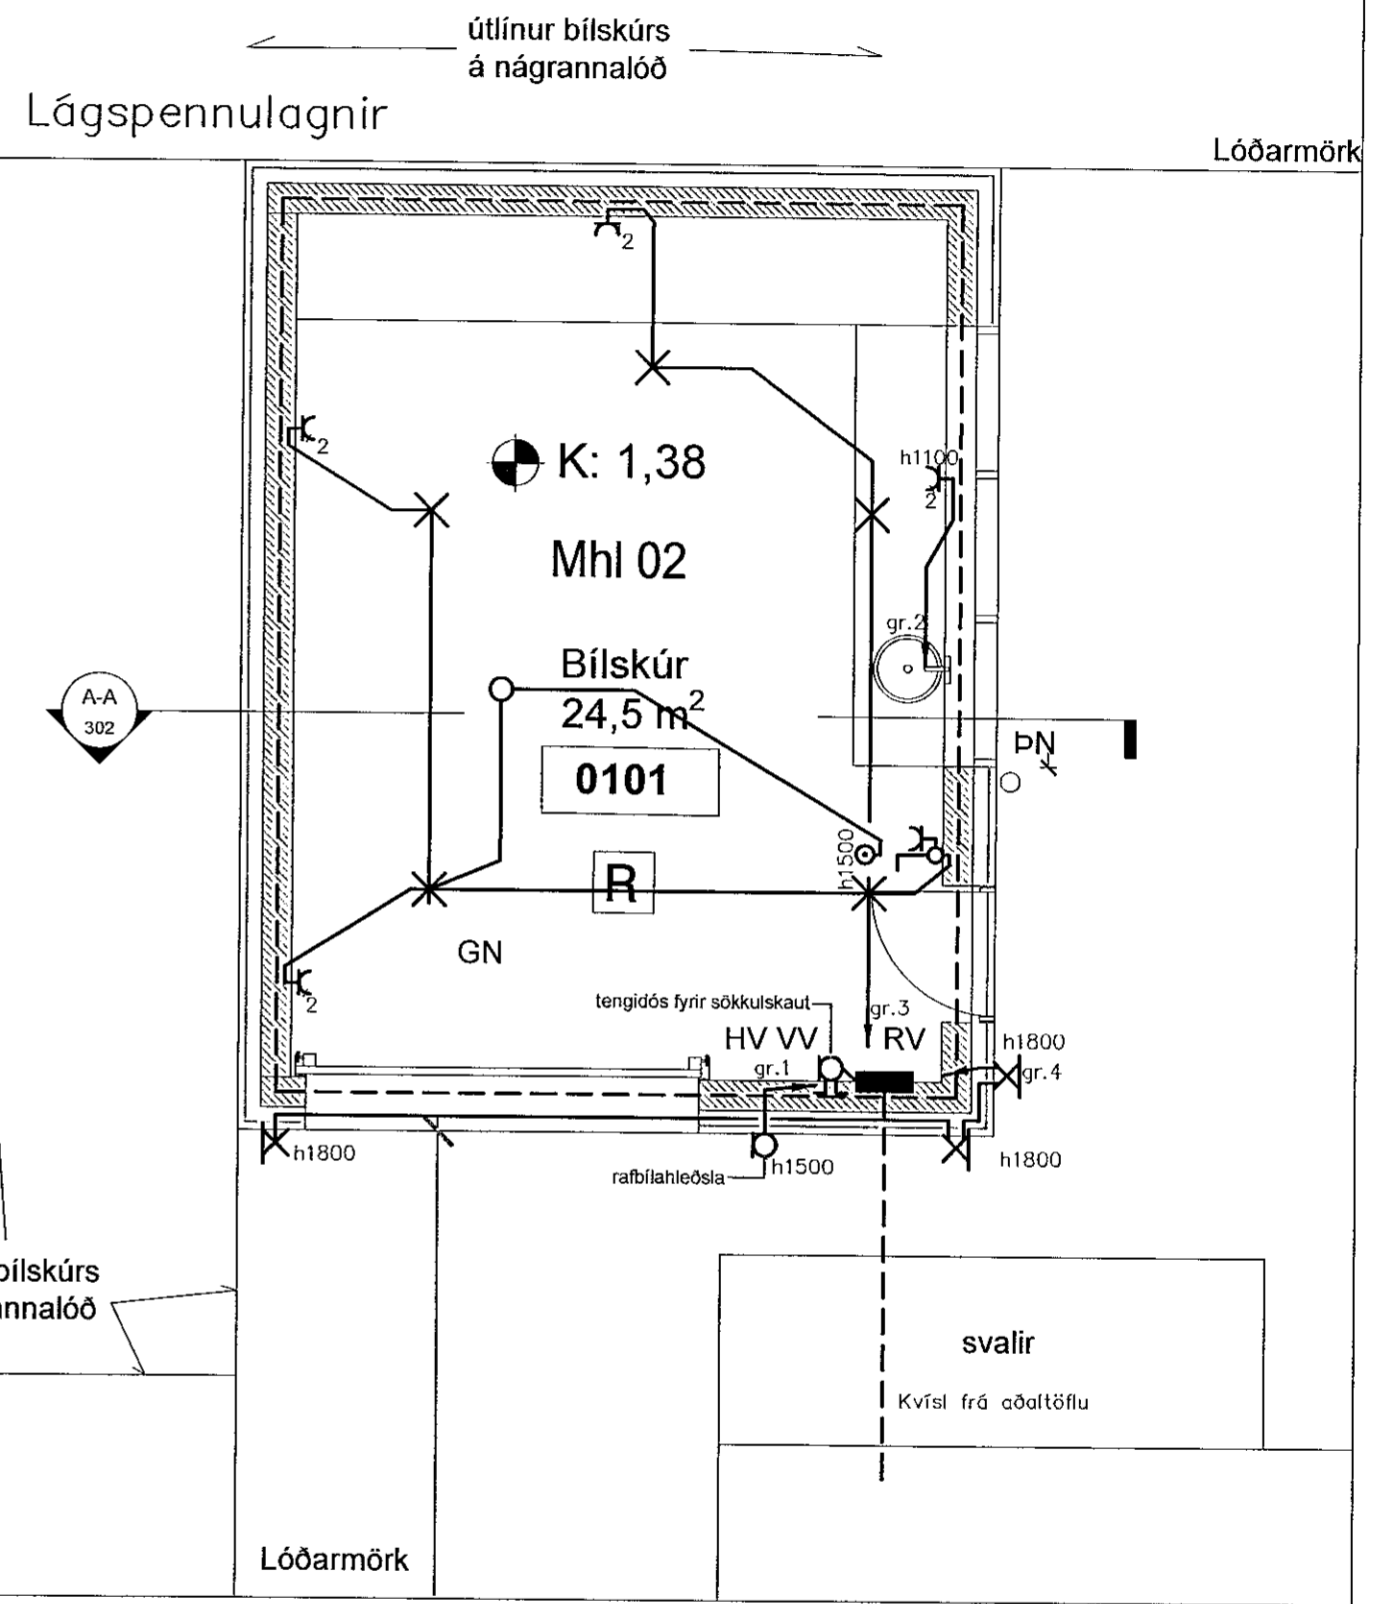


- 40/0.03A
- 32A gr.1
- 16A gr.2
- 16A gr.3
- 16A gr.4
- mem 32mm 3x10mm<sup>2</sup>
- mem 25mm 3x6mm<sup>2</sup>
- mem 20mm 3x2.5mm<sup>2</sup>
- mem 16mm 3x1.5mm<sup>2</sup>
- mem 16mm 4x1.5mm<sup>2</sup>
- mem 16mm 1x6mm<sup>2</sup>
- mem 16mm 1x6mm<sup>2</sup>

- Kvísi frá aðaltöflu
- Rafbílhléðsla
- Tenglar
- Lýsing
- Útlýsing
- Spennuþéttun
- Sökkulskaut

TÆKNIÞJÓNUSTAN SF  
Ármúla 1-108 Reykjavík  
s. gsm 8980723  
e-mail audunn@t.h.is  
Audunn  
250250-3989

Brattakinn 25 Hafnarf.  
Bílskúr  
Lágspennulagnir, lampaplan  
og einlín mynd  
Raflagnateikning

Hannað: AK Dags.: 03.2022  
Teikn.: AK Yfirfarið:  
Kvarði: 1:50  
Nr.: 220501  
Blad: AF:

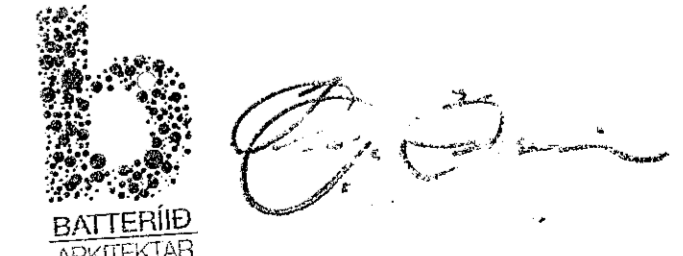

Br. Dags. Breyting