



Samþykkt þann
21. okt. 2021
Lárus Agnarsson / Lárus A. Lárusson
Y-185

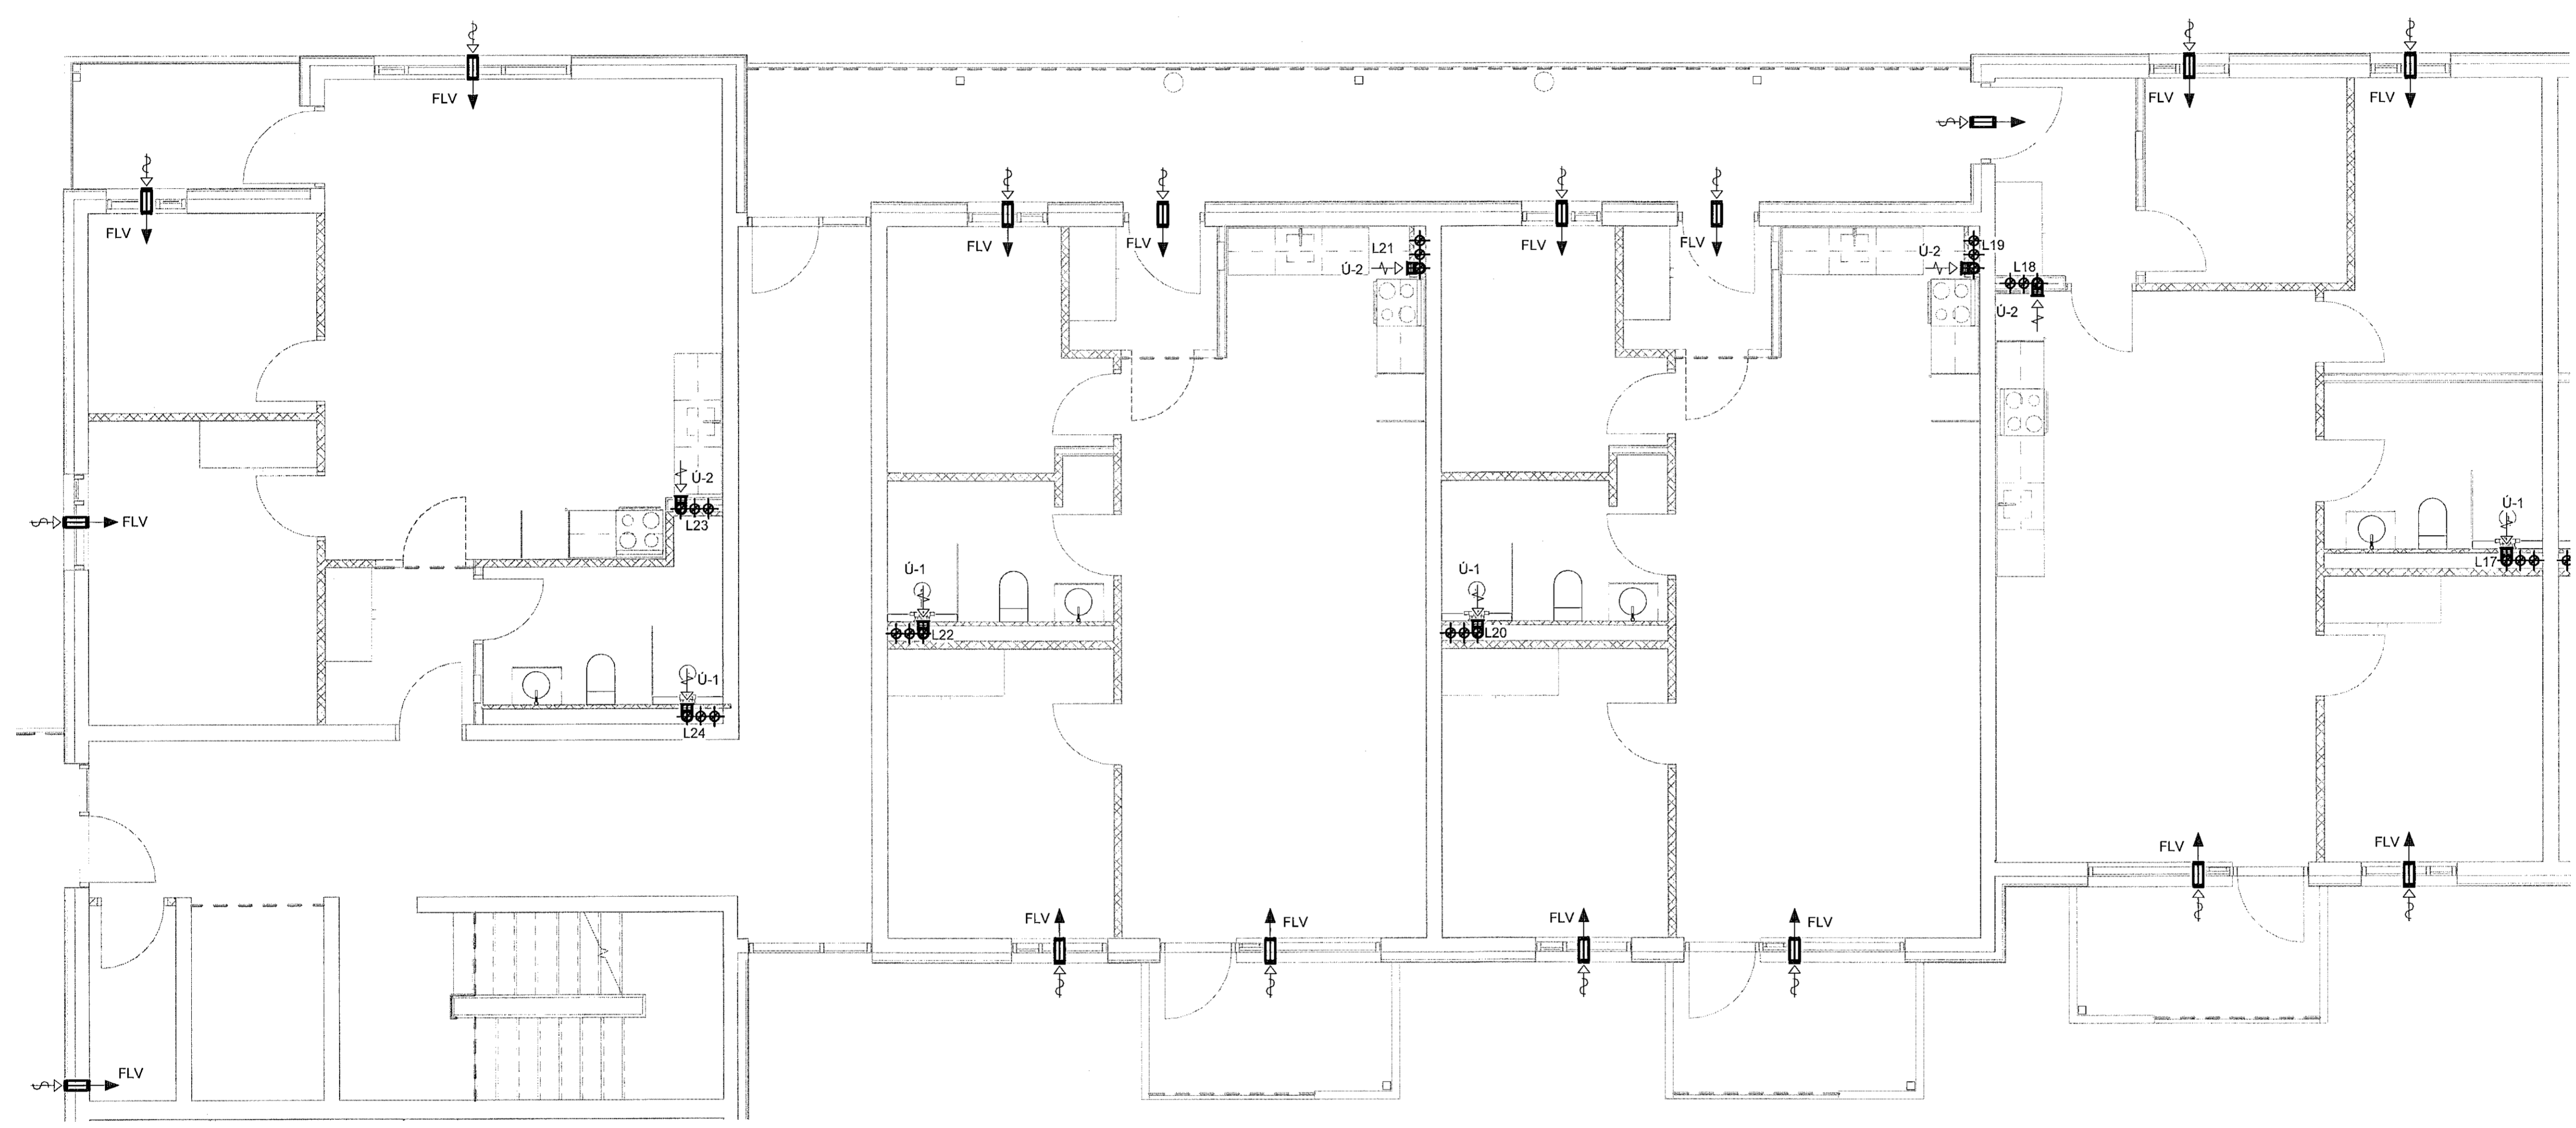

Skýringar:
 Ú1 merkir útsogsventill \varnothing 125 - afköst 20 l/s
 Ú2 merkir útsogsventill \varnothing 125 - afköst 30 l/s
 FLV merkir fersklöfsventill \varnothing 100

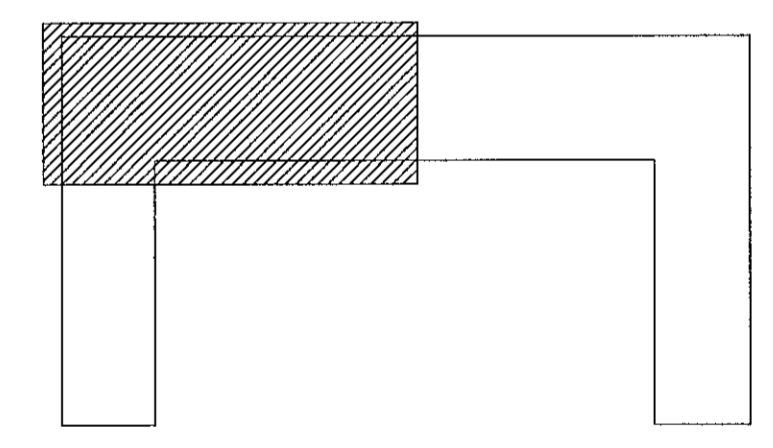

1 3. hæð - 3
1 : 50

VERKTEIKNING GERÐ Á
GRUNNI ADALUPPDRATTA
SEM SAMÞYKKTIR VORU ÞANN
22. Júl. 2021
Ásgeir Ásgeirsson • KI 060161-5-389

NR.	BREYTING	DAGS	BY
A	Verkteikning	13.10.2021	EEP

DAGS F.H. VERKFRÆÐISTOFU REYKJAVÍKUR:
Egbert Elmar Þórarinnsson 140574-4819

DAGS HÖNNUNARSTJÓRI:
Ásgeir Ásgeirsson 060161-5429

**Verkfræðistofa
REYKJAVÍKUR**
FISKIÐ 75, 101, REYKJAVÍK KT: 560415-0600

VERK:
**Hringhamar 2
221 Hafnarfjörður**

TEIKNING:
**Lagnateikning
Loftræsting
3. hæð - 3**

VERKNR.: 2104	MKV.: 1 : 50
HANNAÐ: EEP	TEIKNAD: AG/PBE
DAGS: 13.10.2021	YFIRFARID: JPF
TEIKNING NR.: L-33	ÚTGÁFA NR.: A