


NR. TÆKI	HLUTVERK	STÆRÐ/AFKÖST
1	STOPPLOKAR	DN50
2	EINSTEFNULOKI	DN50
3	HITASTÝRÐUR LOKI	Kv=0,25 m³/klst,
4	STOPPLOKI	DN20
5	STOPPLOKAR	DN50
6	MILLIHITARI	50 kW, 45/20°C-35/15°C, q=0,65 l/s
7	ÞRÝSTIMÆLIR	0-5 bar.
8	HITAMÆLIR	0-75°C
9	TÆMING	DN15
10	LOFTTÆMING	SJÁLFBIRK LOFTTÆMING
11	HRINGRÁSADÆLA	PREPASTÝRÐ 2,3 m³/klst VIÐ 6,5 mVs
14	STOPPLOKI	DN20
15	STILLILOKI	DN20
16	HITAMÆLIR	0-75°C
17	STOPPLOKI	DN40
18	EINSTEFNULOKI	DN15
19	STOPPLOKI	DN15
20	PENSLUKER	12 LÍTRA,
21	ÞRÝSTIMÆLIR	0-5 bar.
22	HITAMÆLIR	0-75°C
S1	HITAMENI	SKYNNAR HITASTIG Á BAKRÁS HITAKERFIS 15°C

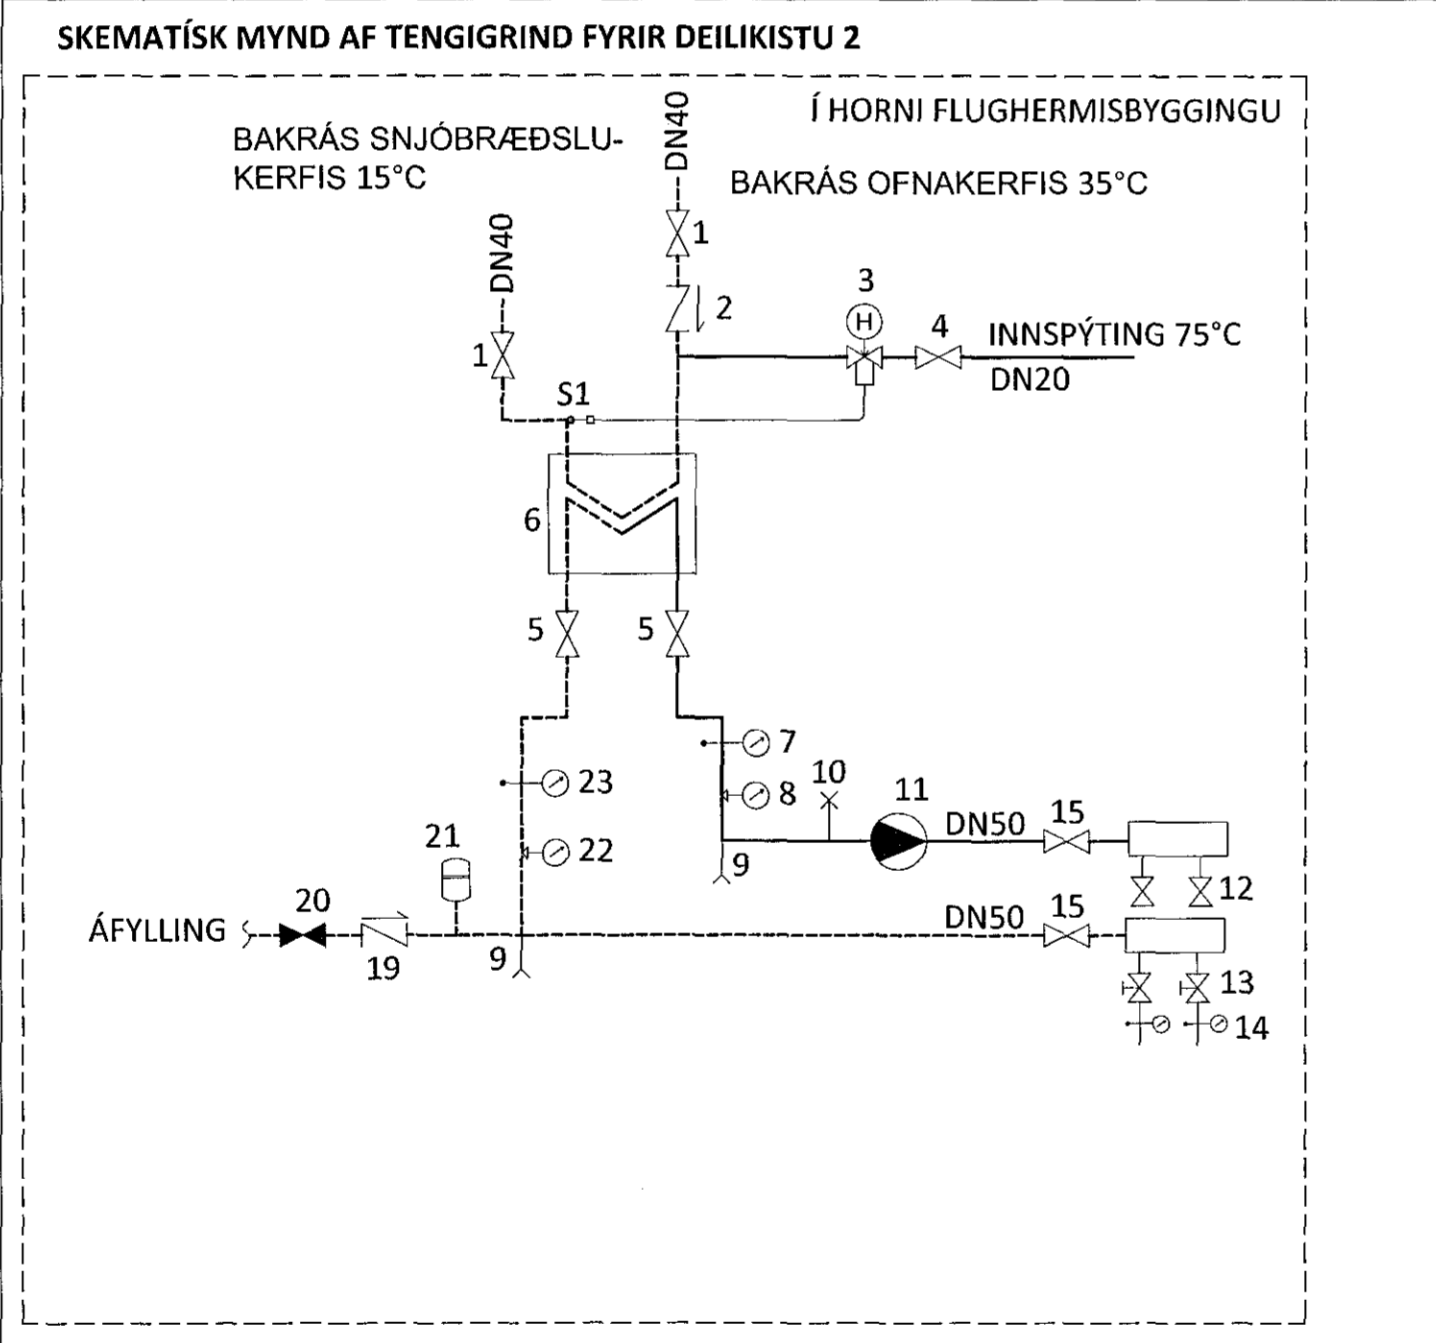

NR. TÆKI	HLUTVERK	STÆRÐ/AFKÖST
1	STOPPLOKAR	DN40
2	EINSTEFNULOKI	DN40
3	HITASTÝRÐUR LOKI	Kv=0,25 m³/klst, (0,12 m³/klst)
4	STOPPLOKI	DN15
5	STOPPLOKAR	DN50
6	MILLIHITARI	69 kW, 45/20°C-35/15°C, q=0,87 l/s
7	ÞRÝSTIMÆLIR	0-5 bar.
8	HITAMÆLIR	0-75°C
9	TÆMING	DN15
10	LOFTTÆMING	SJÁLFBIRK LOFTTÆMING
11	HRINGRÁSADÆLA	PREPASTÝRÐ 2,8 m³/klst VIÐ 6,0 mVs
12	STOPPLOKI	DN20
13	STILLILOKI	DN20
14	HITAMÆLIR	0-75°C
15	STOPPLOKI	DN25
16	EINSTEFNULOKI	DN15
17	STOPPLOKI	DN15
18	PENSLUKER	9 LÍTRA,
19	ÞRÝSTIMÆLIR	0-5 bar.
20	HITAMÆLIR	0-75°C
S1	HITAMENI	SKYNNAR HITASTIG Á BAKRÁS HITAKERFIS 35°C

ARITUN BYGGINGARFULLTRÚA KT. 091251-209

ALMENNAR SKÝRINGAR SJÁ TEIKNINGU -3-A000

BR.	DAGS.	BREYTING	SAMP.
-----	-------	----------	-------

ferill
VERKFRÆÐISTOFA

FLUGVELLIR 1 HAFNARFIRDI
SKRIFSTOFUBYGGING
SNJÓBRÆÐSLA
TENGINMYND

SAMPYKKT: hjalti@ferill.is KT. 270760-4229 DAG

HÖNNUÐUR	YFIRFARIÐ	DAGS. ÖTG.	DAGS. BREYT.
HPV	hjalte@ferill.is	DAG 20.01.16	
MKV.	VERKNR.	TEIKN. NR.	BREYT.
	14014	6 - A001	

Ferill ehf. Mörkin 1 108 Reykjavík Sími: 575 1600 Fax: 575 1601 www.ferill.is