


Ofnaskrá:

NR.	REKN. VARMATAP Watt	HÁMARKS-		VALDIR OFNAR		STÚTAR 10 mm
		HÆÐ mm	LENGD mm	A B	C D	
401	2150	600	2400			A-D
402	1800	600	2200			A-D
403	1700	300	2400			C-B
404	1700	300	2400			C-B
405	1700	300	2400			C-B


Alköst ofna skal miða við $\Delta T = 28^\circ\text{C}$.
Framrás 65°C / bakrás 35°C / herb. hiti 22°C

Kvarði 1:50

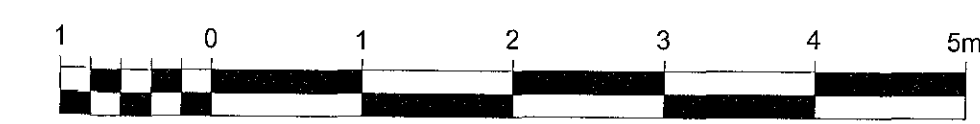

Tilvisanir:

Aimennar skýringar... sjá bl. nr. L1-A-01

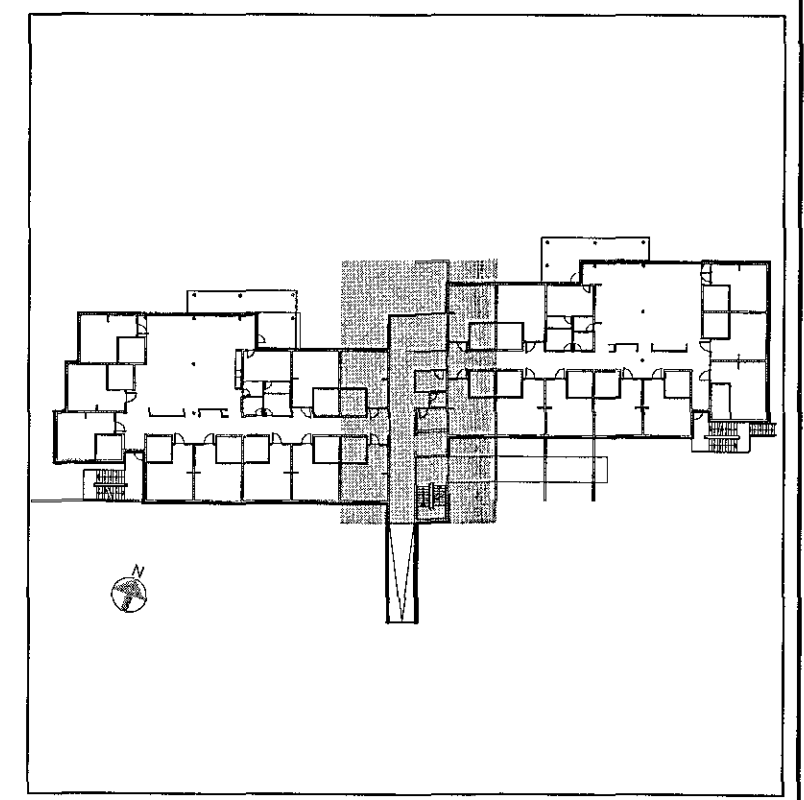

Br. Dags. Breyting. Hannað Tölka.

VSÓ RÁÐGJÖF
BORGARTÚNI 20, 105 REYKJAVÍK, Sími 585-9000, NETF: vso@vso.is

Sólvangur hjúkrunarheimili 2016

Prifa-, hita- og loftrasskerfi
4. hæð
Grunnmynd
Hannað/teiknað: GS / JH
Yfirfarið:
Samþykkt: Kjartan Holgason
Kt: 300857-5909

Kvarði: 1:50 (A1) Reykjavík: 10.05.2017

Verknr. 16364 Teikn.nr. L1-G4-02 Br.