


Ofnaskrá:

NR.	REKN. VARMATAP Watt	HÁMARKS- HÆÐ mm		LENGD mm		VALDIR OFNAR		STÚTAR 10 mm
		A	B	C	D			
216	170	740	500					E-F
217	2150	600	2400					A-D
218	1800	600	2000					C-B
219	170	740	500					F-E
220	2150	600	2400					C-D
244	170	740	500					E-F
245	2150	600	2400					A-D
246	250	600	600					C-D
247	250	600	600					A-B
248	1800	500	2400					C-B
249	1700	300	2400					C-B
250	1700	300	2400					C-B
251	1700	300	2400					C-B
252	2150	600	2400					A-D
253	170	740	500					F-E
263	2150	600	2400					A-D


Alköst ofna skal miða við $t = 28^\circ\text{C}$.
Framrás 65°C / bakrás 35°C / herb. hiti 22°C

Kvarði 1:50



Tilvísanir:

Almennar skýringar... sjá bl. nr. L1-A-01

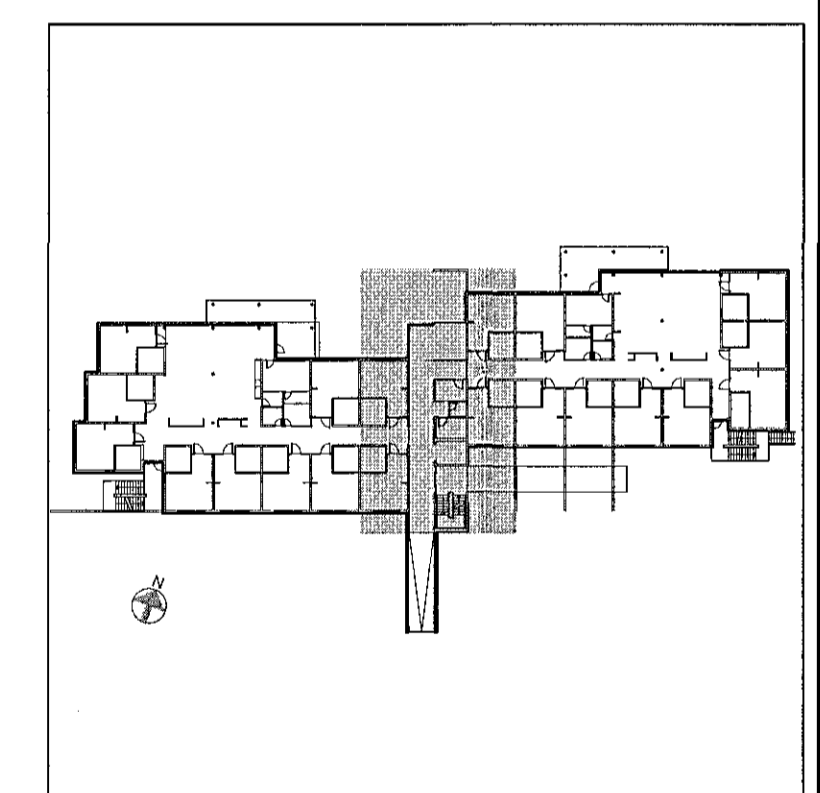

Br. Dags. Breyting Hannað Teikn.

VSÓ RÁÐGJÖF
BORGARTÚNI 20, 105 REYKJAVÍK, Sími 595-9000, NETF: vs@vs.is

Sólvangur hjúkrunarheimili 2016

Þrifa-, hita- og loftresakerfi
2. hæð
Grunnmynd
Hannað/teiknað: GS / PH
Yfirfarir:
Samþykkt: Kjartan Helgason
Kt: 300857-5909

Kvarði: 1:50 (A1)
Verknr. 16364
Teikn.nr. L1-G2-02
Br.