

Ofnaskrá:


NR	REKNI VARMATAP Watt	HÁMARKS- HÆÐ mm	LENGD mm	VALDIR OFNAR		STÚTAR 10 mm
				A	C	
116	170	740	500		Handklæðaofn	E-F
117	2150	600	2400			A-D
118	1800	600	2000			C-B
119	170	740	500		Handklæðaofn	F-E
120	2150	600	2400			C-D
144	170	740	500		Handklæðaofn	E-F
145	2150	600	2400			A-D
146	250	600	600			C-D
147	250	600	600			A-B
148	1800	500	2400			C-B
149	1700	300	2400			C-B
150	1700	300	2400			C-B
151	1700	300	2400			C-B
152	2150	600	2400			A-D
153	170	740	500		Handklæðaofn	F-E
163	2150	600	2400			A-D

Afköst ofna skal miða við $\Delta T=28^{\circ}\text{C}$.
Framrás 65°C / bakrás 35°C / herb. hiti 22°C



Tilvísanir:

Almennar skýringar... sjá bl. nr. L1-A-01

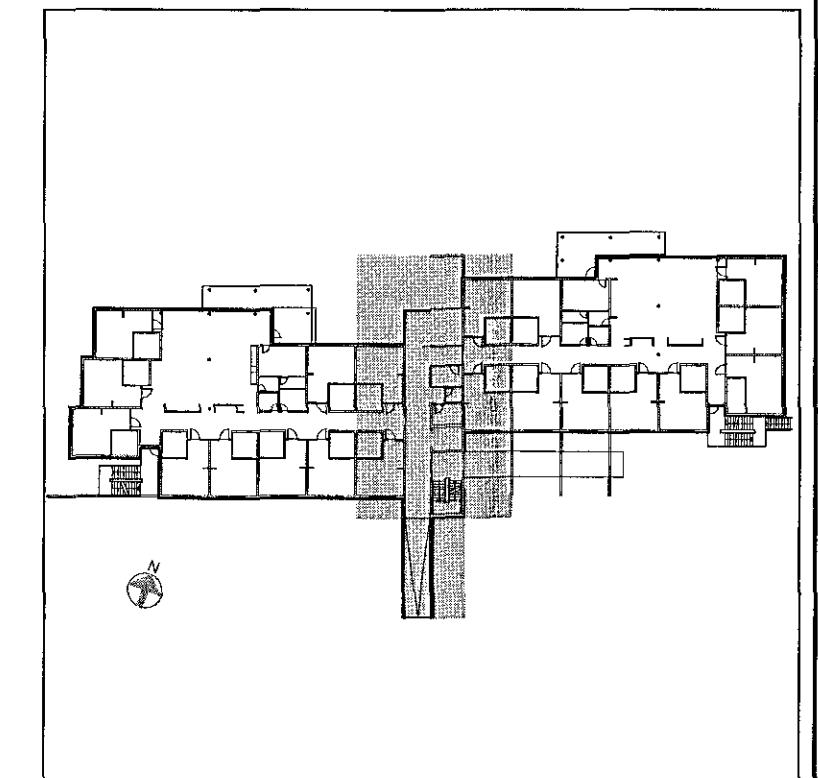

Br. Dags. Breyting. Hannad. Tökn.

VSÓ RÁÐGJÖF
BORGARTÚNI 20, 105 REYKJAVÍK, Sími 585-9000, NETT: vs@vs.is

Sólvangur, hjúkrunarheimili

Prifa-, hita- og loftfræskerfi
1. hæð
Grunnmynd
Hannað/teiknað: GS / PH
Yfirfarir:
Samþykkt: Kjartan Helgason
Kt: 300857-5909

Kvarði: 1:50 (A1) Reykjavík: 10.05.2017

Verknr. Teikn.nr. Br.
16364 L1-G1-02