


Sjá bl. nr.: L1-G0-03

Sjá bl. nr.: L1-G0-01

Ófnaskrá:


012	1300	300	2600	C-B
013	2150	600	2400	C-B
014	1450	300	2000	C-B
015	280	600	600	A-B
017	280	600	600	A-B
018	280	600	600	A-B
019	2150	600	2400	A-D
020	1100	600	2400	C-B

Alköst ofna skal miða við $\Delta T = 28^\circ\text{C}$.
Framrás 65°C / bakrás 35°C / herb. hli 22°C

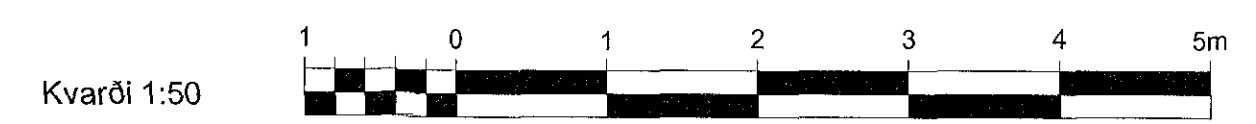

Tilvísanir:

Almennar skýringar... sjá bl. nr. L1-A-01

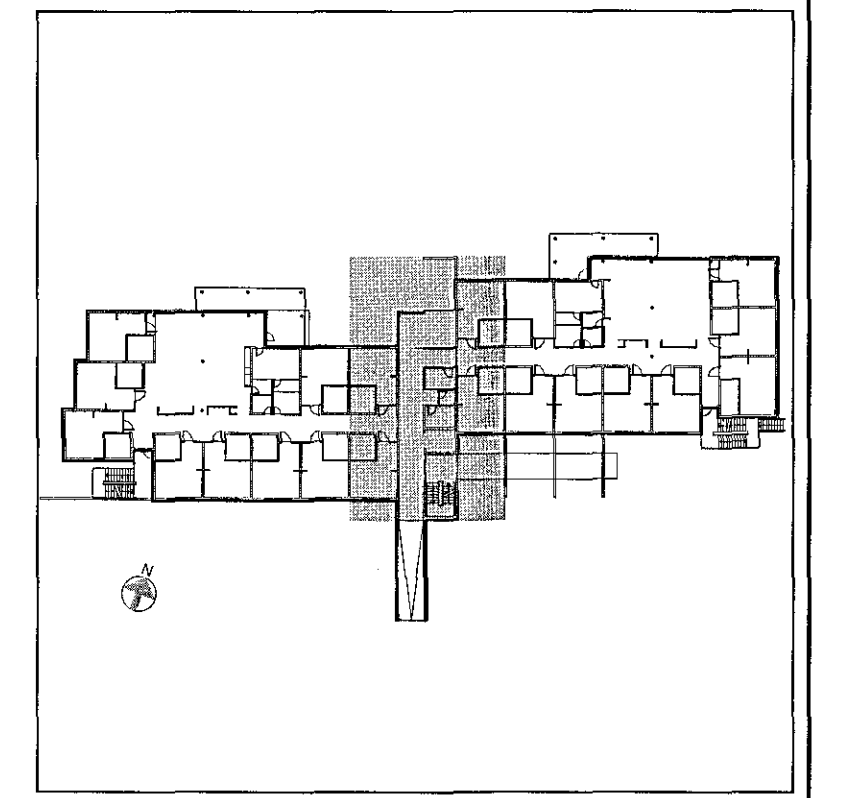

A_08.05.2017 Breytt í nýja skipulag GS / PH
Br. Dagn. Breyting Harnað Tókn.

VSÓ RÁÐGJÖF
BORGARTÚN 20, 105 REYKJAVÍK, Sími 585-9000, NETF: vs@vs.is

Sólvangur hjúkrunarheimili 2016

Prifa-, hita- og loftæskerfi
Kjallari
Grunnmynd
Harnað/teiknað: GS / PH
Yfirarið:
Samþykkt: Kjartan Helgason
Kt: 300857-5909

Kvarði: 1:50 (A1) Reykjavík: 10.05.2017
Verkm. Teikn.nr. Br.
16364 L1-G0-02 A