



Tilvísanir:
Almennar skýringar sjá bl. nr. L1-A-01

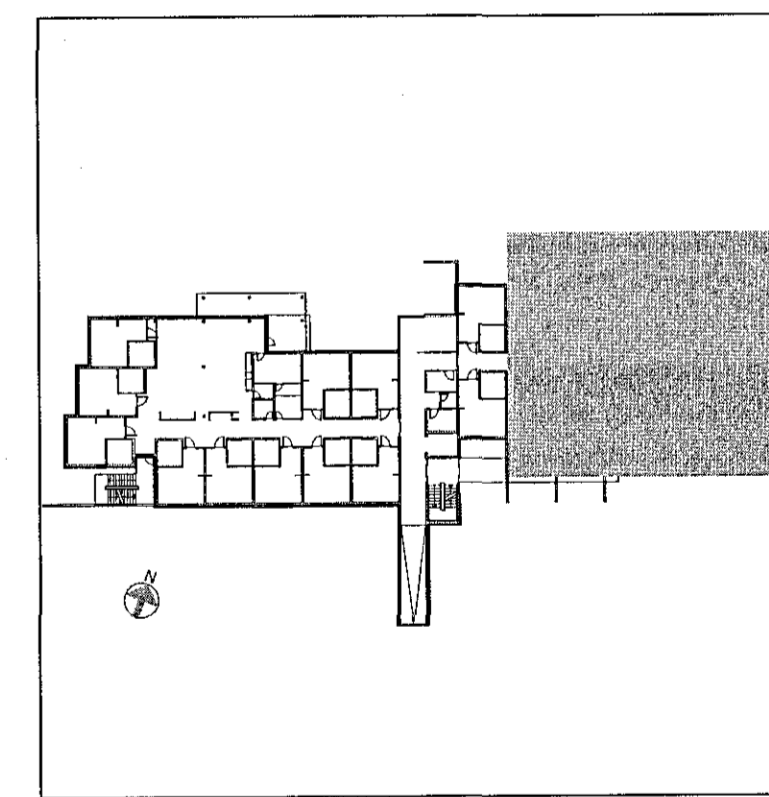

Ofnaskrá:

NR.	REKKN. VARMATAP Watt	HÁMARKS-LENGD mm		VALDR OFNAR		STÚTAR 10 mm
		HÆD mm	LENGD mm	A	C / D	
122	2150	600	2400			A-D
123	1800	600	2000			A-D
124	250	600	600			A-B
125	250	600	600			A-B
126	550	300	800			A-D
127	2050	300	2800			A-D
128	2050	300	2800			A-D
129	170	740	500		Handklæðaoafn	F-E
130	2150	600	2400			C-B
131	170	740	500		Handklæðaoafn	E-F
132	2150	600	2400			C-B
133	170	740	500		Handklæðaoafn	F-E
134	2150	600	2400			A-D
135	2150	600	2400			C-B
136	170	740	500		Handklæðaoafn	E-F
137	2150	600	2400			A-D
138	170	740	500		Handklæðaoafn	F-E
139	2150	600	2400			C-B
140	170	740	500		Handklæðaoafn	E-F
141	2150	600	2400			A-D
142	170	740	500		Handklæðaoafn	F-E
143	2150	600	2400			C-B

AKöst ofna skal miða við $\Delta T=28^{\circ}\text{C}$.
Framrás 65°C / bakrás 35°C / herb. hiti 22°C



Kvarði 1:50

B 31.08.2018 Færstur á lofti og neysluv. ígnum v. br. arkitekti GS PH
A 25.06.2018 Ofnagnum bætt inn GS PH
Br. Daga. Breyting Hannað Teikn.

VSÓ RÁDGGJÖF
BORGARTÚNI 20, 105 REYKJAVÍK, SÍMI 585-9000, NETF: vs@vs.is

Sólvangur hjúkrunarheimilis 2016

Prifa-, hita- og loftfræskiferi
1. hæð
Grunnmynd
Kvarði: 1:50 (A1)
Verknr. 16364

Hannað/teiknað: GS / PH
Yfirfarð: Sambýkkt: Kjartan Helgason
Kt: 300857-5909
Reykjavík: 10.05.2017
Teikn.nr. L1-G1-03
Br. B