




Samþykkt þann  
05 JUL 2011  
Bæturáttættið í Hafnarfirði  
F.h. Hrólfur S. Gunnlaugsson

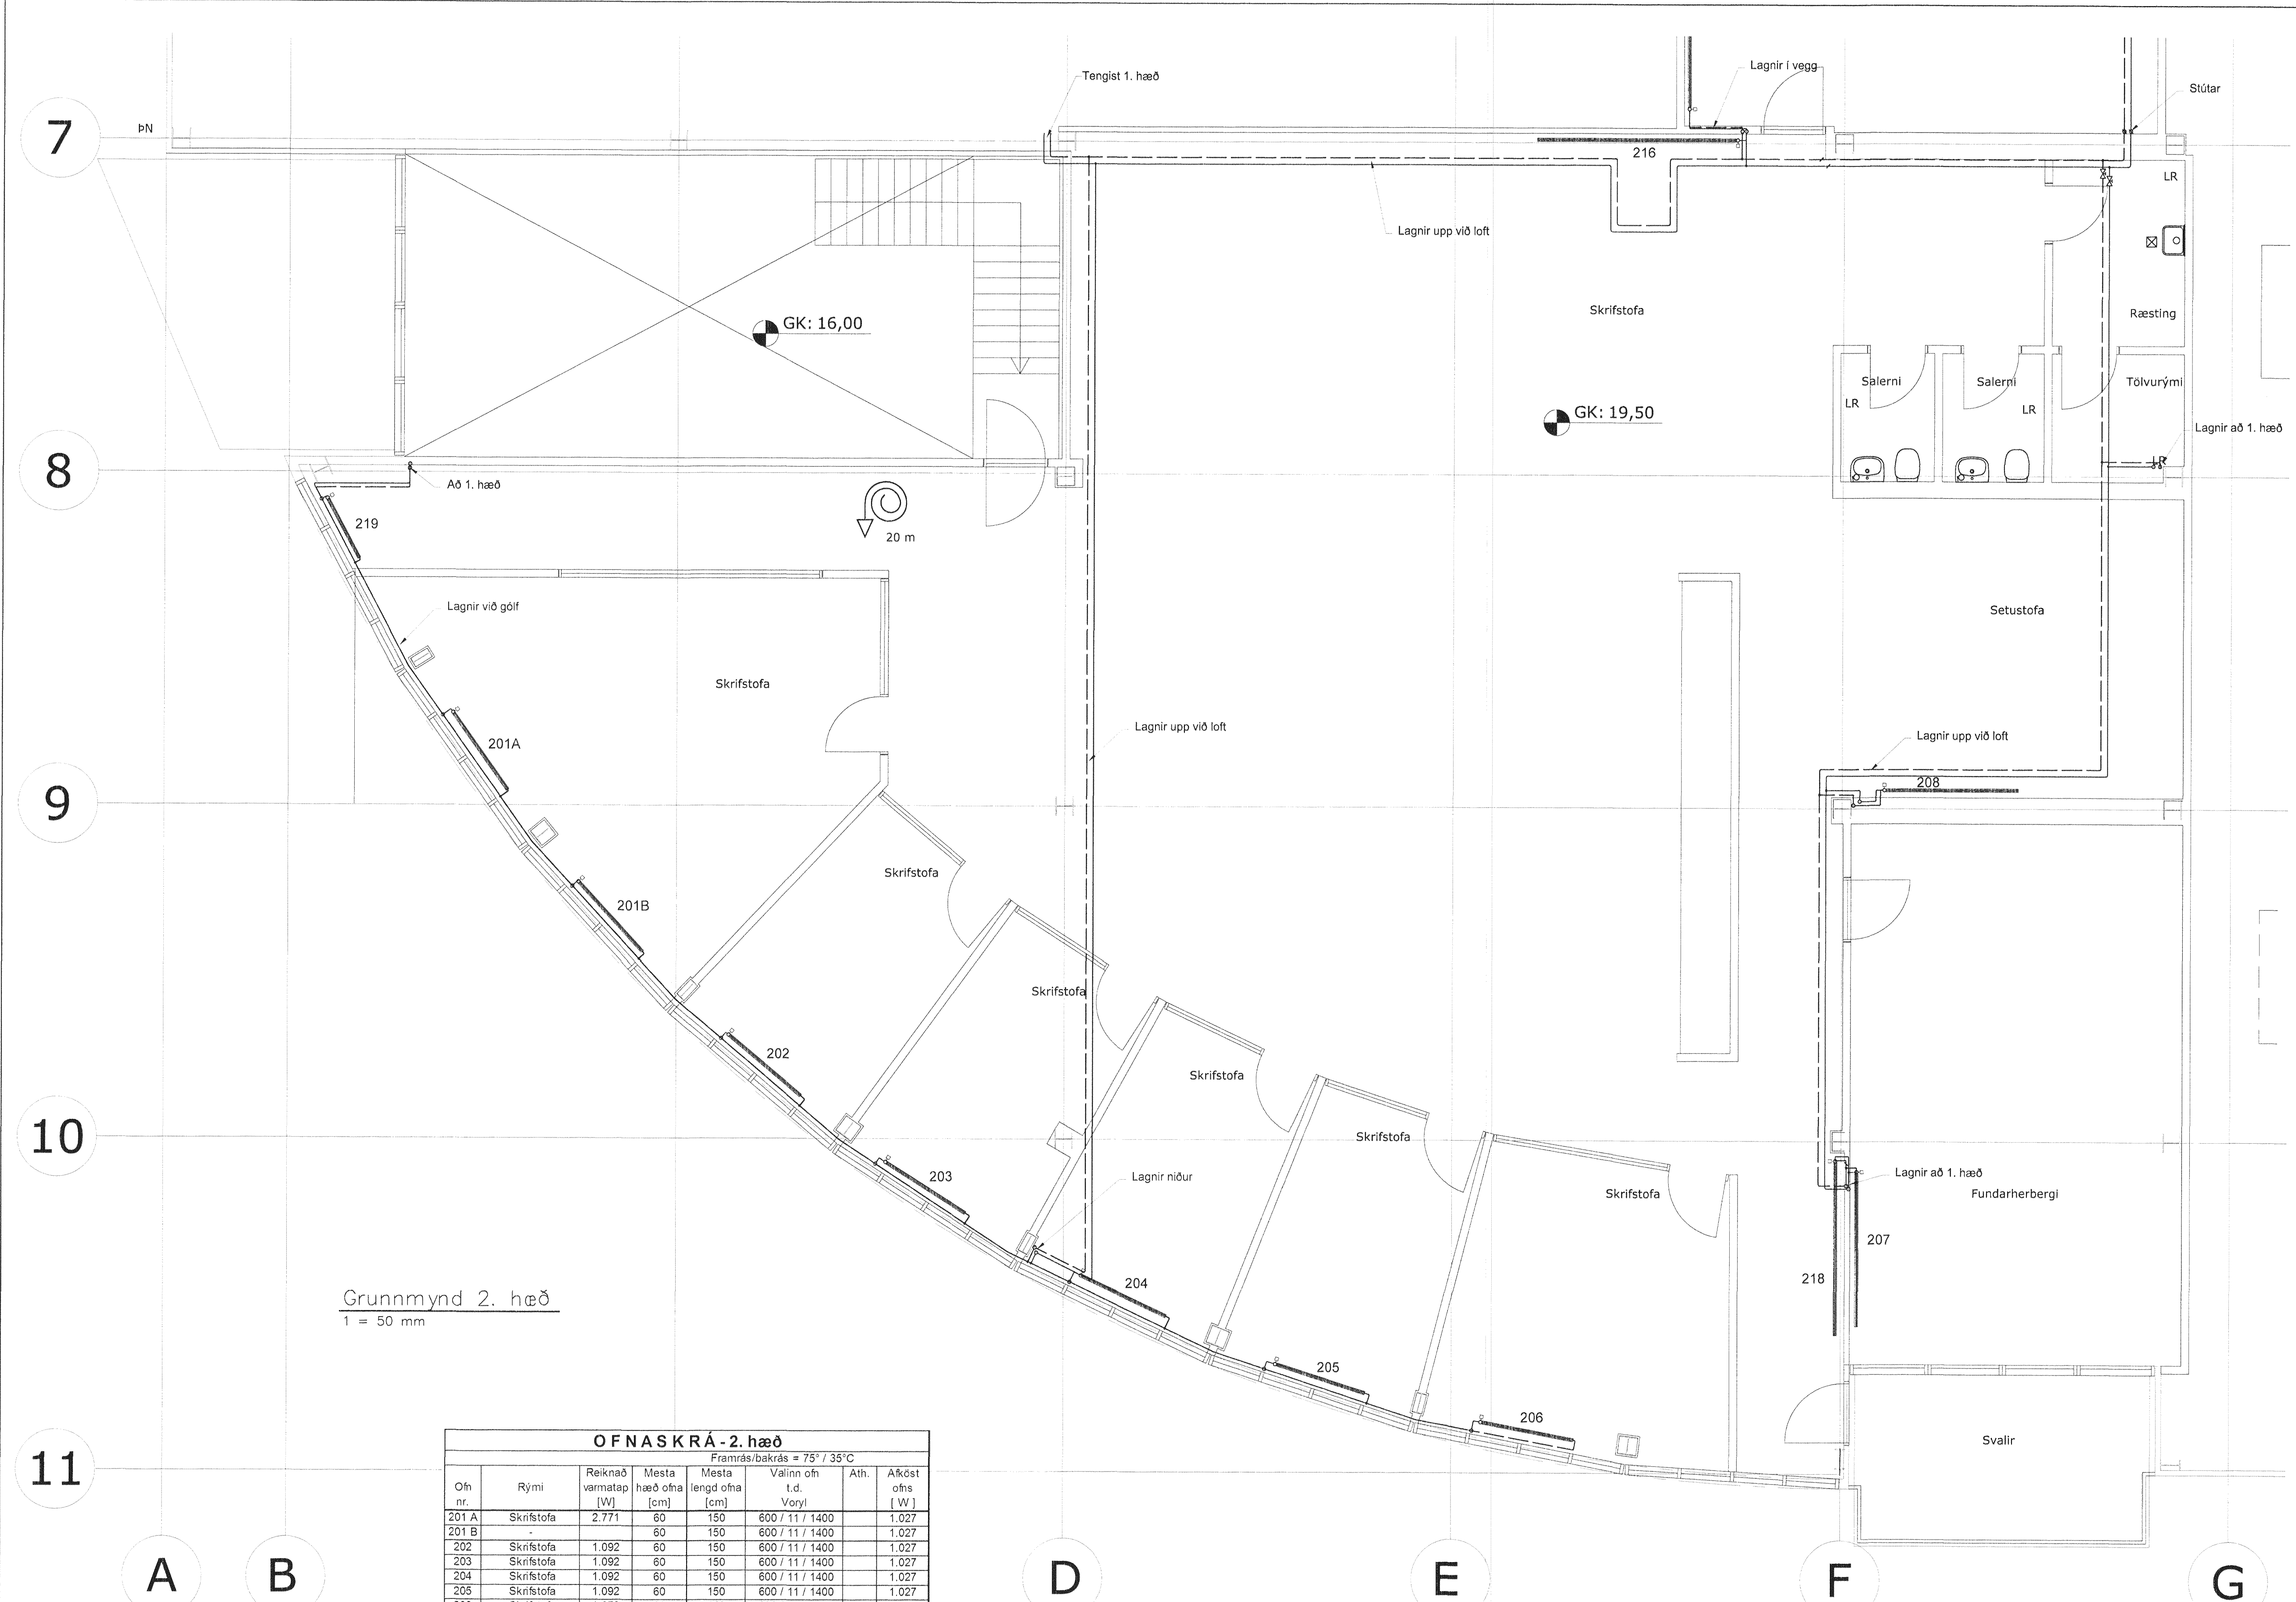

Grunnmynd 2. hæð  
1 = 50 mm

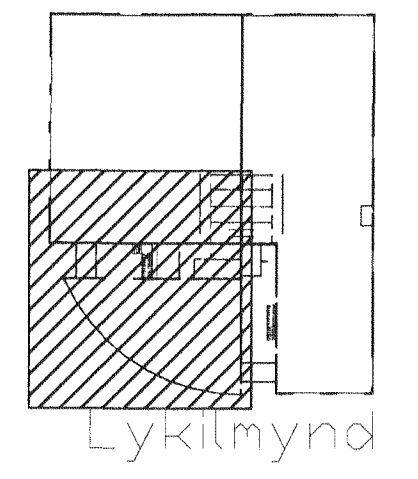

Skýringar sjá teikningu nr.300



OFNASKRÁ - 2. hæð						
Framrás/bakrás = 75° / 35°C						
Öfn nr.	Rými	Reiknað varmatap [W]	Mesta hæð ofna [cm]	Mesta lengd ofna [cm]	Valinn öfn t.d. Voryl	Ath. Akóst ofns [W]
201 A	Skrifstofa	2.771	60	150	600 / 11 / 1400	1.027
201 B	-	-	60	150	600 / 11 / 1400	1.027
202	Skrifstofa	1.092	60	150	600 / 11 / 1400	1.027
203	Skrifstofa	1.092	60	150	600 / 11 / 1400	1.027
204	Skrifstofa	1.092	60	150	600 / 11 / 1400	1.027
205	Skrifstofa	1.092	60	150	600 / 11 / 1400	1.027
206	Skrifstofa	1.670	60	150	600 / 11 / 1400	1.027
207	Fundarherb.	3.646	60	250	600 / 22 / 2400	3.360
208	Skrifstofa	1.100	60	200	600 / 11 / 1600	1.170
	Salerni	215				Loft.
	Salerni	215				Loft.
	Geymsla	134				Loft.
	Ræsting	211				Loft.
	Matsalur	723				Loft.
214	Matsalur	2.455	60	300	600 / 11 / 1400	1.027
	Eldhúsi	494				Loft.
216	Skrifstofa	3.414	60	300	600 / 22 / 2800	3.920
0	Skrifstofa	5.927	0	0		Loft.
218	Gangur	827	0	0	600 / 21 / 2400	2.460
219	Gangur	971	0	0	600 / 11 / 1400	1.027
	Varmatap Σ:	29.138			Heild valinna ofna:	20.153

Ög.	Breytingar	Mánaður	Daga

Verkteikning

Selhella 5, Hafnarfirði

Hitalögn  
Grunnmynd. 2.hæð 2/2

Strendingur ehf.  
Verkfræðibjónusta  
Fjarlægja 13-15 - 220 Hafnarfirður  
Sími 565 5544. Fax 565 5544  
strendingur@strendingur.is

Dagur  
22.07.2010

Teiknari / mörð af  
JW/SG

Malkort  
1:50

Númer teikningar  
325

Bláskort  
A1