
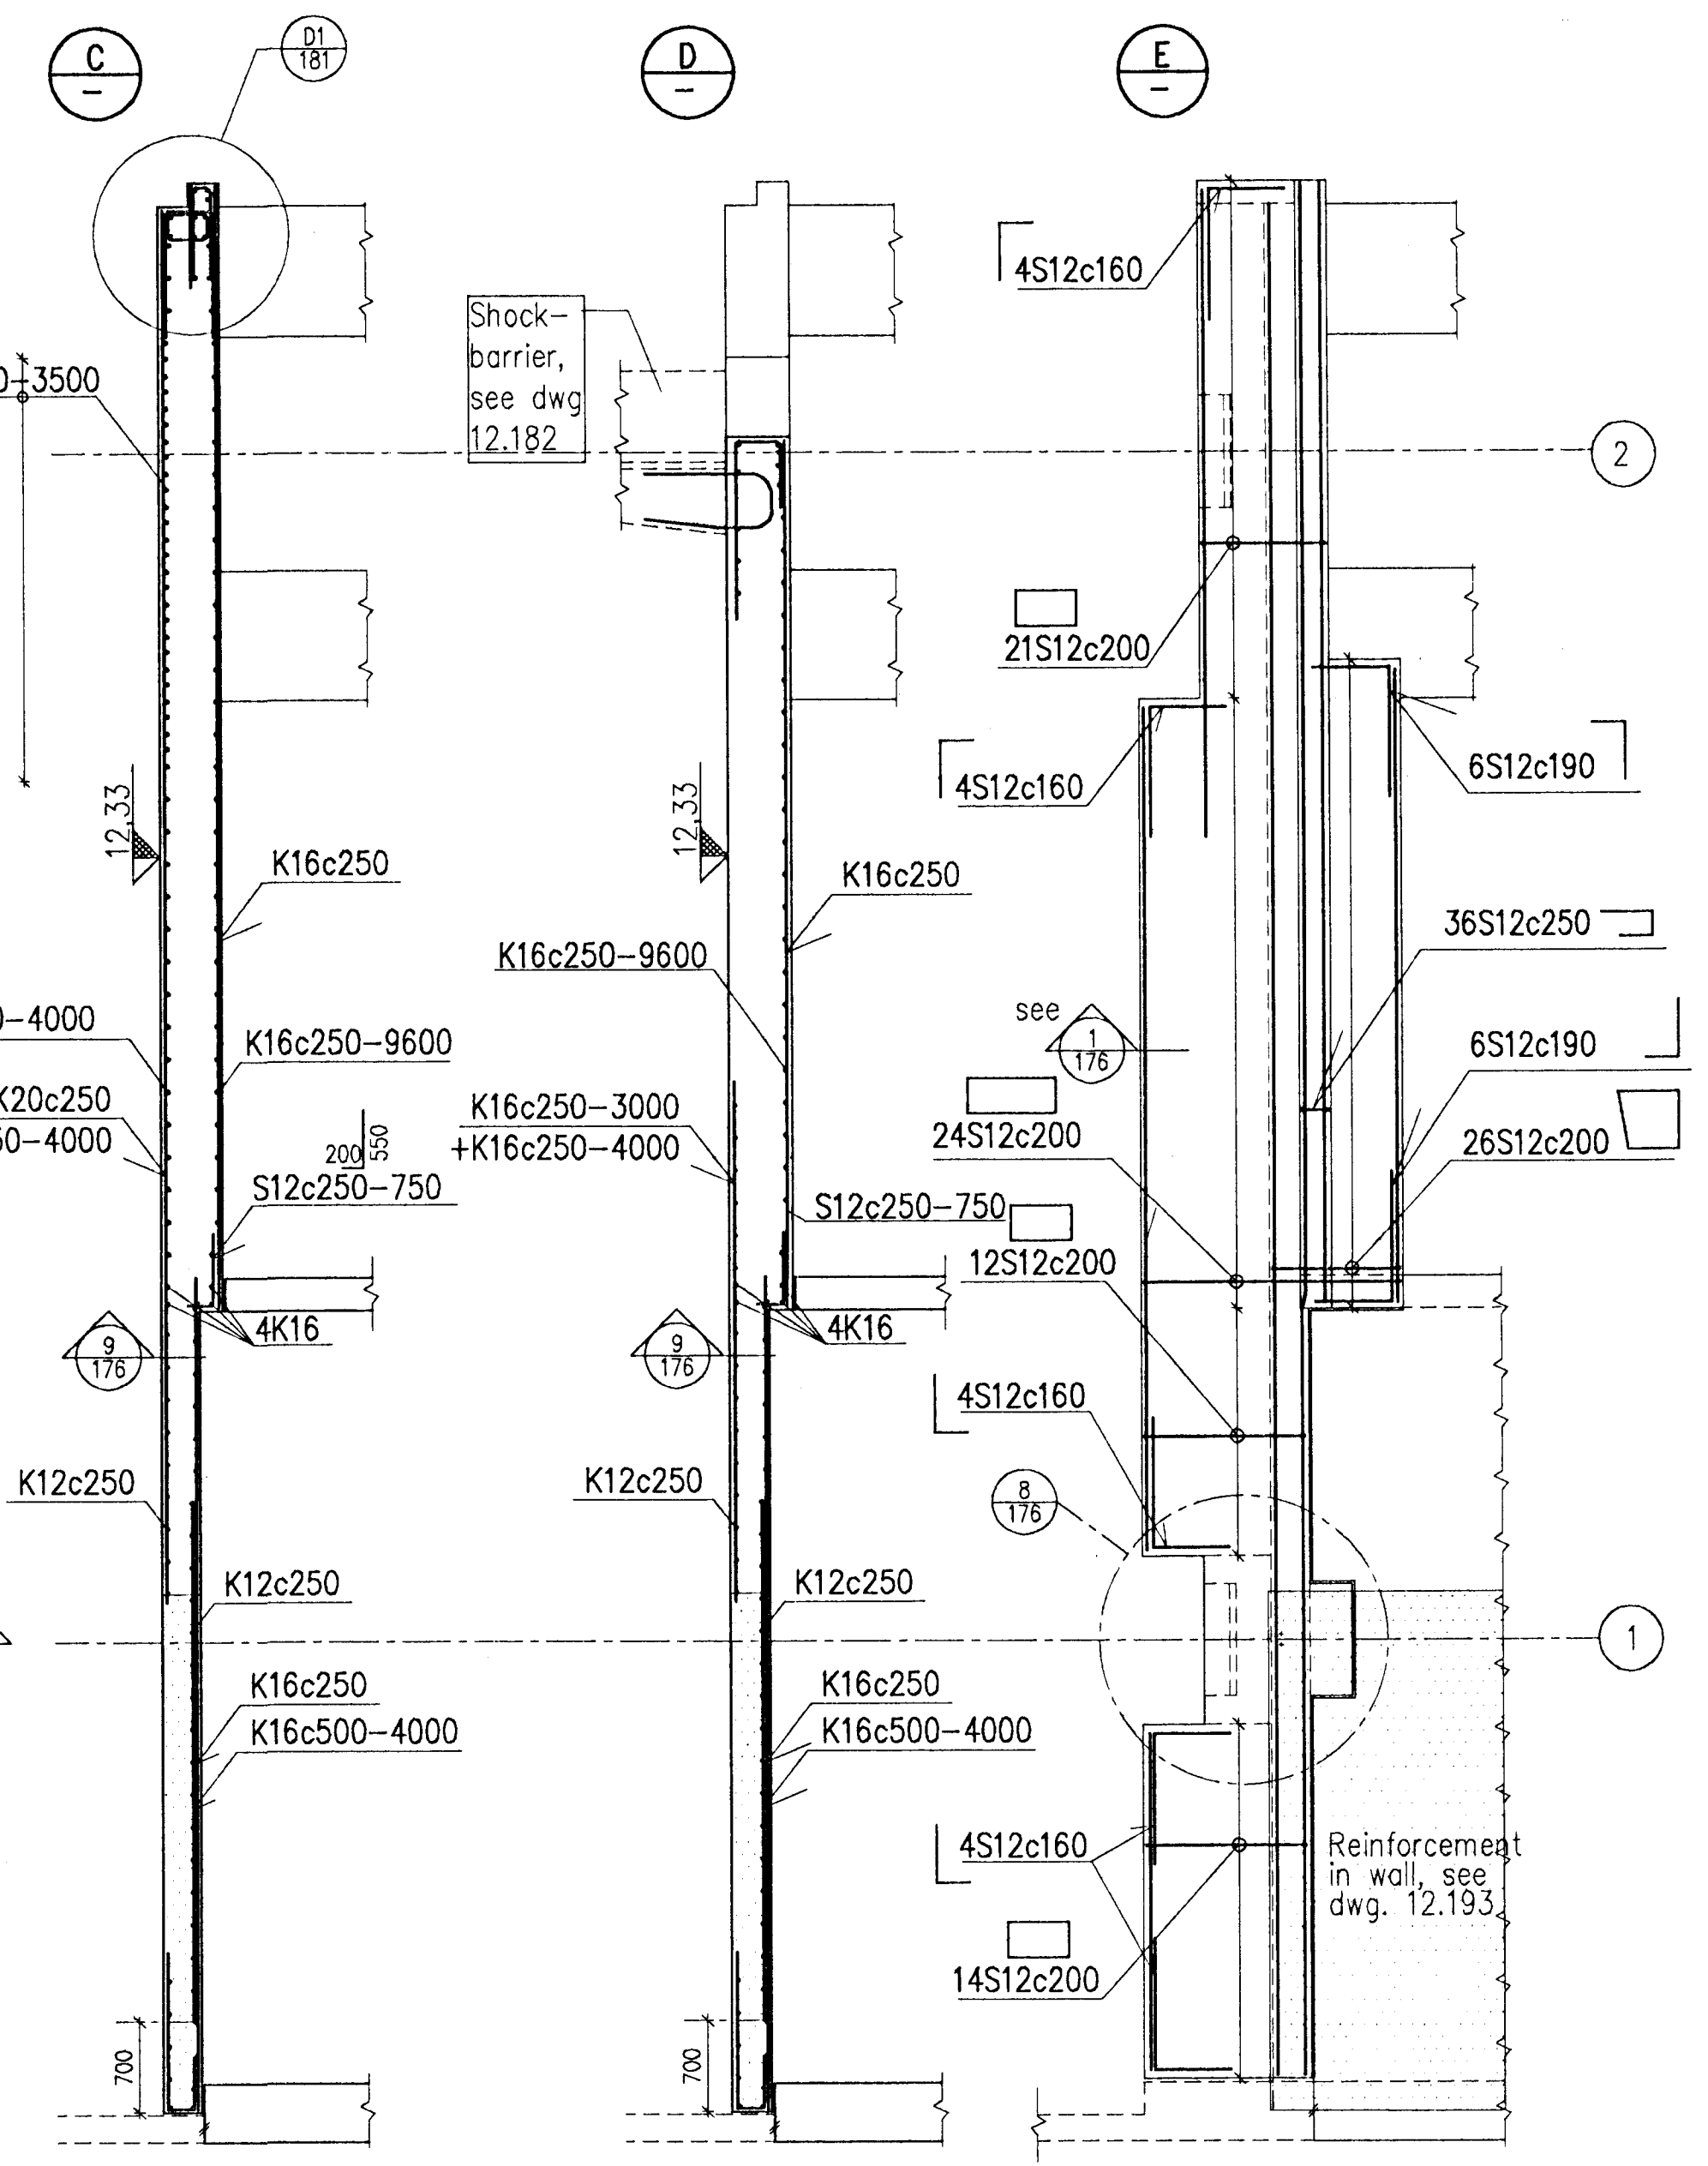



TABLE T5 1 Piece

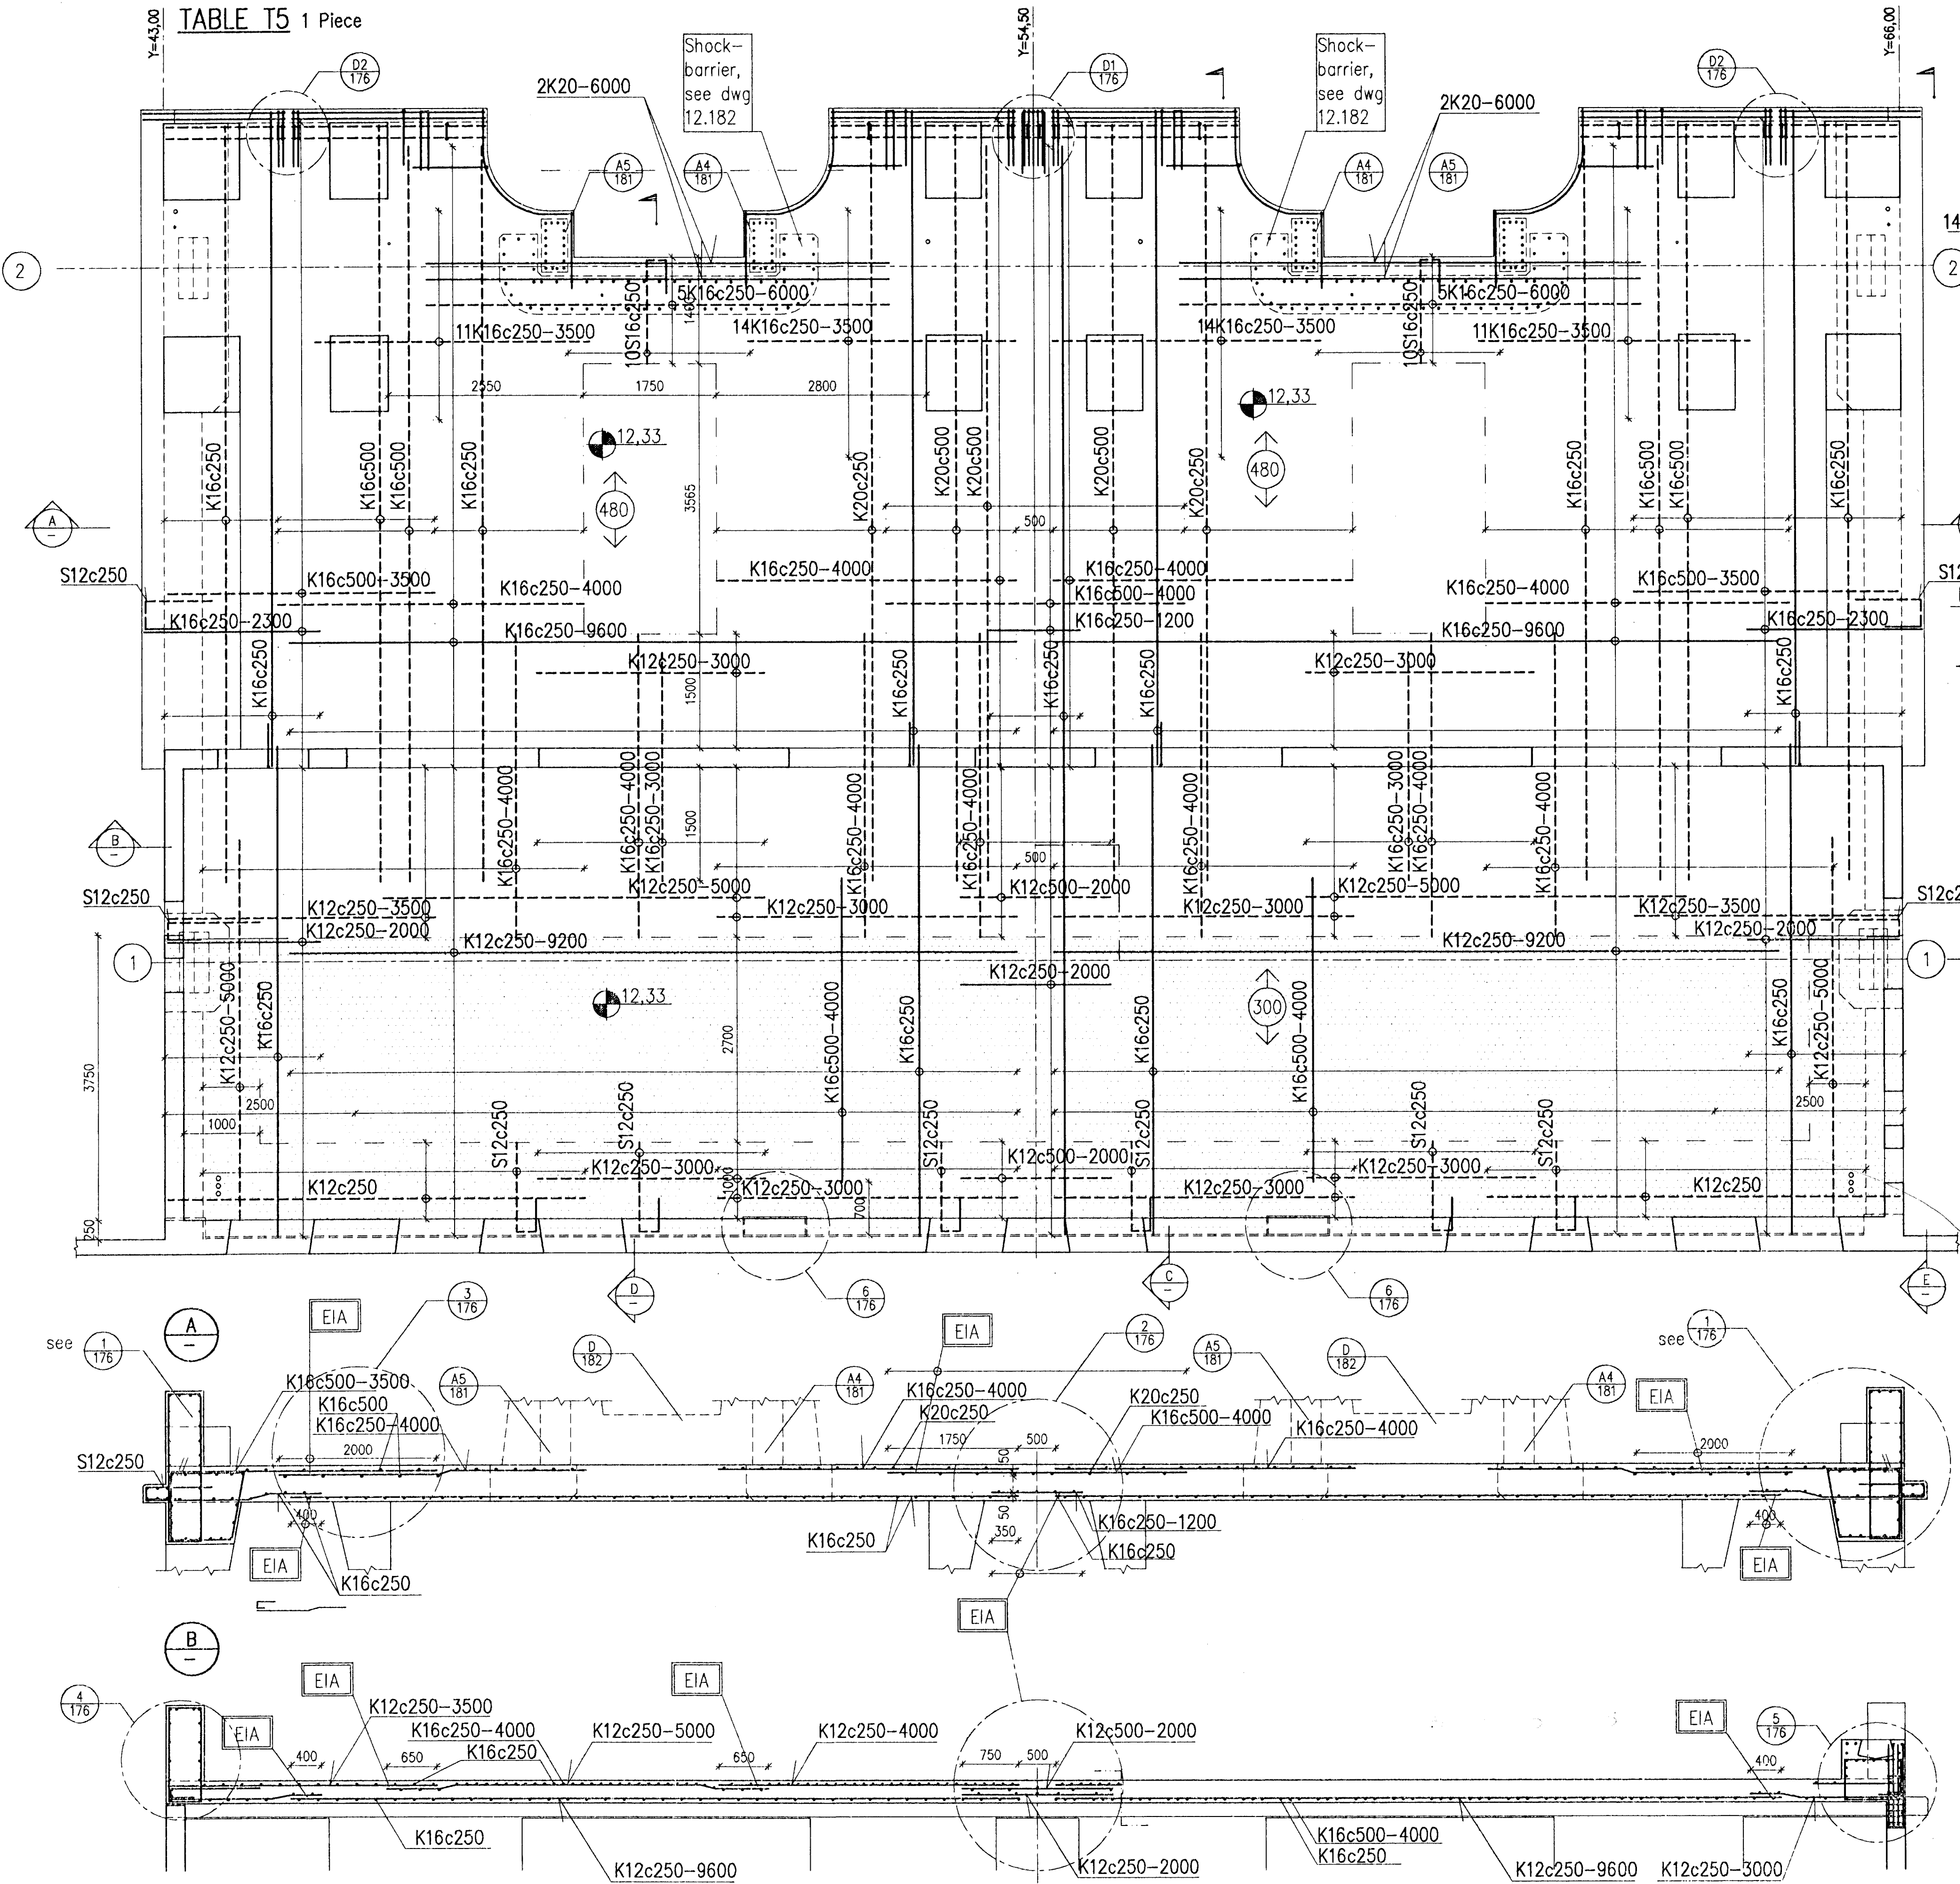

Reinforcement bars to be isolated

EIA Areas where reinforcement is disconnected. No connection between reinforcement layers is allowed. Before concreting, distance 50 mm between layers must be chequed.

HAFAHAFURÐUR
BYGGINGAFLUTUNIR
AFGREITT
28/3/96
B.S.

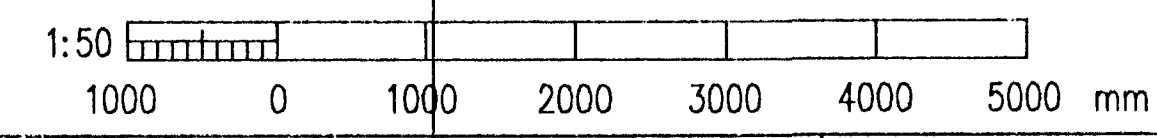

VST CONSULTING ENGINEERS Ltd. Armula 4 108 Reykjavik Iceland Tel: +354 569 5000 Fax: +354 569 5010		95.120 - 12.174
ICELANDIC ALUMINIUM COMPANY LTD.	DRAWN 95.11.30 KGS APPROVED 95.11.30 KGS PROCESS 95.11.30 NI PROJECT 95.11.30 NI SCALE 1:50 FORMAT A1	POTROOM NO. 3 CONCRETE WORK TABLE T5 REINFORCEMENT
ALUSUISSE ALESA	ALESA ALUSUISSE ENGINEERING LTD. ZURICH SWITZERLAND	79000-32374
ICELANDIC ALUMINIUM CO. LTD		186.674

REV. NO.	DATE	REVISION	BY	APP.	REV. NO.	DATE	REVISION	BY	APP.	NOTES	REFERENCE DRAWING	DRAWING NUMBER
1	1996.03.25	APPROVED FOR CONSTRUCTION	KGS	N.I.								

This drawing is our property and given for personal use only. It may not be copied or made available to others without our permission. The receiver is responsible for any misuse.