



GRUNNMYND EFRI HÆÐ  
mkv. 1:50

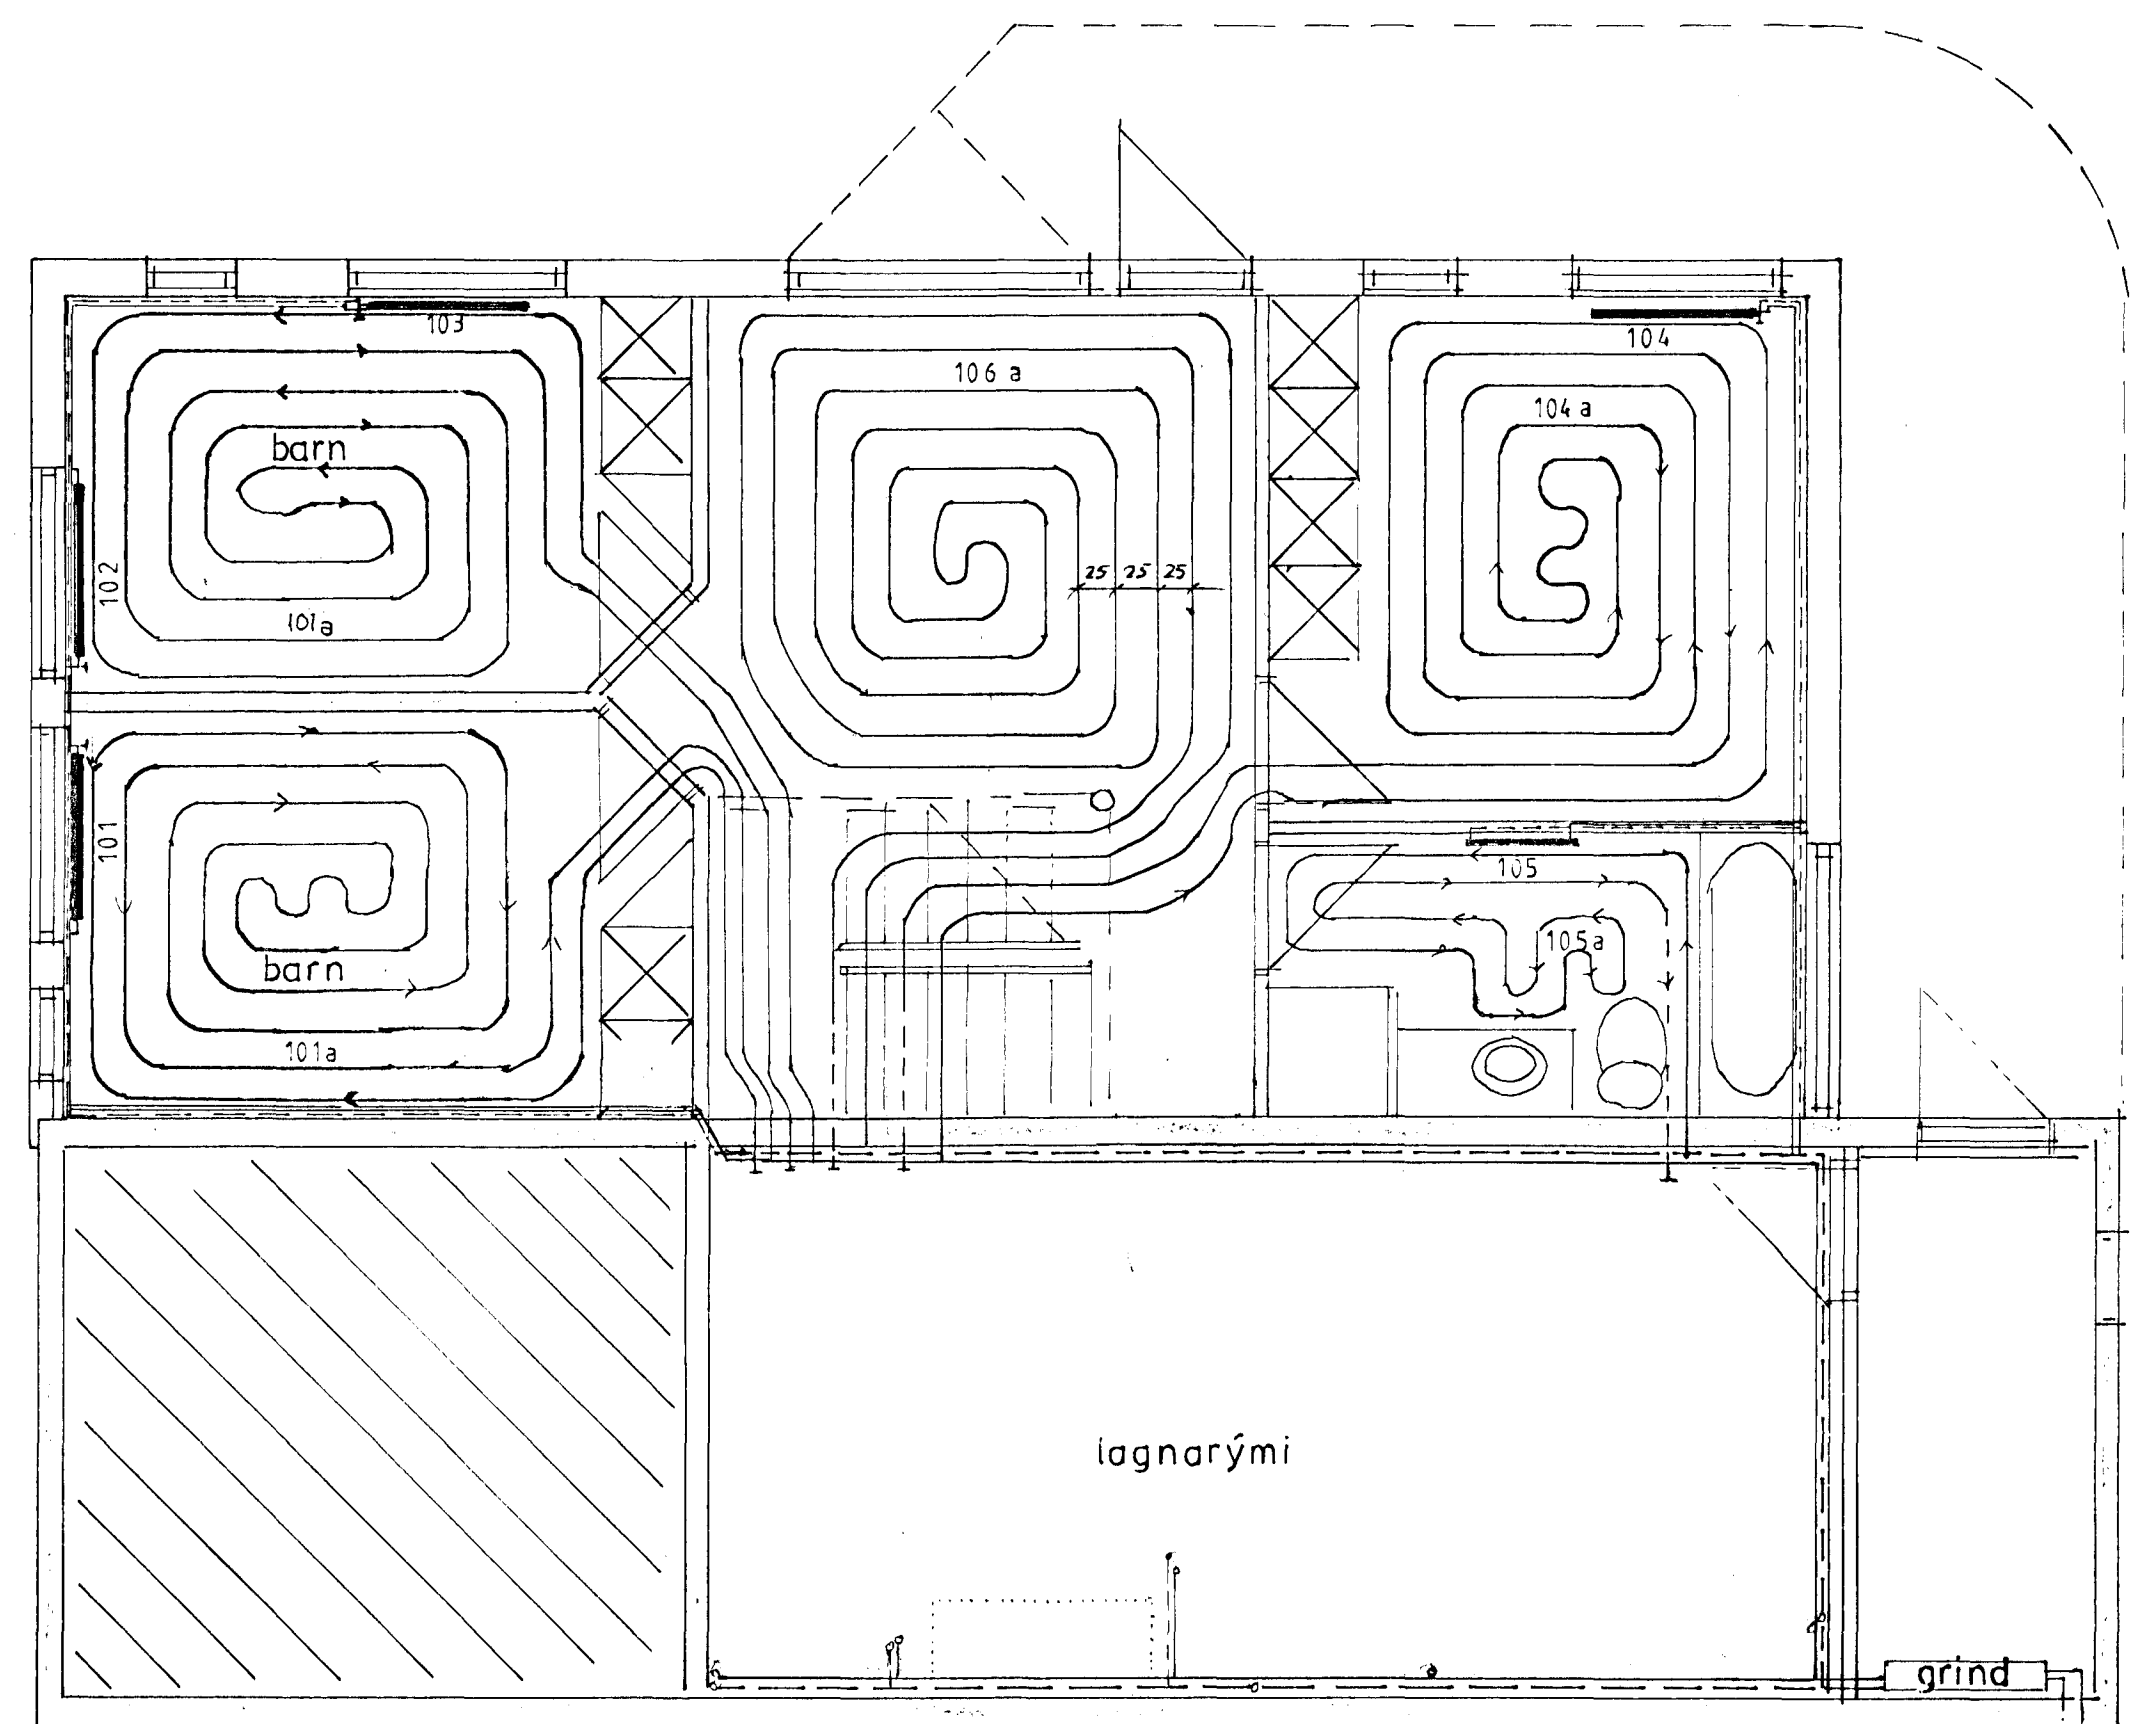

GRUNNMYND NÐRI HÆÐ  
mkv. 1:50

AFSTÖÐUMYND  
mkv. 1:500

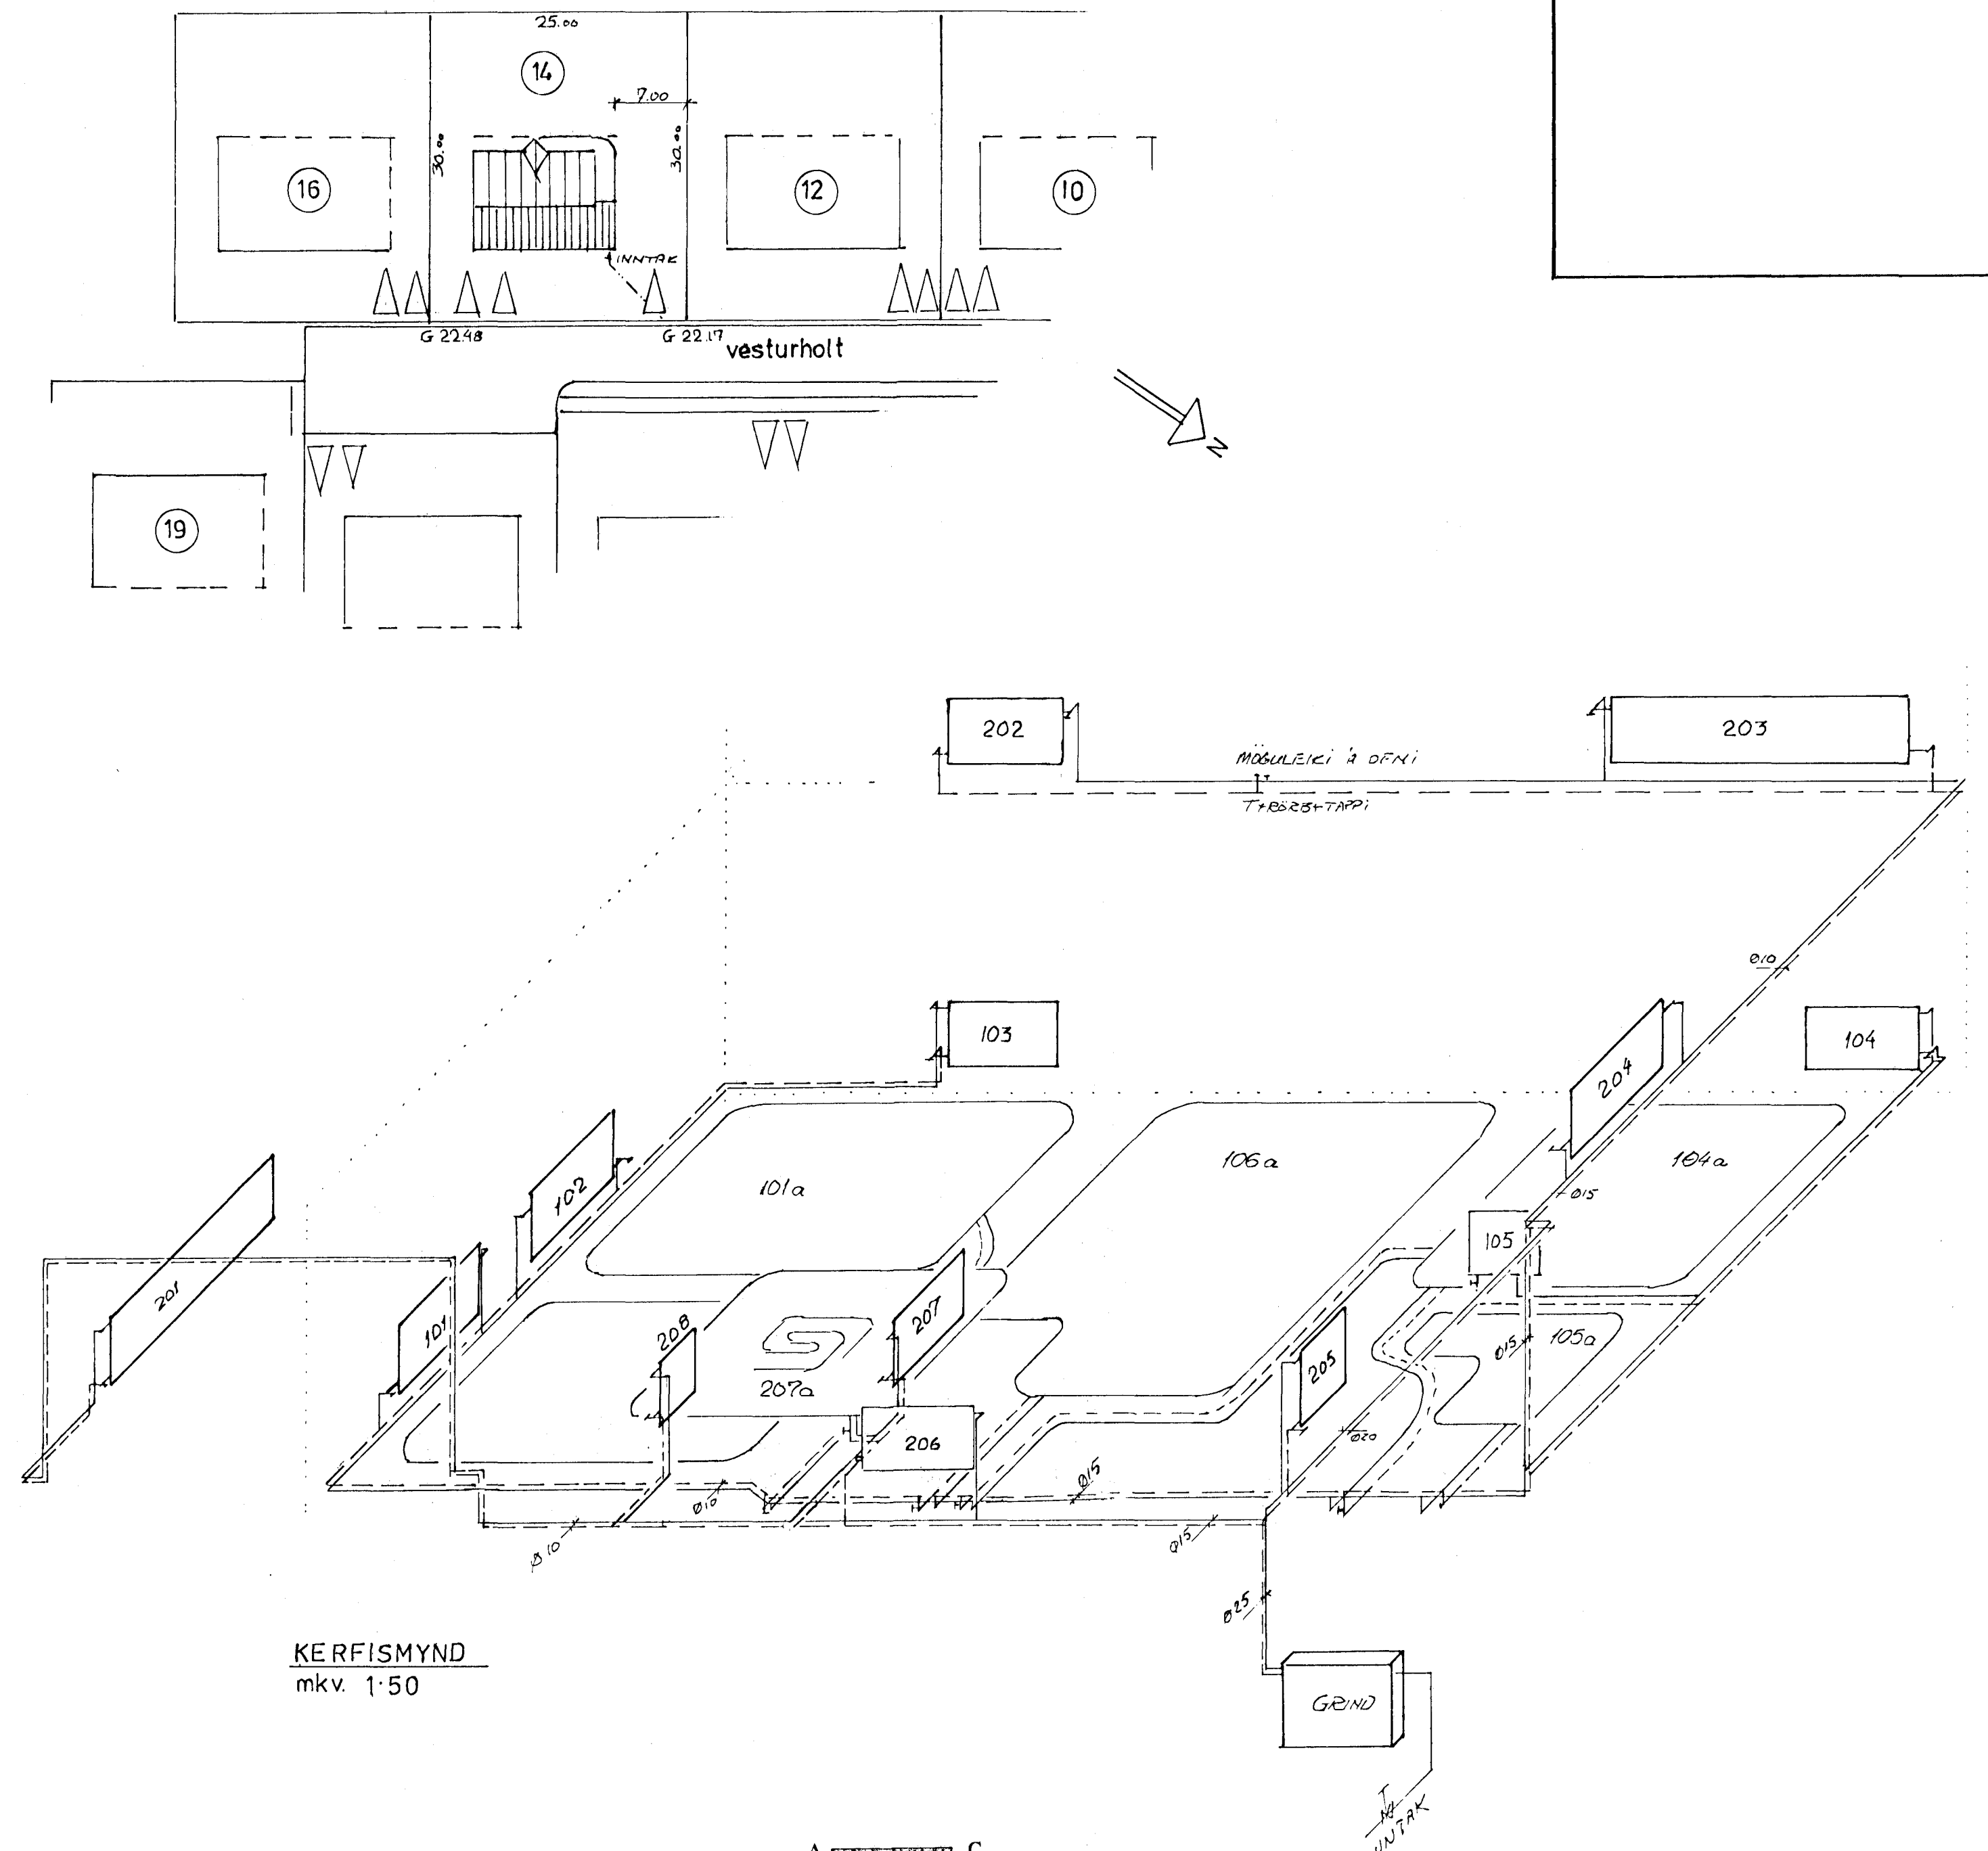

KERFISMYND  
mkv. 1:50

Ofnaskrá  $\Delta t = 40^\circ\text{C}$

nr.	Rými	teg.	reikn. hitatap wött	staða stúta	Stærðir ofna þykkt mm	hæð mm	lengd mm	afköst wött	Tcg. loka
101	Herbergi 1	A	1050	AD	59	600	1130	749	Retúr
101 a	Herbergi 1 og 2	Geisli	400	AB	0	0	0	1200	Retúr
102	Herbergi 2	1	420	AD	59	600	1130	568	Retúr
103	Herbergi 2	1	420	AB	59	600	1130	568	Retúr
104	Hjónaherb.	A	1030	CD	59	600	1130	749	Retúr
104a	Hjónaherb.	Geisli	300	AB	0	0	0	840	Retúr
105	Badherbergi	BRT 60-120	570	BD	59	1200	600	525	Retúr
105a	Badherbergi	Geisli	150	AD	0	0	0	250	Retúr
106a	Sjónvarpsh.	Geisli	1495	AB	0	0	0	1560	Retúr
201	Bílskúr	A	2200	AB	103	600	2290	2292	Retúr
202	Vinnuherbergi	2	866	CB	103	600	1130	909	Túr
203	Stofa	B	2530	CD	103	600	2910	2948	Túr
204	Stofa	B	1315	CD	59	600	1290	1307	Retúr
205	Þvottur	A	380	CD	59	600	640	428	Retúr
206	Eldhús	A	628	AD	59	600	1130	749	Retúr
207	Anddyri	C	912	BC	103	600	1130	749	Retúr
207a	Anddyri	Geisli	150	BC	0	600	1130	420	Retúr
208	Salerni	A	212	AD	103	600	480	321	Retúr
samtals wött			<b>15.028</b>	samtals wött			<b>16.811</b>		

Allt efni og öll vinna skal vera í samræmi við gildandi reglugerðir og staðla

Rör í geislahita skal vera úr hitspolum PEX-plastpörum Ø15mm / Ø20mm

*Pægir Þorgeirsson*

Dags: okt 96	Hann/tekn. Yfirfarid:	Samþ:	Mkv: 1:50	Pergeir Þorgeirsson fff: Dst. hus 105 112 Pvk
Heiti: Vesturholt 14 Hafnarf.		Kemur í stað: Vikur fyrir:		Nr.: 1080
Tilvisun:		Útreikn:		