

HITALÖGN SKYRNGAR:

FITTINGS: SVARTUR RANDFITTINGS

EINANGRUN: 20mm. GLERULLARHOLKAR VAFDIR SISALPAPPA.


OFNLOKAR: A FRAMRENNSLI T.D. DANFOSS RAVL-3/8" SEM STYRAST AF HERBERGISHITA

A BAKRENNSLI T.D. DANFOSS FJVR-3/8" SEM STYRAST AF HITASTIGI BAKRENNSLIS.

OFNAR: STALOFNAR PROFADIR VID 8 kg/cm. loftaskrúfur á öllum ofnum

prófun: lögna skal prófa við 6 kg/cm. SEM STANDA SKÁL I 12 KLST. AN ÞESS AD FALLA.

ATH: OFNASTÆRDIR SKAL ENDURSKODA A STADNUM ADUR EN OFNAPONTUN ER GERD.

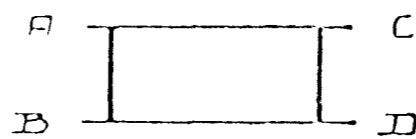

$\Delta t = 40^\circ C$

OFN NR.	GERD	LENGD	HLEÐ	RFK.	TENGING	VALDIR OFNAR
	CM	CM	Kcal h	FRAM	BAK	GERD RFK.
12	110	60	750	C	D	
13	110	60	870	A	B	
14	160	60	1520	A	B	
15	210	60	2400	C	D	
16	110	60	580	A	B	
17	110	60	1370	C	D	

TAFLA YFIR TOPPUNARSTADI							
TEKI			KALDIR KR.		HEITIR KR.		
SK.	HEITI	FJ.	VIÐD 15mm	20mm	SAMT.	VIÐD 15mm	20mm
V5	VATNSFALLARNI	1	1		1		
HL	HANDLAUG	1	1		1		1
EV	ELDHÚSVÆKUR	1	1		1		1
ST	STURTA						
PU	PUDTTAVEL	1	1		1		1
UP	UPP PUDTTAVEL						
SV	SKOLVÆKUR	1	1		1		1
BK	BADKAR	1	1		1		1
5B	SLONGUKRANI						
UK	UTIKRANI						
SAMT. EIN							
VIÐD HEIMEDAR & 32 PL PEH.							



ATH! OFNASTÆRDIR SKULU ATHUGAST A STADNUM ADUR EN OFNAPONTUN ER GERD

VESTURHOLT 19 HAFNARFIRDI
 KJALLARI HITALÖGN, VATNSLOGN GRUNNMYND
 JULI 1991 MKV 1:50
 JOHANNES PETURSSON FTFI 5-675107 41