


GRUNNMYND 2. HÆÐ, MKV. 1:50
GÓLFHITI

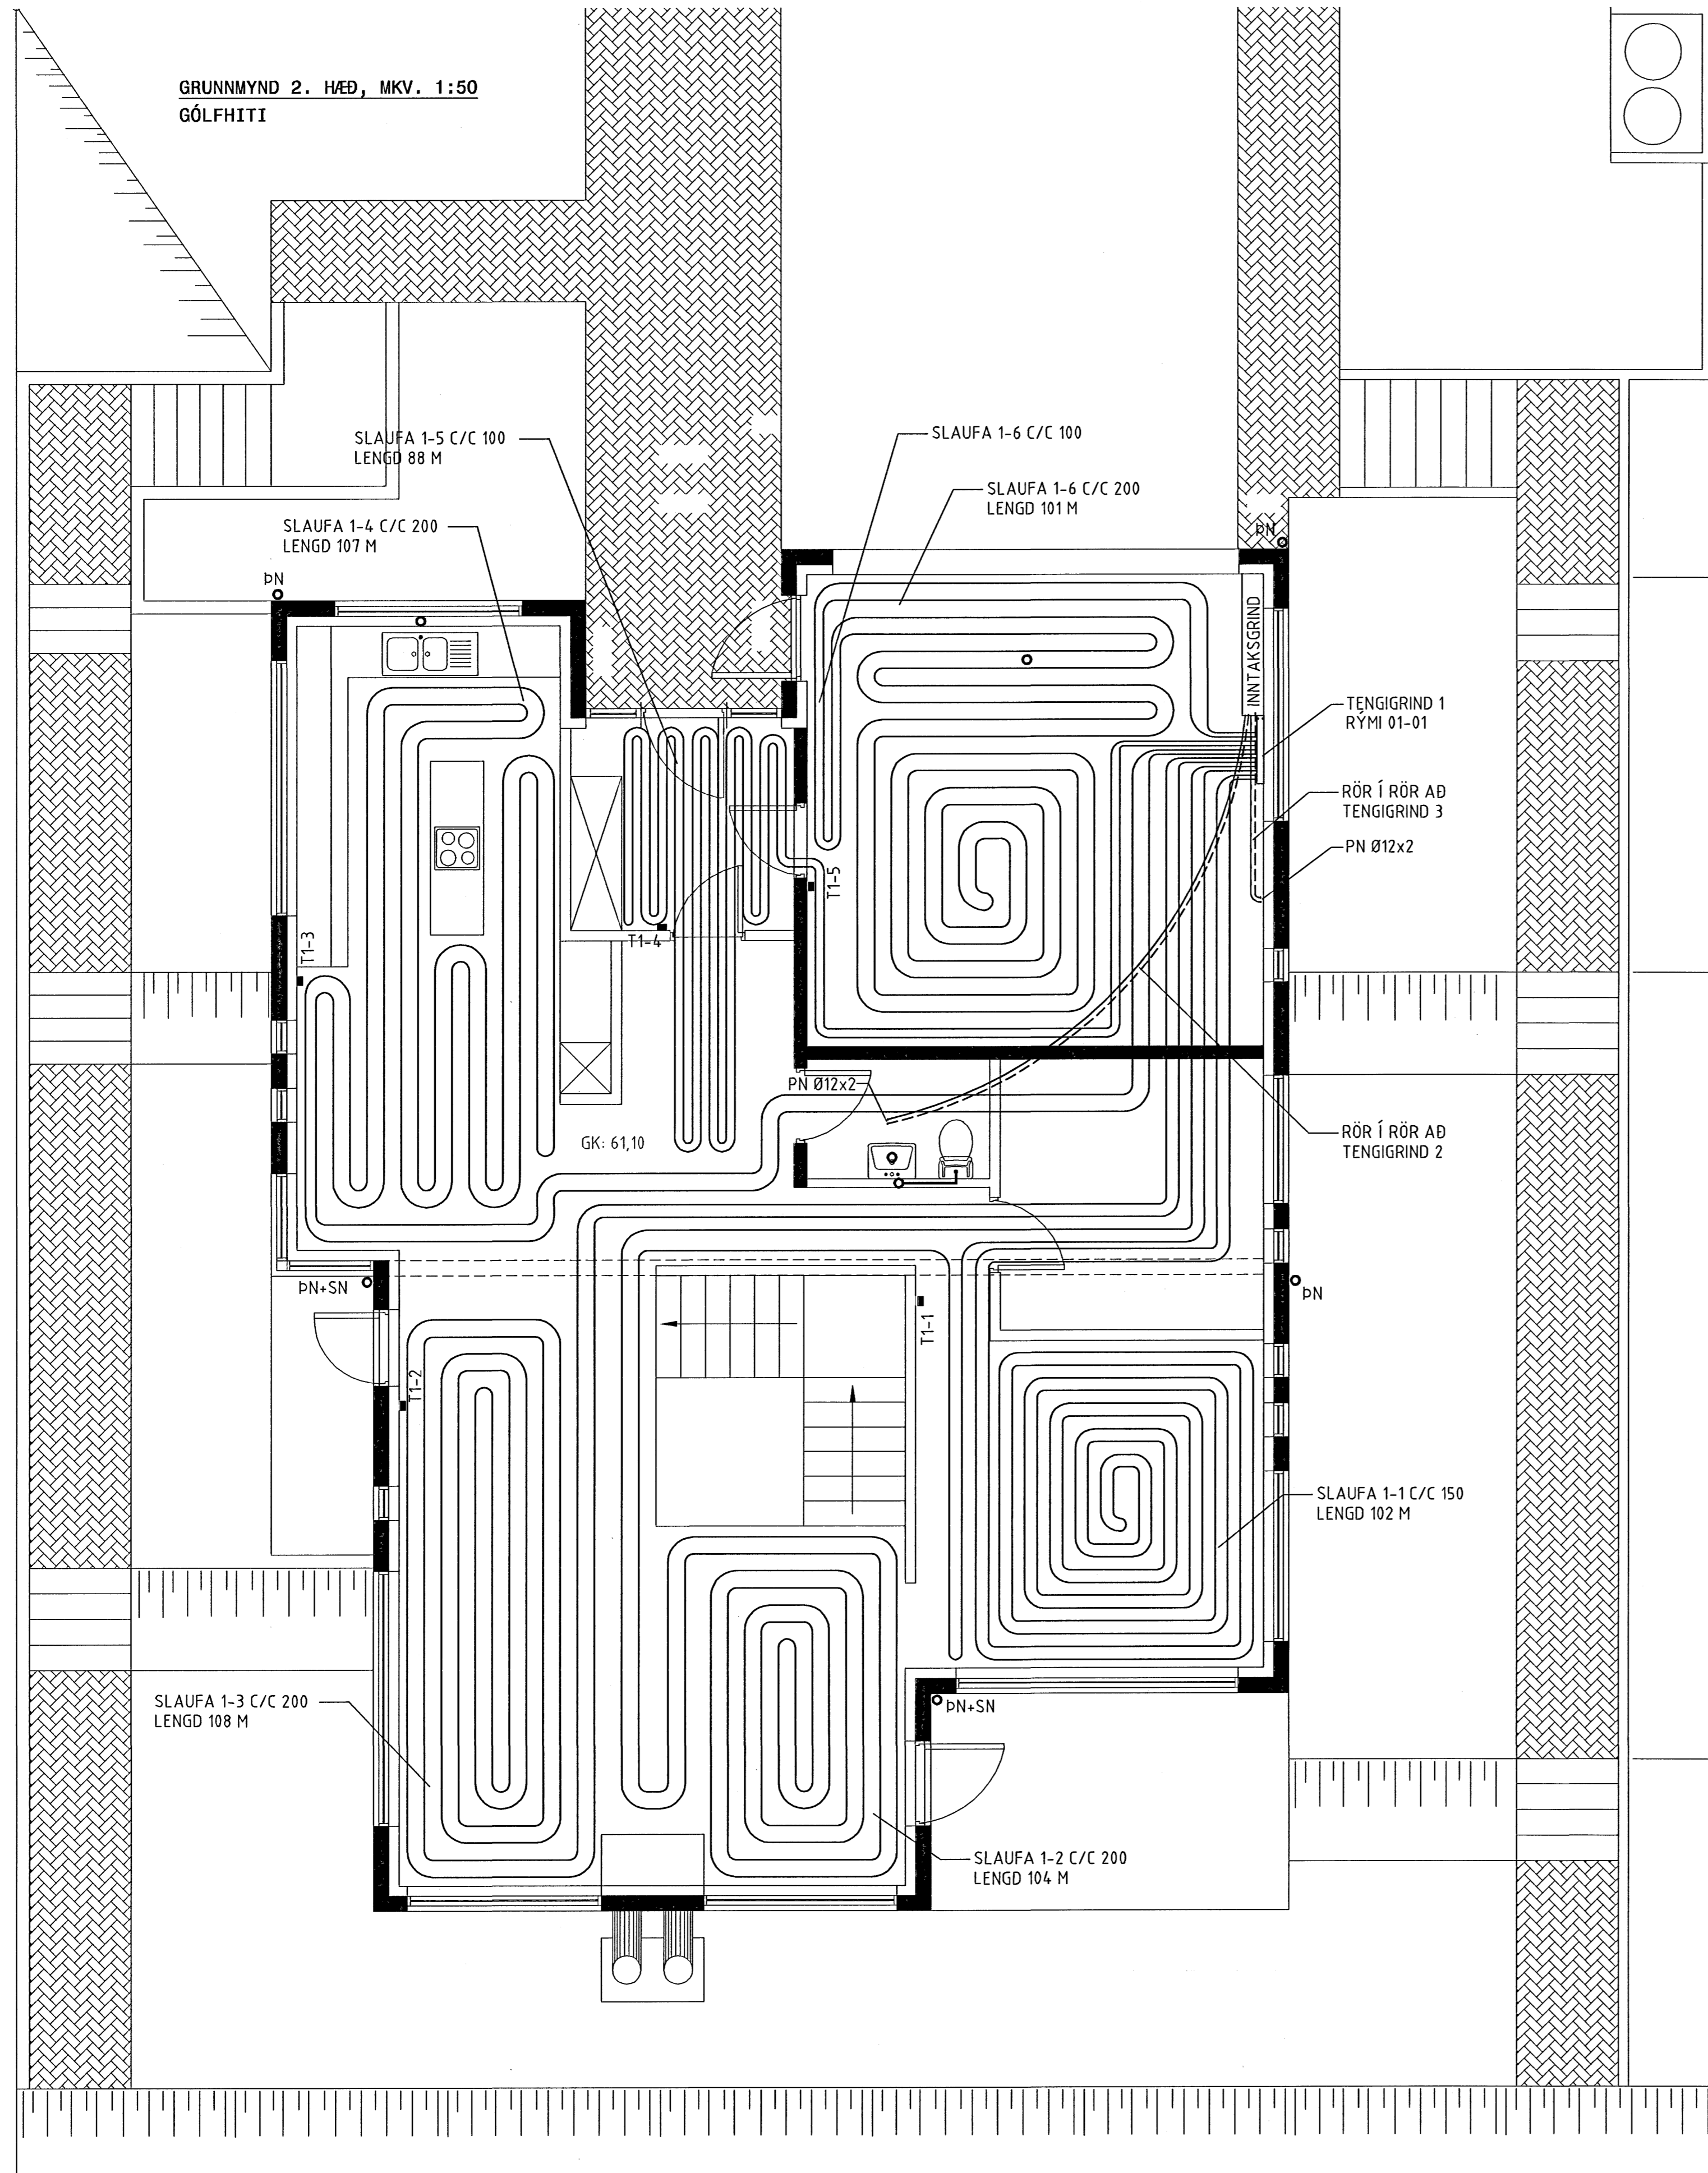

Gólfhiti

Tengigrind 1 (Rými 01-01)						
Slaufa nr.	Afköst [W]	Bil milli lagna [mm]	Lengd [m]	Herbergishiti [°C]	Vatnsmagn [l/mín]	Stýring
1-1	956	150	102	20	1.71	T1-1
1-2	1560	200	104	20	2.80	T1-2
1-3	1620	200	108	20	2.90	T1-2
1-4	1605	200	107	20	2.88	T1-3
1-5	2090	100	88	20	3.74	T1-4
1-6	2651	100/200	101	18	4.75	T1-5
Tengigrind 2 (Rými 01-01)						
2-1	862	200	77	20	1.54	T2-1
2-2	1350	200	90	20	2.42	T2-1
2-3	915	200	61	20	1.64	T2-2
2-4	1052	200	94	20	1.89	T2-3
2-5	903	150	43	22	1.62	T2-4
Tengigrind 3 (Rými 01-02)						
3-1	645	200	43	20	1.16	T3-1
3-2	903	150	43	22	1.62	T3-2
3-3	1102	150/200	58	20	1.97	T3-3
3-4	1440	200	96	20	2.58	T3-4
Samtals	19,655		1215		35.22	
Reiknuð þörf er 19.455 W			T = hitastillir á vegg, stýrir samsvarandi mótrolukum			

Byggingafultrúi Hafnarfjarðar
Alfreitt Þann
01 NOV 2005

ALMENNAR SKÝRINGAR SJÁ TEIKNINGU NR. 0519-301

NR	DAGS	BREYTING	SAMP

LAGNA- OG VÉLAHÖNNUN
-HÖNNUN OG RADGJÖF-

LAGNA- OG VÉLAHÖNNUN EHF.
HÁALEITISBRAUT 103, 104 R
SÍÐI 859 0618
NEIFANG: thor.gunnarsson@stinet.is
ÞÓR GUNNARSSON & SÖ. KEI
RÚS 0694-4229

KLUKKUBERG 32 HAFNARFJÖRDUR

HITAKERFI
GRUNNMYND 2. HÆÐ
GÓLFHITASKRÁ

MKV	TEIKN	DAGS ÚTG	TEIKN NÚMÉR
1:50	DAG	05.09.30	0519-304
ÁRITUN HÖNNUNAR	ST	290960-4229	SAMPYKKT
HÖNNUNUR BREYTINGAR	DAGS BREYTINGAR		BREYTING NR