
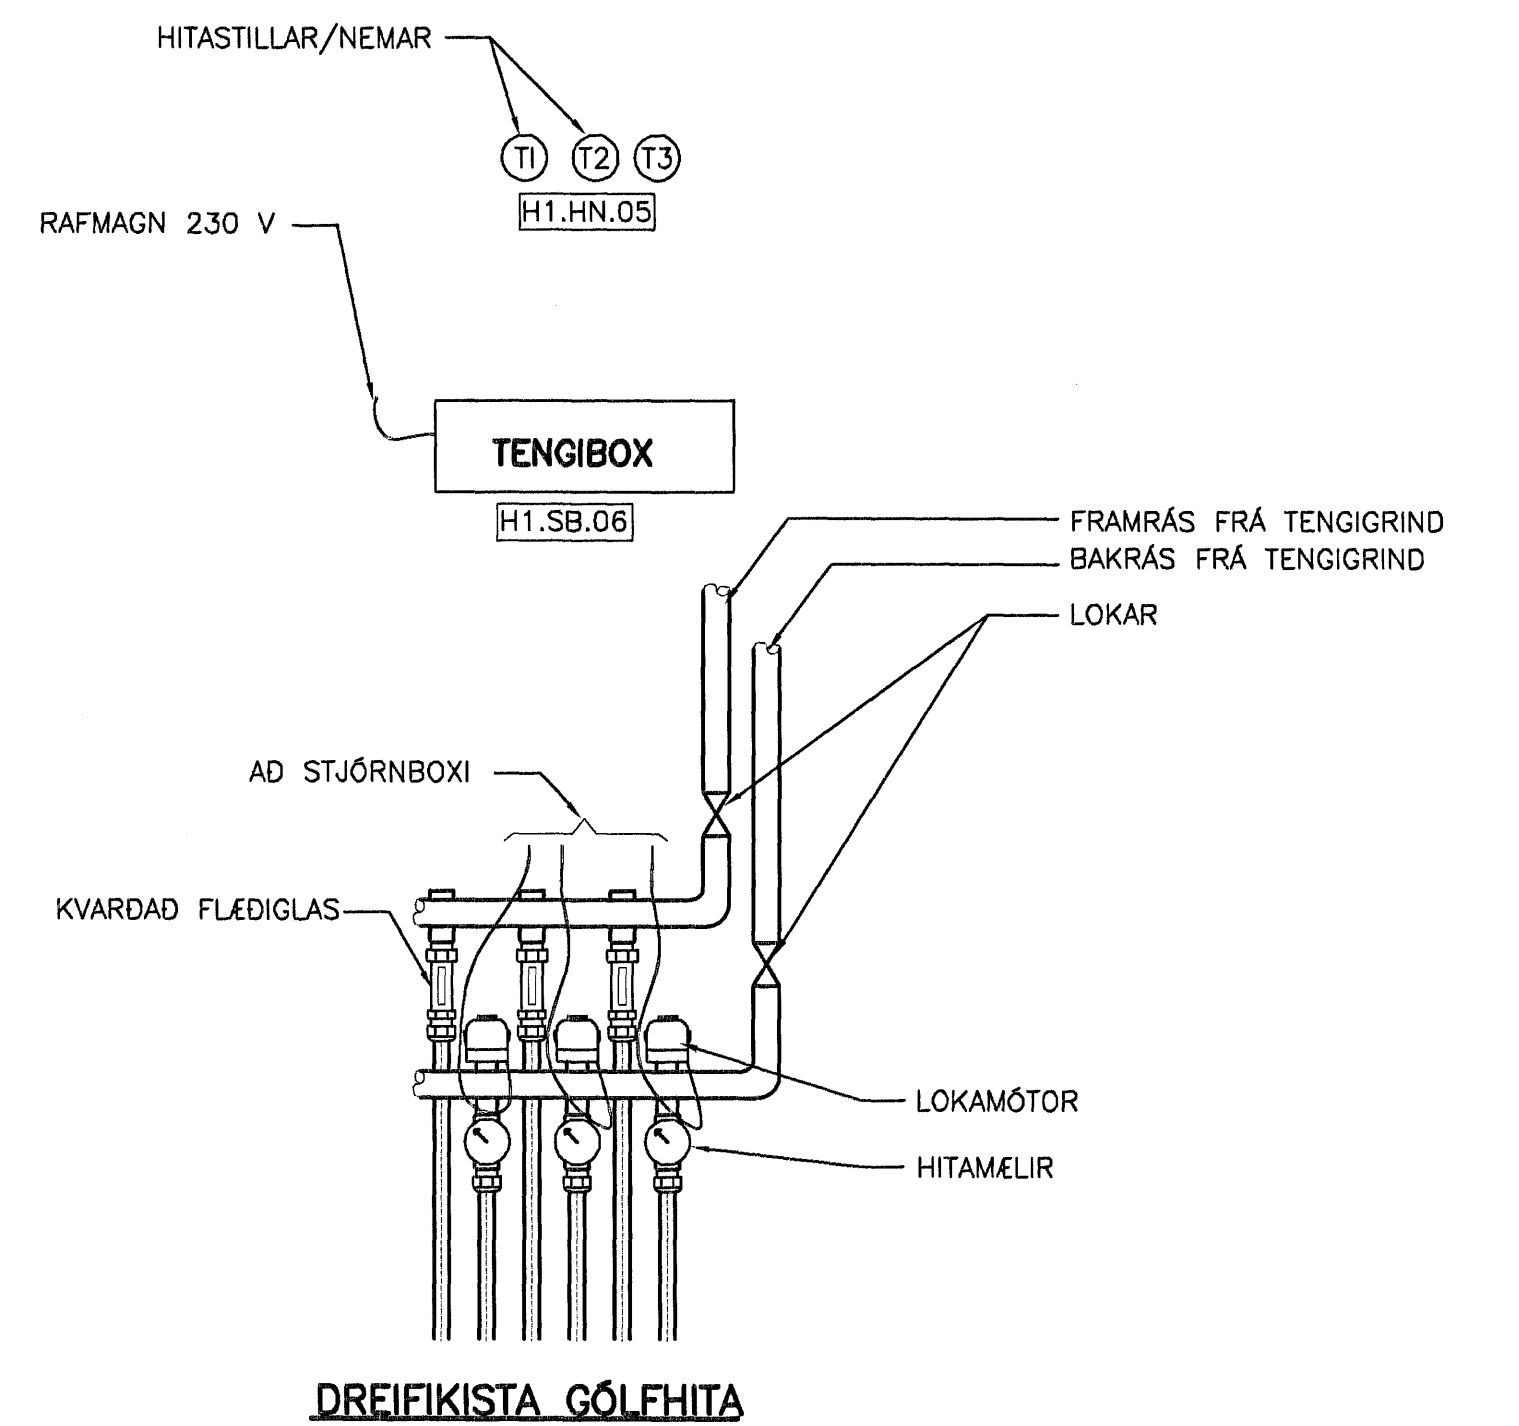


DAGS	NR	BREYTINGAR	SAÐR.

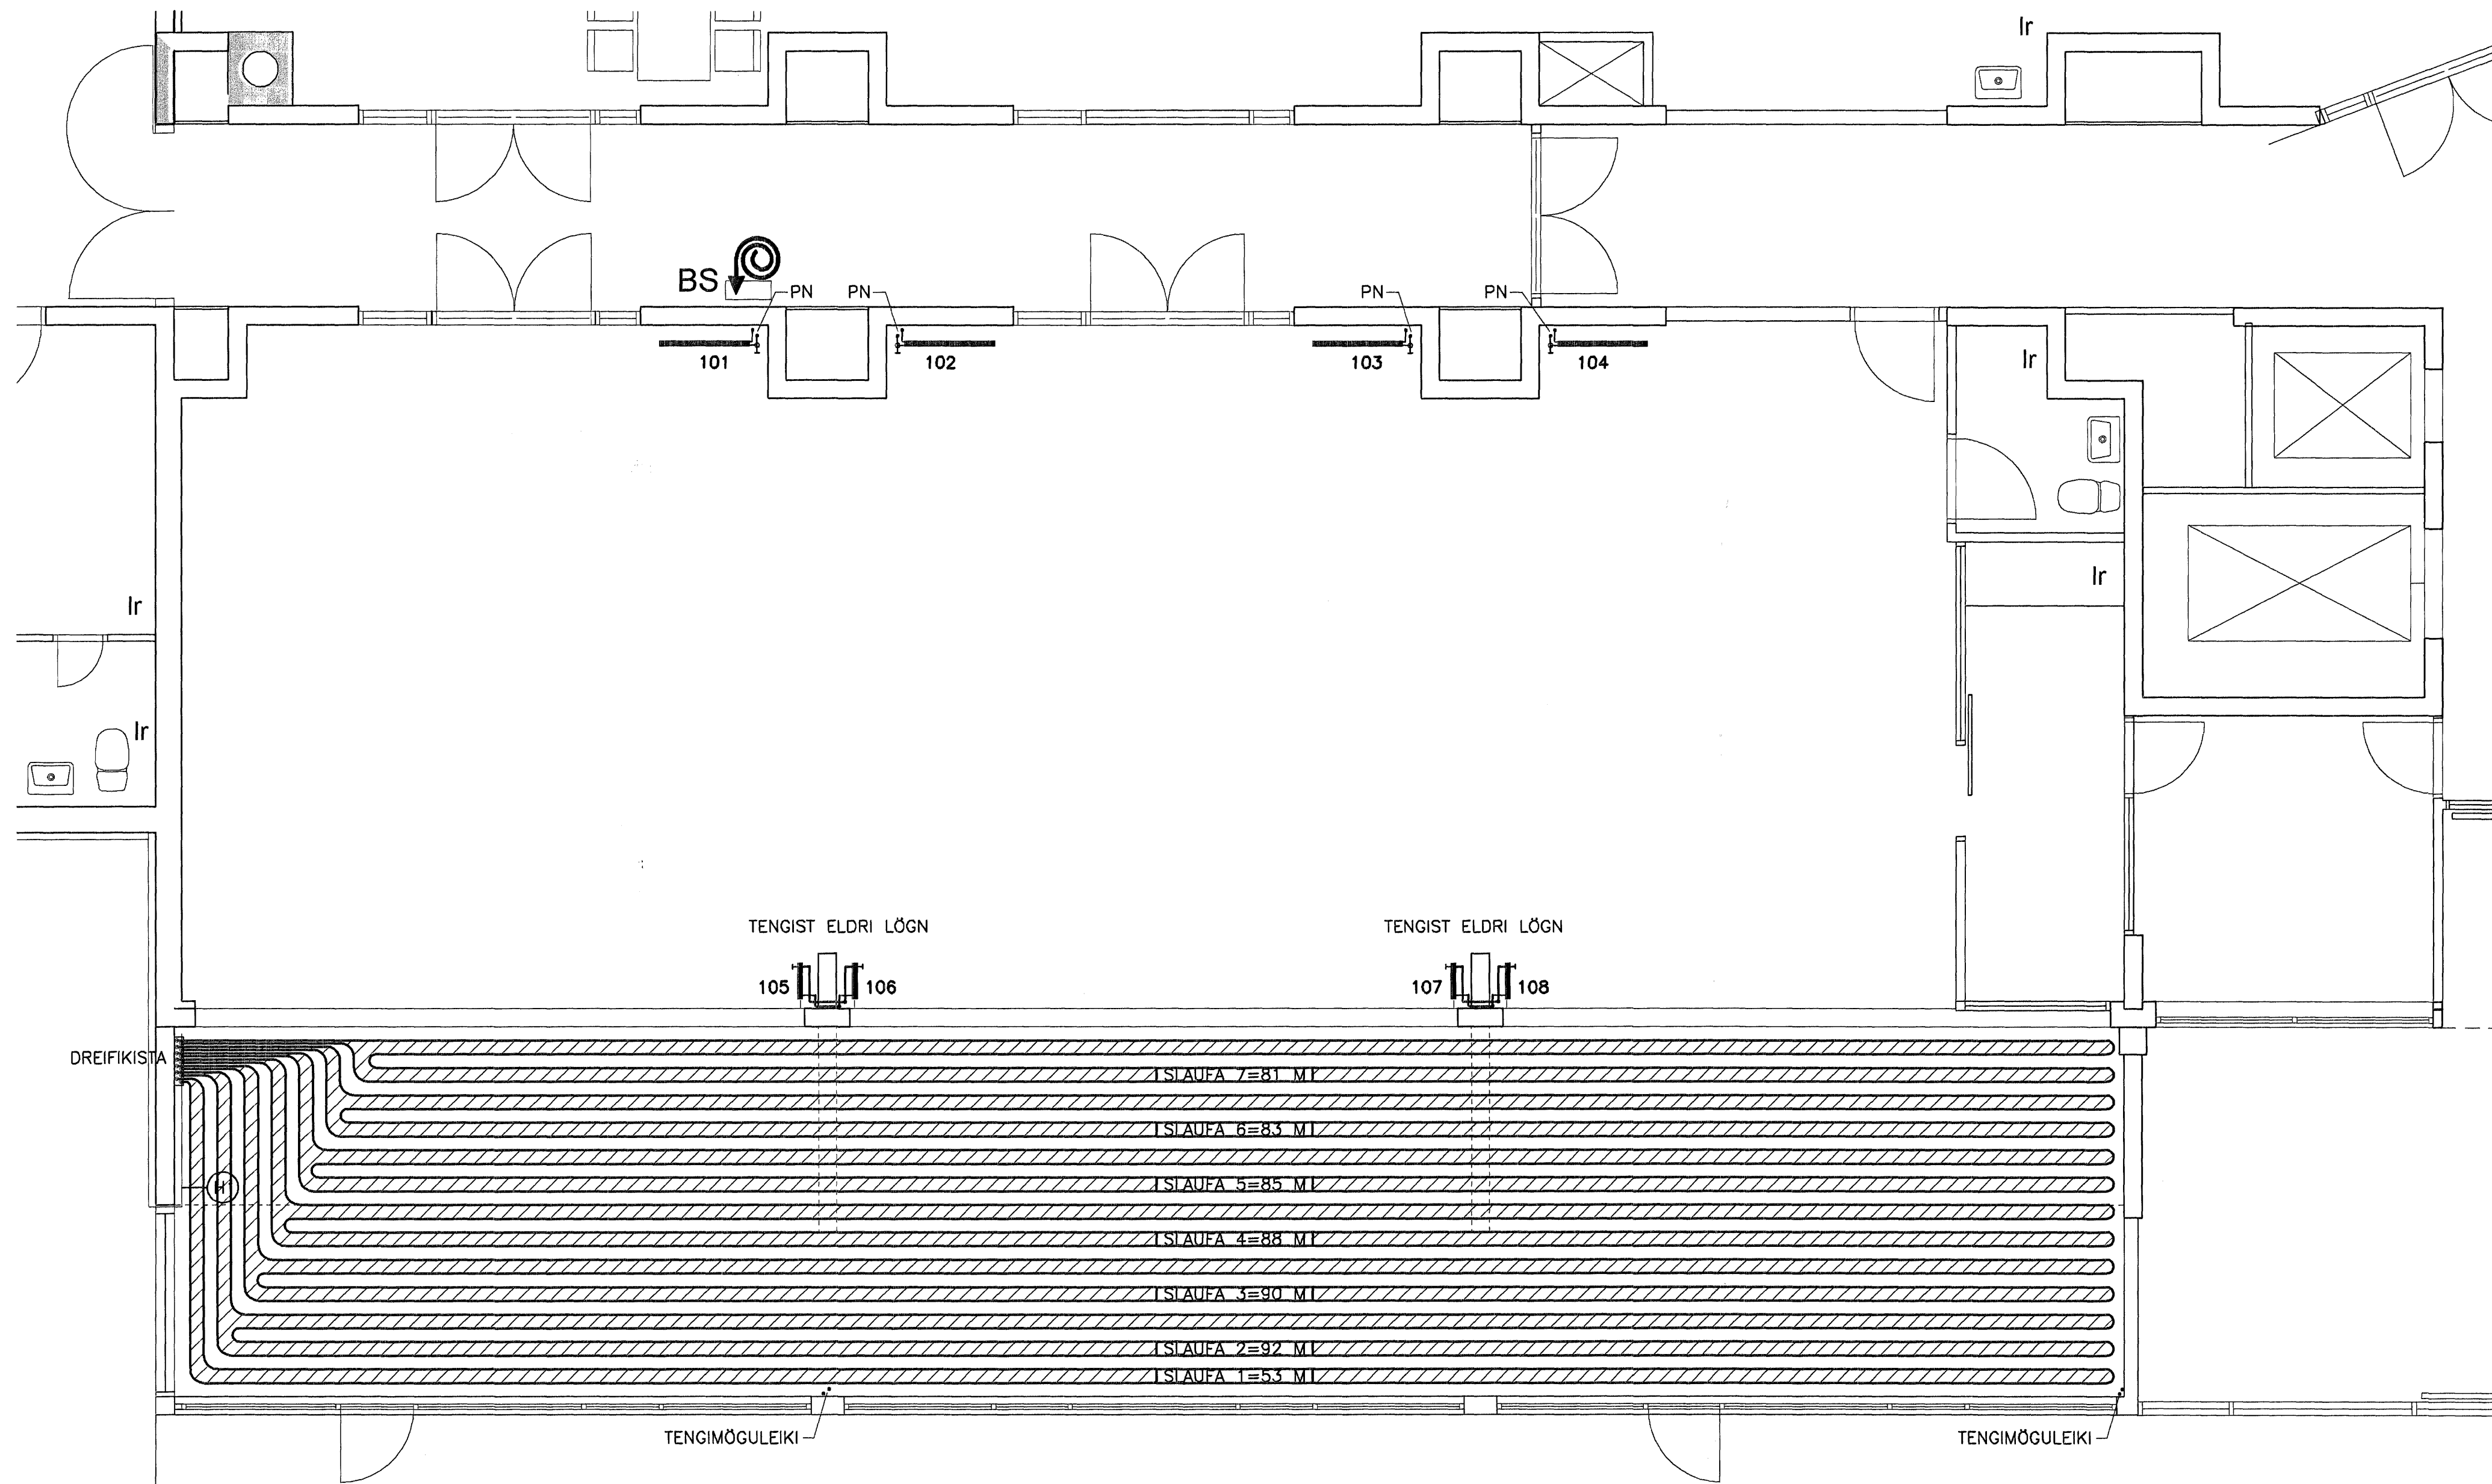



GRUNNMYND, 1:50

OFNASKRÁ $\Delta t = 40^\circ\text{C}$

HITASTIG VATNS: $80^\circ\text{C} - 40^\circ\text{C}$

OFN NR.	NAUÐSYN-LEGT AFL W	HERBERGI	MAX HÉÐ mm	MAX LENGÐ mm	OFNLOKAR	STILLI-TALA	Kv m ² /h
101	1400	SAMKOMUSALUR	600	1000			
102	1400	SAMKOMUSALUR	600	1000			
103	1400	SAMKOMUSALUR	600	1000			
104	1400	SAMKOMUSALUR	600	1000			
105	1200	SAMKOMUSALUR	1200	400			
106	1200	SAMKOMUSALUR	1200	400			
107	1200	SAMKOMUSALUR	1200	400			
108	1200	SAMKOMUSALUR	1200	400			
Samt.	10400						

Sampykkt þann
10 JULI 2007
Byggingulltrúinn í Hafnarfirði
F.h. Sigurbjartur Halldórsson

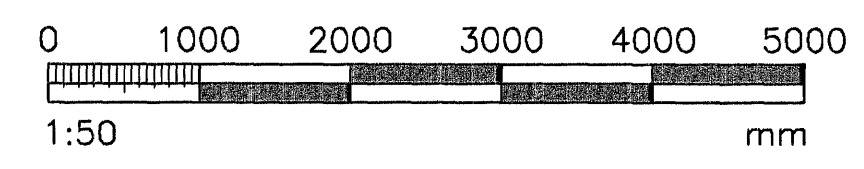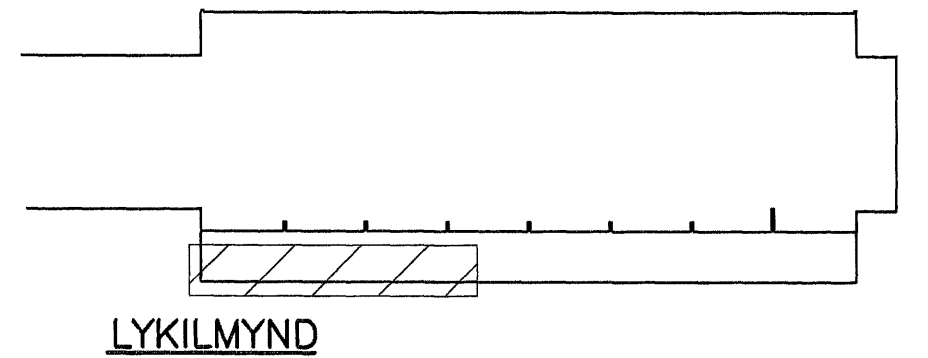

VERKFRÆÐIÞJÓNUSTAN EHF

SKEFAN 10 · 108 REYKJAVÍK · Sími: 517 9050 · Netfang: jang@stentek.is, gho@stentek.is

HEITI VAXIS: HRAUNVANGUR 7 (Hrafnista) HAFNARFIRÐI	VERKNUMER: 511	DAGS: 23.04.07
HEITI TEIKNINGAR: HITAKEREL GRUNNMYND	FRAMTAKA: Jón Guðmundsson 280255-4329	FRUMTÖGAFI: 1:10
SAÐR. NR: 511	TEIKNAR: [Signature]	